

TECHNICAL SPECIFICATIONS

FOR

**ALTERATION TO STUDENT SERVICES ANNEX (A#33484)
EXTERIOR DOOR REPLACEMENT**


**VENTURA COUNTY COMMUNITY COLLEGE DISTRICT
Bid No.**

FOR

**MOORPARK COLLEGE
7075 CAMPUS ROAD
MOORPARK, CA 93021**



William J Amador, ARCHITECT
AMADOR WHITTLE ARCHITECTS, INC

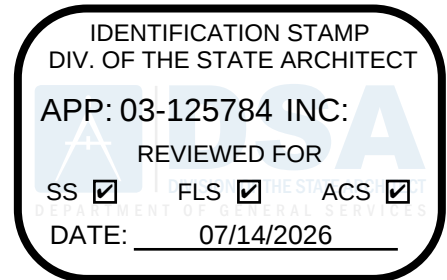

**TECHNICAL SPECIFICATIONS
FOR
MOORPARK COLLEGE ALTERATION TO STUDENT SERVICES ANNEX (A#33484)
EXTERIOR DOOR REPLACEMENT**

DIVISION 00 – PROCUREMENT AND CONTRACTING REQUIREMENTS

00000	Title Page	01
00100	Table of Contents.....	02

DIVISION 1 – GENERAL REQUIREMENTS

01 1100	Summary of Work	04
01 3113	Project Coordination.....	05
01 3300	Submittal Procedures.....	08
01 7329	Cutting and Patching	07
01 7419	Construction and Demolition Waste Management	04
01 7700	Contract Close Out	07
01 7836	Warranties	03

DIVISION 2 - DEMOLITION

02 4116	Demolition	04
---------	------------------	----

DIVISION 3 – CONCRETE – NOT USED

DIVISION 5 – METAL FABRICATIONS – NOT USED

DIVISION 6 – WOOD, PLASTICS, AND COMPOSITES – NOT USED

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

07 9200	Joint Sealants	06
---------	----------------------	----

DIVISION 8 - OPENINGS

08 1113	Hollow Metal Doors	09
08 7100	Door Hardware.....	15

DIVISION 9 - FINISHES

09 9000	Painting and Coating	09
---------	----------------------------	----

DIVISION 10 – SPECIALTIES – NOT USED

DIVISION 11 – EQUIPMENT– NOT USED

DIVISION 12 – FURNISHINGS – NOT USED

DIVISION 13 – SPECIAL CONSTRUCTION – NOT USED

DIVISION 14 - CONVEYING SYSTEMSM – NOT USED

DIVISION 21 – FIRE SUPRESSION – NOT USED

DIVISION 22 – PLUMBING – NOT USED

DIVISION 23 – HEATING, VENTILATING, AND AIR CONDITIONING – NOT USED

DIVISION 26 – ELECTRICAL – NOT USED

DIVISION 31 – EARTHWORK – NOT USED

DIVISION 32 – SITE WORK

32 1123	Aggregate Base Courses.....	02
32 1600	Curbs, Gutters, Sidewalks.....	04

DIVISION 33 – UNDERGROUND UTILITIES

33 4000	Storm Drainage Utilities	05
---------	--------------------------------	----

END OF TABLE OF CONTENTS

SECTION 01 1100

SUMMARY OF WORK

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. The furnishing of all labor, materials, equipment, services, and incidentals necessary for Work of the **STUDENT SERVICES ANNEX – EXTERIOR DOOR REPLACEMENT** located at **7075 Campus Road, Moorpark, California 93021**, as set forth in the Construction Documents which include, but are not limited to, the Drawings, Addenda and Specifications.

1.02 RELATED REQUIREMENTS:

PART 2 - PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 USE OF PREMISES

- A. CONTRACTOR shall coordinate Work of all trades, Subcontractors, utility service providers, with OWNER and/or Separate Work Contract. CONTRACTOR shall sequence, coordinate, and perform the Work to impose minimum hardship on the operation and use of the existing facilities and/or Project site. CONTRACTOR shall install all necessary protection for existing improvements, Project site, property, and new Work against dust, dirt, weather, damage, vandalism, and maintain and relocate all protection to accommodate progression of the Work.
- B. CONTRACTOR shall confine entrance and exiting to the Project site and/or facilities to routes designated by the OWNER.
- C. Within existing facilities, OWNER will remove portable equipment, furniture, and supplies from Work areas prior to the start of Work. CONTRACTOR shall cover and protect remaining items in areas of the Work.
- D. CONTRACTOR is advised school may be in session during performance of the Work. CONTRACTOR shall utilize all available means to prevent generation of unnecessary noise and maintain noise levels to a minimum. When required by the OWNER, CONTRACTOR shall immediately discontinue noise-generating activities and/or provide alternative methods to minimize noise generation. CONTRACTOR shall

install and maintain air compressors, tractors, cranes, hoists, vehicles, and other internal combustion engine equipment with mufflers, including unloading cycle of compressors. CONTRACTOR shall discontinue operation of equipment producing objectionable noise as required by the OWNER.

- E. CONTRACTOR shall furnish, install, and maintain adequate supports, shoring, and bracing to preserve structural integrity and prevent collapse of existing improvements and/or Work modified and/or altered as part of the Work.
- F. CONTRACTOR shall secure building entrances, exits, and Work areas with locking devices as required by the OWNER.
- G. CONTRACTOR assumes custody and control of OWNER property, both fixed and portable, remaining in existing facilities vacated during the Work.
- H. CONTRACTOR shall cover and protect surfaces of rooms and spaces in existing facilities turned over for the Work, including OWNER property remaining within as required to prevent soiling or damage from dust, dirt, water, and/or fumes. CONTRACTOR shall protect areas adjacent to the Work in a similar manner. Prior to OWNER occupancy, CONTRACTOR shall clean all surfaces including OWNER property.
- I. CONTRACTOR shall not use or allow anyone other than OWNER employees to use facility telephones and/or other equipment, except in an emergency. CONTRACTOR shall reimburse OWNER for telephone toll charges originating from the facility except those arising from emergencies or use by OWNER employees.
- J. CONTRACTOR shall protect all surfaces, coverings, materials, and finished Work from damage. Mobile equipment shall be provided with pneumatic tires.
- K. CONTRACTOR is advised OWNER may award Separate Work Contracts at this Project site.
- L. CONTRACTOR shall not permit the use of portable and/or fixed radio's or other types of sound producing devices including walkmans and similar devices.

3.02 PROPERTY INVENTORY

- A. Property, OWNER intends to remove; will be removed by OWNER before a room or space is vacated for the Work. Before performing Work in each room or space, OWNER and CONTRACTOR shall prepare a detailed initial written inventory of OWNER property remaining within, including equipment and telephone instruments and the condition thereof. OWNER and CONTRACTOR shall retain a signed copy of the inventory dated and signed by both parties. Prior to subsequent OWNER

occupancy of each such room or space, OWNER and CONTRACTOR shall perform a final inventory of OWNER property and all discrepancies between the initial inventory and final inventory shall be the responsibility of CONTRACTOR.

3.03 FURNITURE, FIXTURES AND EQUIPMENT (MATERIALS) OWNER FURNISHED CONTRACTOR INSTALLED (OFCI)

- A. Certain materials identified in the Contract Documents as OWNER Furnished CONTRACTOR Installed, OFCI, will be delivered to the Project site by the OWNER.
- B. If designated in the Contract Documents to be OWNER furnished CONTRACTOR installed, (OFCI), CONTRACTOR shall unload, store, uncrate, assemble, install, and connect OWNER supplied materials.
- C. Sixty days before the date the CONTRACTOR needs to have the OFCI materials on site, CONTRACTOR shall notify OWNER of the scheduled date for needed OFCI materials. Upon delivery to Project site, CONTRACTOR shall store OFCI materials inside rooms and/or protected spaces and will be responsible for security of OFCI materials until Substantial Completion. OWNER will sign receipt or bill of lading as applicable.
- D. CONTRACTOR shall, within ten days after delivery, uncrate and/or unpack OFCI materials in presence of OWNER who shall inspect delivered items. OWNER shall prepare an inspection report listing damaged or missing parts and accessories. OWNER shall transmit one copy of the report to CONTRACTOR. OWNER will procure and/or replace missing and or damaged OFCI materials, as indicated in inspection report.
- E. CONTRACTOR shall install OFCI materials in the locations and orientation as indicated in the Contract Documents. CONTRACTOR shall verify exact locations with OAR before final installation of OFCI materials.
- F. If required, ONWER will furnish setting and or placement drawings for OFCI materials.
- G. CONTRACTOR shall install OFCI materials by proper means and methods to ensure an installation as recommended by the manufacturer. CONTRACTOR shall furnish and install all necessary fasteners and required blocking to properly install OFCI materials.
- H. CONTRACTOR shall install OFCI materials with manufacturer recommended fasteners for the type of construction to which the OFCI materials are being fastened and/or anchored.

- I. CONTRACTOR shall provide final connections of any electrical, signal, gas, water, waste, venting and/or similar items to OFCI materials. CONTRACTOR shall, prior to final connection, verify the operating characteristics of OFCI materials are consistent with the designated supply.
- 3.04 FURNITURE, FIXTURES AND EQUIPMENT (Materials) - OWNER furnished, OWNER installed (OFOI)
- A. Certain materials are identified in the Contract Documents as OWNER Furnished, OWNER Installed (OFOI)
 - B. On dates and during times designated by OWNER, CONTRACTOR shall provide clear off-loading, receiving, protected storage, and OWNER'S dumpster space areas for the use of OWNER or OWNER'S third party OFOI installation contractors. At such times, CONTRACTOR shall also make clear routes and access available to all rooms and spaces to receive OFOI materials.
 - C. On dates and during times designated by OWNER, CONTRACTOR shall provide access to the elevators for use of OWNER or OWNER'S third party OFOI installation contractors.
 - D. CONTRACTOR shall cooperate fully with OWNER or OWNER'S third part OFOI installation contractors.
 - E. CONTRACTOR may be requested by OWNER to provide supplemental labor and equipment to support OFOI activities. Such requests must be submitted in accordance with the change order clauses of Contract.
 - F. Immediately prior to mobilization of OWNER or OWNER'S third party OFOI installation contractors, OWNER shall document the condition of the Work in areas to be utilized for OFOI activities.
 - G. CONTRACTOR shall not be responsible for damage caused by OWNER or OWNER'S forces. OWNER shall document the condition of the Work and report to CONTRACTOR any damage in areas utilized for OFOI activities.

END OF SECTION

SECTION 01 3113

PROJECT COORDINATION

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section specifies administrative and procedural requirements necessary for coordinating Work operations including, but not limited to, the following:
 - 1. General coordination procedures.
 - 2. Coordination drawings.

1.02. RELATED REQUIREMENTS

- A. Section 01 3300: Submittal Procedures.
- B. Section 01 7700: Contract Closeout.

PART 2 - PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 COORDINATION

- A. CONTRACTOR shall coordinate operations included in various sections of Contract Documents to assure efficient and orderly installation of each part of Work. Coordinate Work operations included under related sections of Contract Documents that depend on each other for proper installation, connection, and operation of Work, including but not limited to:
 - 1. Schedule construction operations in sequence required where installation of one part of Work depends on installation of other components, before or after its own installation.
 - 2. Coordinate installation of different components to assure maximum accessibility for required maintenance, service, and repair.
 - 3. Provide provisions to accommodate items scheduled for later installation.
 - 4. Prepare and administer provisions for coordination drawings.

- B. Where necessary, prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required in notices, reports, attendance at meetings, and:
 - 1. Prepare similar memoranda for OWNER and Separate Work Contract where coordination of their Work is required.
- C. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities to avoid conflicts and assure orderly progress of Work. Such administrative activities include, but are not limited to, following:
 - 1. Preparation of schedules.
 - 2. Installation, relocation, and removal of temporary facilities.
 - 3. Delivery and processing of submittals.
 - 4. Progress meetings.
 - 5. Project closeout activities.
- D. Conservation: Coordinate Work operations to assure operations are carried out with consideration given to conservation of energy, water, materials, and:
 - 1. Salvage materials and equipment involved in performance of, but not actually incorporated into Work.

3.02 SUBMITTALS

- A. Coordination Drawings: CONTRACTOR shall prepare coordination drawings to coordinate the installation of products and materials fabricated, furnished and installed by separate entities, under different parts of the Contract. CONTRACTOR shall notify OAR and ARCHITECT of all major conflicts in writing in a timely manner so that the design team can respond without construction delays. Coordination drawings shall address the following at a minimum:
 - 1. Limitations in available space for installation or service. CONTRACTOR shall overlay plans of each trade and verify space requirements and conflicts between trades. Minor changes and adjustments that do not affect design intent shall be made by CONTRACTOR and shall be highlighted for ARCHITECT'S review.

2. Incompatibility between items provided under different trades (such as difference in voltage between equipment specified under Divisions 22 and 23 and electrical power provided under Division 26.)
 3. Inconsistencies between drawings, specifications and codes (between trades and within each trade).
 4. Additional items required for existing facilities construction projects shall be designed and prepared from available as-built drawings that are verified through non-invasive and non-destructive, visual observation only. CONTRACTOR shall field verify actual existing conditions during and upon completion of demolition work and incorporate findings into preparation of co-ordination drawings. Minor changes and adjustments that do not affect design intent shall be made by Sub-Contractor and shall be highlighted for OAR and ARCHITECT'S reviews.
- B. Prepare coordination drawings in CAD with each trade on a separate layer, in specified color and scale. CONTRACTOR and each Subcontractor shall provide and forward reproducible copies and CAD drawing files in the order described here:
1. Structural shop drawings shall indicate location and sizes of columns, beams and other structural members, as well as wall, roof and slab penetrations, and will be provided to mechanical, electrical, low voltage and plumbing Sub-contractors for co-ordination. Structural items shall be indicated using black lines.
 2. HVAC Subcontractor will indicate all ductwork, piping and equipment complete with installation and dimensioned service clearances, duct and pipe sizes, fitting types and sizes, top or bottom of duct and pipe elevations, distances of ducts, pipes and equipment from building reference points and hanger and support locations. Minor changes and adjustments that do not affect design intent shall be made by Subcontractor and shall be highlighted for OAR and ARCHITECT'S reviews. Forward drawings to plumbing Subcontractor for further co-ordination. HVAC items shall be indicated using orange lines.
 3. Plumbing Subcontractor will indicate all plumbing lines, and equipment complete with installation and dimensioned service clearances, pipe sizes, fitting types and sizes, top or bottom of pipe elevations, distances of pipes and equipment from building reference points and hanger/support locations Co-ordinate with HVAC Subcontractor. Minor changes and adjustments that do not affect design intent shall be made by Sub-

contractor and shall be highlighted for OAR and ARCHITECT'S reviews. Upon completion drawings shall be forwarded to Fire Sprinkler Subcontractor for further co-ordination. All Plumbing items shall be indicated using blue lines.

4. Fire sprinkler Subcontractor will indicate fire sprinkler piping and equipment complete with installation and dimensioned service clearances, pipe sizes, fitting types and sizes, top or bottom of pipe elevations, distances of pipes and equipment from building reference points and hanger or support locations. Co-ordinate with Plumbing and HVAC Subcontractors. Minor changes and adjustments that do not affect design intent shall be made by sub-contractors and shall be highlighted for OAR and ARCHITECT'S reviews. Upon completion drawings shall be forwarded to Electrical CONTRACTOR for further co-ordination. Fire sprinkler equipment shall be indicated using red lines.
5. Electrical and Low Voltage Subcontractors will indicate service and feeder conduit runs and other electrical equipment complete, including low voltage with installation and dimensioned service clearances, sizes, top or bottom of conduit and rack elevations, distances of conduits and equipment from building reference points and hanger and support locations. Co-ordinate with Fire Sprinkler, Plumbing and HVAC Subcontractors. Minor changes and adjustments that do not affect design intent shall be made by sub-contractors and shall be highlighted for OAR and ARCHITECT'S reviews. Upon completion drawings shall be forwarded to CONTRACTOR for further co-ordination. Electrical work shall be indicated in dark green lines. Low voltage work shall be indicated in light green lines.
6. CONTRACTOR will be responsible for the overall coordination review. As each coordination drawing is completed, CONTRACTOR will meet with OAR to review and resolve all conflicts on coordination drawings.
7. Coordination meetings will be held in Project field office of CONTRACTOR. CONTRACTOR is required to distribute Shop Drawings, cut sheets and submittals to Subcontractors where appropriate. Reviewed coordination drawings will be maintained in Project field office of CONTRACTOR. Meeting minutes shall be developed by CONTRACTOR and submitted to OAR within 5 days.

END OF SECTION

SECTION 01 3300

SUBMITTAL PROCEDURES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Administrative and procedural requirements for submittals required for the Work, including but not limited to; Shop Drawings, Product Data, Samples, material lists, and quality control items.
- B. Throughout the Contract Documents, the minimum acceptable quality of materials, fabrication, and execution have been defined by the name and catalog number of a manufacturer and by reference of recognized industry standards.
- C. To ensure that specified products are furnished and installed in accordance with the design intent, procedures have been established for submittal of design data and for its review by ARCHITECT, OWNER and others.

1.02 RELATED REQUIREMENTS

- A. Section 01 3113: Project Coordination.
- B. Section 01 7329: Cutting and Patching.
- C. Section 01 7700: Contract Closeout.

PART 2 – PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 PROCEDURES

- A. CONTRACTOR is required to review and approve every submittal and shop drawing prior to transmittal and delivery to ARCHITECT. Should CONTRACTOR determine a submittal contains errors, or does not meet the requirements of the contract, CONTRACTOR shall immediately return the submittals and shop drawings to the producer and expedite the corrections prior to transmitting the submittal to ARCHITECT. Submittals shall not be used by CONTRACTOR to request clarifications or submit questions. CONTRACTOR will affix stamp to each submittal certifying CONTRACTOR has performed, at minimum, the following:

1. Verified the submittal is complete in all respects and follows the requirements of the Contract Documents without variance.
 2. Confirmed that no substitutions have been included. If substitutions are included, CONTRACTOR shall eliminate them from the submittal and process them in accordance with Section 00 7000 General Conditions Article 6.14.
 3. Identified any variances from the requirements of the Contract Documents and confirmed that the identified variance meets, but does not exceed the allowable limitations or tolerances as defined in these specifications.
 4. Verified that all submitted materials, dimensions and tolerances are compatible with existing or planned conditions of the Work in order to erect, fabricate, or install the submitted assembly in conformance with the requirements of the Contract Documents.
 5. Coordinated and verified that the dimensions match CONTRACTOR measured field or installation conditions.
 6. Coordinated and verified that the products of separate manufacturers required within any field produced assembly are compatible in all respects for such assembly.
 7. Packaged together all related submittals or shop drawings where such is necessary for a comprehensive ARCHITECT review.
- B. CONTRACTOR shall package each submittal appropriately for transmittal and handling. Transmittal format shall be as required by OWNER. CONTRACTOR shall transmit one PDF format set of each submittal or re-submittal to ARCHITECT, which shall be returned to CONTRACTOR. CONTRACTOR shall provide the OWNER additional copies as specified or as requested by OWNER. ARCHITECT will not accept submittals received from sources other than from CONTRACTOR.
- C. After ARCHITECT'S review, ARCHITECT will transmit submittals to OWNER, CONTRACTOR, INSPECTOR and others as required. Work shall not commence, unless otherwise approved by OWNER, until approved submittals are transmitted to CONTRACTOR.
- D. CONTRACTOR shall clearly identify any deviations from the Contract Documents on each submittal. Any deviation not so noted even though stamped reviewed is not acceptable.

- E. CONTRACTOR shall coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities requiring sequential activity.
- F. Timing of Submittals:
1. In accordance with General Conditions, CONTRACTOR shall submit to ARCHITECT, with copy of transmittal to the OWNER, those Shop Drawings, Product Data, diagrams, materials lists, Samples and other submittals required by the Contract Documents.
 2. The scheduling of submittals shall be sequenced to support the progress of the Work, and shall be:
 - a. Submitted sufficiently in advance of construction, fabrication or installation in order to allow time for transmittal, review, modification, correction, (and resubmission and re-review when required.)
 - b. Phased with adequate time between submittals in order to allow for proper review by the ARCHITECT without negative impact to the Milestones Schedule.
 3. CONTRACTOR shall coordinate submittal of related items and ARCHITECT reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received by ARCHITECT.
 4. CONTRACTOR shall revise, update and submit submittal schedule to ARCHITECT and OWNER on the first of each month, or as required by OWNER.
 5. CONTRACTOR shall allow in the Construction Schedule, at least sixteen days for ARCHITECT review following ARCHITECT receipt of submittal. For mechanical, plumbing, electrical, low voltage, fire sprinklers, door and hardware, and other submittals requiring joint review with OAR, CONTRACTOR shall allow a minimum of eighteen days following ARCHITECT receipt of submittal.
 6. No adjustments to the Contract Time or Milestones will be authorized because of a failure to transmit submittals to ARCHITECT sufficiently in advance of the Work to permit review and processing or where CONTRACTOR fails to provide ARCHITECT submittals on related items.

7. In case of product substitution, Shop Drawing preparation shall not commence until such time as OWNER accepts or rejects the proposed substitution in accordance with the procedures described in the General Conditions.
- G. If required, resubmit submittals in a timely manner. Resubmit as specified for initial submittal but identify as such. Review times for re-submitted items shall be as per the time frames for initial submittal review.
- H. Shop Drawing preparation shall not commence until such time as CONTRACTOR receives Product Data acceptance.
- I. ARCHITECT will stamp each submittal with a uniform, action stamp. ARCHITECT will mark the stamp appropriately to indicate the action taken, as follows:
 1. Final Unrestricted Release: When ARCHITECT marks a submittal “Reviewed” the Work covered by the submittal may proceed provided it complies with requirements of the Contract Documents. Final payment depends on that compliance.
 2. Final-But-Restricted Release: When ARCHITECT, or authorized agent, marks a submittal “Reviewed as Noted,” the Work covered by the submittal may proceed provided it complies with notations or corrections on the submittal and requirements of the Contract Documents. Final payment depends on that compliance.
 3. Returned for Re-submittal: When ARCHITECT, or authorized agent, marks a submittal “Rejected, Revise and Resubmit,” do not proceed with Work covered by the submittal, including purchasing, fabrication, delivery, or other activity. Revise or prepare a new submittal according to the notations; resubmit without delay. Repeat as necessary to obtain different action mark. In case of multiple submittals covering same items of Work, CONTRACTOR is responsible for any time delays, schedule disruptions, out of sequence Work, or additional costs due to multiple submissions of the same submittal item. Do not use, or allow others to use, submittals marked “Rejected, Revise and Resubmit” at the Project site or elsewhere where Work is in progress.
 4. Other Action: Where a submittal is for information or record purposes or special processing or other activity, ARCHITECT, or authorized agent, will return the submittal marked “Action Not Required “.

3.02 SHOP DRAWINGS

- A. Shop Drawings are original drawings prepared by CONTRACTOR, Sub-contractor, supplier, or distributor illustrating some portion of Work by showing fabrication, layout, setting, or erection and shall not be based on reproduced Contract Documents or copied standard information.
- B. Produce Shop Drawings to an accurate scale that is large enough to indicate all pertinent features and methods. Except for templates, patterns, and similar full-size drawings, submit Shop Drawings on sheets at least 8-1/2 by 11 inches but no larger than 24 by 36 inches.
- C. Shop Drawings shall include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings. Include the following information:
 - 1. Dimensions.
 - 2. Identification of products and materials included by sheet and detail number.
 - 3. Compliance with specified standards.
 - 4. Notation of coordination requirements.
 - 5. Notation of dimensions established by field measurement.
- D. Each submittal shall bear the following information:
 - 1. Project name and VCCD Bid Number.
 - 2. Date.
 - 3. Name and address of ARCHITECT.
 - 4. Name and address of CONTRACTOR.
 - 5. Name and address of Subcontractor.
 - 6. Name and address of supplier.
 - 7. Name and address of manufacturer.

8. Name and title of appropriate Specification section.
9. Drawing number and detail references, as appropriate.

3.03 PRODUCT DATA

- A. Collect Product Data into a single submittal for each element of Work or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, wiring diagrams, schedules, illustrations, or performance curves.
 1. Mark each copy to show or delineate pertinent materials, products, models, applicable choices, or options. Where Product Data includes information on several products that are not required, clearly mark copies to indicate the applicable information. Include the following information:
 - a. Manufacturer's printed recommendations.
 - b. Compliance with trade association standards.
 - c. Compliance with recognized testing agency standards.
 - d. Application of testing agency labels and seals.
 - e. Notation of dimensions verified by field measurement.
 - f. Notation of coordination requirements.
 - g. Notation of dimensions and required clearances.
 - h. Indicate performance characteristics and capacities.
 - i. Indicate wiring diagrams and controls.
 2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed by CONTRACTOR.

3.04 SAMPLES

- A. Procedure:

1. Submit Samples of sufficient size, quantity, cured and finished and physically identical to the proposed product or material. Samples include partial or full sections or range of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches denoting color, texture, and/or pattern.
 - a. Mount or display Samples in the manner to facilitate review of qualities indicated. Include the following:
 - 1) Specification section number and reference.
 - 2) Generic description of the Sample.
 - 3) Sampling source.
 - 4) Product name or name of manufacturer.
 - 5) Compliance with recognized standards.
 - 6) Availability and delivery time.
2. Submit Samples for review of size, kind, color, pattern, and texture. Submit Samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.
 - a. Where variations in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show the approximate limits of the variations.
 - b. Refer to other Specification sections for requirements for Samples that illustrate materials, fabrication techniques, assembly details, connections, operation, and similar construction characteristics.
 - c. Refer to other sections for Samples to be returned to CONTRACTOR for incorporation into the Work. Such Samples must be undamaged at time of installation. On the transmittal indicate special requests regarding disposition of Sample submittals.
 - d. Samples not incorporated into the Work, or otherwise not designated as Owner property, remain the property of CONTRACTOR and shall be removed from the Project site prior to Substantial Completion.

3. Color and Pattern: Whenever a choice of color or pattern is available in a specified product, submit accurate color chips and pattern charts to OWNER for review and selection.
 4. Number Required: Submit six, minimum, of each. Two will be returned to CONTRACTOR.
- B. When specified, erect field Samples and mock-ups at the Project site to illustrate products, materials, fabrications, or execution and to establish standards by which completed Work shall be judged.
 - C. Maintain sets of Samples, as returned, at the Project site, for quality comparisons throughout the course of the Work. Sample sets may be used to obtain final acceptance of the Work associated with each set.

3.05 QUALITY CONTROL SUBMITTALS

- A. Submit quality control submittals, including design data, certifications, manufacturer's field reports, and other quality control submittals as required under other sections of the Contract Documents.
- B. When other sections of the Contract Documents require manufacturer's certification of a product, material, or installation complies with specified requirements, submit a notarized certification from the manufacturer certifying compliance with specified requirements.
- C. Certification shall be signed by an officer of the manufacturer or other individual authorized to sign documents on behalf of the represented company.
- D. Requirements for submittal of inspection and test reports are specified in other sections of the Contract Documents.

END OF SECTION

SECTION 01 7329
CUTTING AND PATCHING

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section specifies procedural requirements for cutting and patching.

1.02 RELATED REQUIREMENTS

- A. Section 02 4116 - Demolition.

1.03 SUBMITTALS

- A. The word “cutting” as used in the Contract Documents includes, but is not limited to, cutting, drilling, chopping, and other similar operations and the word “patching” includes, but is not limited to, patching, rebuilding, reinforcing, repairing, refurbishing, restoring, replacing, or other similar operations.
- B. Cutting and Patching Proposal: CONTRACTOR shall submit a proposal describing procedures well in advance of the time cutting and patching will be performed if the Contract Documents requires approval of these procedures before proceeding. Include the following information, as applicable, in the proposal:
1. Describe the extent of cutting and patching required. Denote how it will be performed and indicate why it cannot be avoided.
 2. Describe anticipated results in terms of changes to existing construction. Include changes to structural elements and operating components as well as changes in the building’s appearance or other significant visual elements.
 3. List products to be used and firms or entities that will perform this Work.
 4. Indicate dates when cutting and patching will be performed.
 5. Utilities: List utilities that cutting and patching operations will disturb or affect. List utilities to be relocated and those that will be temporarily out-of-service. Indicate how long service will be disrupted.

6. Where cutting and patching involves adding reinforcement to structural elements, submit details and engineering calculations showing integration of reinforcement with the original structure.
7. Review by ARCHITECT and DSA prior to proceeding with cutting and patching does not waive ARCHITECT right to later require complete removal and replacement of defective Work.

1.04 QUALITY ASSURANCE

- A. Requirements for structural Work: Do not cut and patch structural elements in a manner that would change their load-carrying capacity or load-deflection ratio.
 1. Obtain approval from ARCHITECT and DSA of the cutting and patching proposal before cutting and patching the following structural elements:
 - a. Foundation construction.
 - b. Bearing and retaining walls.
 - c. Structural concrete.
 - d. Structural steel.
 - e. Lintels.
 - f. Timber and primary wood framing.
 - g. Structural decking.
 - h. Stair systems.
 - i. Miscellaneous structural metals.
 - j. Exterior curtain-wall construction.
 - k. Equipment supports.
 - l. Piping, ductwork, vessels, and equipment.
 - m. Structural systems of special construction in Division 13 Sections.
- B. Operational Limitations: Do not cut and patch operating elements or related components in a manner that would result in reducing their capacity to perform as intended. Do not cut and patch operating elements or related components in a manner that would result in increased maintenance or decreased operational life or safety.

1. Obtain review of the cutting and patching proposal before cutting and patching the following operating elements or safety related systems:
 - a. Primary operational systems and equipment.
 - b. Air or smoke barriers.
 - c. Water, moisture, or vapor barriers.
 - d. Membranes and flashings.
 - e. Fire protection systems.
 - f. Noise and vibration control elements and systems.
 - g. Control systems.
 - h. Communication and/or data systems.
 - i. Conveying systems.
 - j. Electrical wiring systems.
 - k. Operating systems of special construction in Division 13 Sections.
- C. Visual Requirements: Do not cut and patch construction exposed on the exterior or in occupied spaces in a manner that would, in the opinion of ARCHITECT, reduce the building's aesthetic qualities. Do not cut and patch construction in a manner that would result in visual evidence of cutting and patching. Remove and replace Work cut and patched in a visually unsatisfactory manner.
 1. If possible, retain the original installer or fabricator to cut and patch the exposed Work listed below. If it is impossible to engage the original installer or fabricator, engage another recognized experienced and specialized firm.
 - a. Firestopping.
 - b. Finished wood flooring.
 - c. HVAC enclosures, cabinets, or covers.

1.05 WARRANTY

- A. Existing Warranties: Replace, patch, and repair material and surfaces cut or damaged by methods and with materials in such a manner as not to void any warranties required or existing.

PART 2 - PRODUCTS (Not applicable)

PART 3 - EXECUTION

3.01 INSPECTION

- A. Examine surfaces to be cut and patched and conditions under which cutting and patching is to be performed before cutting. If unsafe or unsatisfactory conditions are encountered, take corrective action before proceeding.
 - 1. Before proceeding, meet at the Project site with parties involved in cutting and patching, including mechanical and electrical trades. Review areas of potential interference and conflict. Coordinate procedures and resolve potential conflicts before proceeding.

3.02 PREPARATION

- A. Temporary support: Provide adequate temporary support of existing improvements or Work to be cut.
- B. Protection: Protect existing improvements and Work during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of existing improvements or Work that might be exposed during cutting and patching operations.
- C. Avoid interference with use of adjoining areas or interruption of free passage to adjoining areas.
- D. Where the Work requires sandblasting of existing surfaces in order to receive new materials secured by cementitious, adhesive or chemical bond, completely remove existing finishes, stains, oil, grease, bitumen, mastic and adhesives or other substances deleterious to the new bonding or fastening of new Work. Utilize wet sand blasting for interior surfaces and for exterior surfaces where necessary to prevent objectionable production of dust.

3.03 PERFORMANCE

- A. General: Employ skilled workmen to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time and complete without delay. Carefully remove existing Work to be salvaged and/or reinstalled. Protect and store for reuse into the Work. Verify compatibility and suitability of existing substrates before starting the Work.
- B. Cutting: Cut existing construction using methods least likely to damage elements retained or adjoining Work. Where possible, review proposed procedures with the original installer; comply with the original installer's recommendations.

1. In general, where cutting, use hand or small power tools designed for sawing or grinding, not hammering and chopping. Cut holes and slots as small as possible, neatly to size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.
 2. To avoid marring existing finished surfaces, cut or drill from the exposed or finished side into concealed surfaces.
 3. Cut through concrete and masonry using a cutting machine, such as a carborundum saw or a diamond-core drill. Saw cut reinforcing bars and paint ends with bituminous paint except where bonded into new concrete. When cutting concrete paving, cut and remove to nearest existing joint line.
 4. Comply with requirements of applicable Sections of Divisions 31, 32, and 33 where cutting and patching requires excavating, backfill, and recompaction.
 5. Woodwork: Cut and or remove to a panel or joint line.
 6. Sheet Metal: Remove back to joint, lap, or connection. Secure loose or unfastened ends or edges and seal watertight.
 7. Glass: Remove cracked, broken, or damaged glass and clean rebates and stops of setting materials.
 8. Plaster: Cut back to sound plaster on straight lines, and back bevel edges of remaining plaster. Trim existing lath and prepare for new lath.
 9. Gypsum Wallboard: Cut back on straight lines to undamaged surfaces with at least two opposite cut edges centered on supports.
 10. Acoustical ceilings: Remove hanger wires and related appurtenances where ceilings are not scheduled to be installed.
 11. Tile: Cut back to sound tile and backing on joint lines.
 12. Flooring: Completely remove flooring and clean backing of prior adhesive. Carefully remove wood flooring for patching and repairing of existing wood flooring scheduled to remain.
- C. Patching: Patch with durable seams that are as invisible as possible. Comply with required tolerances.
1. Where feasible, inspect and test patched areas to demonstrate integrity of the installation. Verify conditions of existing substrates prior to executing Work.

2. Restore exposed finishes of patched areas and extend finish restoration into retaining adjoining construction in a manner that will eliminate all evidence of patching and refinishing.
3. Concrete: Maintain cut edges in a moist condition for twenty four hours prior to the placement of new concrete. In lieu of this an epoxy adhesive may be provided. Finish placed concrete to match existing unless noted otherwise. Concrete shall have a compressive strength of 3,000 psi where installed to repair and match existing improvements, unless noted otherwise.
4. Metal Fabrications: Items to remain exposed shall have their edges cut and ground smooth and rounded.
5. Sheet Metal: Replace removed or damaged sheet metal items for new Work.
6. Glass: Install matching glass and re-seal exterior window assemblies.
7. Lath and Plaster: Install new lath materials to match existing and fasten to supports at 6-inch centers. Provide a 6-inch lap where new lath to adjoins existing lath. Fasten new lath as required for new Work. Restore paper backings as required. Apply a bonding agent on cut edges of existing plaster. Apply three coat plaster of the type, thickness, finish, texture, and color to match existing.
8. Gypsum Wallboard: Fasten cut edges of wallboard. Install patches with at least two opposite edges centered on supports and secure at 6-inch centers. Tape and finish joints and fastener heads. Patching shall be non-apparent when painted or finished.
9. Acoustical Ceilings: Comply with the requirements for new Work specified in related sections of the Contract Documents.
10. Resilient Flooring: Completely remove flooring and prepare substrate for new material.
11. Painting: Prepare areas to be patched, patch and paint as specified under related sections of the Contract Documents.

3.04 CLEANING

- A. Clean areas and spaces where cutting and patching are performed. Completely remove paint, mortar, oils, putty, and similar items. Thoroughly clean piping, conduit, and similar features before applying paint or other finishing materials. Restore damaged coverings to their original condition.

END OF SECTION

SECTION 01 7419

CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes: Preparation and implementation, including reporting and documentation, of a Waste Management Plan for reusing, recycling, salvage or disposal of non-hazardous waste materials generated during demolition and new construction (Construction and Demolition (C&D) Waste), to foster material recovery and re-use and to minimize disposal in land fills.
- B. Related Requirements
 - 1. Section 01 3300 - Submittal Procedures.
 - 2. Section 01 7700 - Contract Closeout.

1.02 REFERENCES

- A. California Integrated Waste Management Act of 1989 (AB 939).
- B. California Code of Regulations Title 14, Section 18700 et seq.
- C. California Green Building Standards Code.

1.03 SYSTEM DESCRIPTION

- A. Collection and separation of all C&D waste materials generated on-site, reuse or recycling on-site, transportation to approved recyclers or reuse organizations, or transportation to legally designated landfills, for the purpose of recycling salvaging and reusing a minimum of 75 percent of the C&D waste generated.

1.04 SUBMITTALS

- A. C&D Waste Management Plan (Exhibit 1): Within 10 calendar days after the Notice to Proceed and prior to any waste removal, submit the following to the OAR for review and approval. Update quarterly. Include:
 - 1. Materials to be recycled, reused, or salvaged, either onsite or offsite.
 - 2. Estimates of C&D waste quantity (in tons) by type of material. (If waste is measured by volume, give factors for conversion to weight in tons.)
 - 3. Procedures for recycling and reuse program.
 - 4. Permit or license and location of Project waste-disposal areas.
 - 5. Site plan for placement of waste containers.

- B. C&D Waste Management Monthly Progress Report (Exhibit 2): Summary of waste generated by Project, monthly with Application for Payment. Include:
 - 1. Firms accepting the recovered or waste materials.
 - 2. Type and location of accepting facilities (landfill, recovery facility, used materials yard, etcetera). If materials are reused or recycled on the Project site, location should be designated as “on-site reuse and recycling”.
 - 3. Type of materials and net weight (tons) of each.
 - 4. Value of the materials or disposal fee paid.
 - 5. Attach weigh bills and other documentation confirming amount and disposal location of waste materials.
- C. C&D Waste Management Final Compliance Report: Final update of Waste Management Plan to provide summary of total waste generated by Project.

PART 2 – PRODUCTS (Not Used)

PART 3 – EXECUTION

3.01 IMPLEMENTATION

- A. Implement approved Waste Management Plan including collecting, segregating, storing, transporting and documenting each type of waste material generated, recycled or reused, or disposed in landfills.
- B. Designate an on-site person to be responsible for instructing workers and overseeing the sorting and recording of waste/ recyclable materials.
- C. Include waste management and recycling in worker orientation and as an agenda item for regular Project meetings.
- D. Recyclable and waste bin areas shall be limited to areas approved on the Waste Management Plan. Keep recycling and waste bins neat and clearly marked to avoid contamination of materials.

3.02 ATTACHMENTS

- A. Exhibit 1: Waste Management Plan
- B. Exhibit 2: Waste Management Monthly Progress Report.

EXHIBIT 1

WASTE MANAGEMENT PLAN
CONSTRUCTION/ MAINTENANCE/ALTERATION & DEMOLITION PROJECTS

PROJECT NAME:	«PROJECTTITLE» «CONTRACTTITLE»
PROJECT NO:	«Project Number»
NAME OF COMPANY:	
CONTACT PERSON:	
TELEPHONE:	
PROJECT SITE LOCATION:	
PROJECT TYPE:	☐ NEW CONSTRUCTION ☐ DEMOLITION ☐ MAINTENANCE/ALTERATION PROJECTS
PROJECT SIZE (SQ. FT.):	
DATE & ESTIMATED PERIOD	

(1) Material Type	(2) Tons Estimated Recycle	(3) Tons Estimated Reuse	(4) Tons Estimated Salvage	(5) Tons Estimated Landfill	(6) Proposed Disposal or Recycling Facility (e.g., Onsite, Name of Facility)
Total					
Diversion Rate: Columns [(2)+(3)+(4)] / [(2)+(3)+(4)+(5)]					=

Signature	Title	Date
-----------	-------	------

- Column 1 "Material Types" – Enter type of materials targeted for recycling, reuse, and/or salvage, either on- or off-site, and include a category for waste materials requiring disposal.
- Columns 2 thru 4 "Estimated Generation" - Enter estimated quantities (tons) of recyclable, reusable, or salvageable waste materials anticipated to be generated and state number of salvageable items.
- Column 5 "Estimated Landfill" - Enter quantities (tons) of materials to be disposed in landfill.
- Column 4 "Disposal Location" - Enter end-destination of recycled, salvaged, and disposed materials.
- General : (1) Attach proposed Recycling and Waste Bin Location Plan.
 (2) Attach name and contact data for each recycling or disposal destination to be used.

EXHIBIT 2

WASTE MANAGEMENT PROGRESS REPORT
CONSTRUCTION/ MAINTENANCE/ALTERATION & DEMOLITION PROJECTS

PROJECT NAME:	«PROJECTTITLE» «CONTRACTTITLE»
PROJECT NO:	«Project Number»
NAME OF COMPANY:	
CONTACT PERSON:	
TELEPHONE:	
PROJECT SITE LOCATION:	
PROJECT TYPE:	☐ NEW CONSTRUCTION ☐ DEMOLITION ☐ MAINTENANCE/ALTERATION PROJECTS
PROJECT SIZE (SQ. FT.):	
PERIOD	to

(1) Material Type	(2) Tons Actual Recycle	(3) Tons Actual Reuse	(4) Tons Actual Salvage	(5) Tons Actual Landfill	(6) Disposal or Recycling Facility (e.g., Onsite, Name of Facility)
Total					
Diversion Rate: Columns [(2)+(3)+(4)] / [(2)+(3)+(4)+(5)]					=

Signature	Title	Date
-----------	-------	------

- Column 1 "Material Types" – Enter type of materials targeted for recycling, reuse, and/or salvage, either on- or off-site, and include a category for waste materials requiring disposal.
- Columns 2 "Estimated Generation" - Enter estimated quantities (tons) of recyclable, reusable, or salvageable waste
thru 4 materials anticipated to be generated and state number of salvageable items.
- Column 5 "Estimated Landfill" - Enter quantities (tons) of materials disposed.
- Column 4 "Disposal Location" - Enter end-destination of recycled, salvaged, and disposed materials.
- General : (1) Attach proposed Recycling and Waste Bin Location Plan.
 (2) Attach name and contact data for each recycling or disposal destination to be used.

END OF SECTION.

SECTION 01 7700

CONTRACT CLOSEOUT

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section includes administrative and procedural requirements for Contract Closeout, including but not limited to, the following:
 - 1. Inspection procedures.
 - 2. Project record documents submittal.
 - 3. Operation and maintenance manual submittal.
 - 4. OWNER orientation and instruction.
 - 5. Final cleaning.

1.02 RELATED REQUIREMENTS:

- 1. Section 01 3300 - Submittal Procedures.
- 2. Section 01 7836 - Warranties.

PART 2 – PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 SUBSTANTIAL COMPLETION

- A. Inspection Procedures: On receipt of the Request For Certificate of Substantial Completion, OWNER will authorize commencement of inspection. INSPECTOR, OWNER, CONTRACTOR and ARCHITECT will inspect the Work.
 - 1. If after inspection of the Work, OWNER does not consider the Work substantially complete, OWNER will notify CONTRACTOR.

2. If after inspection, OWNER considers the Work substantially complete, INSPECTOR shall prepare a comprehensive Punch List of items to be corrected.
 - a. INSPECTOR may repeat inspection to assure the Work is corrected.
 - b. Results of the completed inspection will form a partial basis of the requirements for Release of Retention.

3.02 ADMINISTRATIVE CLOSEOUT

- A. Re-inspection Procedures: INSPECTOR, OWNER, CONTRACTOR and ARCHITECT may inspect the Work upon notice, including final inspection of Punch List items from earlier inspections, has been corrected, except for items whose completion is delayed under circumstances acceptable to OWNER.
 1. OWNER has the right to preclude CONTRACTOR from Punch List correction and documents submittals after the Contract Completion date; unless OWNER elects to authorize CONTRACTOR to extend Administrative Contract duration. CONTRACTOR will be assessed actual cost for the unsettled items. Withholds amounts exceeding actual costs to correct or to obtain deliverable will be released.
 2. If allowed by the OWNER, re-inspection will be repeated, but may be assessed against CONTRACTOR if OWNER is subject to additional professional service and or additional costs of inspection.

3.03 PROJECT RECORD DOCUMENT SUBMITTAL

- A. General: Do not use project record documents for construction purposes. Protect record documents from deterioration and loss. Provide access to record documents for ARCHITECT, INSPECTOR and OWNER reference during normal working hours. Project record document shall be updated on a weekly basis. Prior to submitting each application for payment, secure INSPECTOR and ARCHITECT approval of project record documents.
- B. Record Drawings: Maintain a clean, undamaged set of prints of Drawings and Shop Drawings. Mark the set to show the actual installation where the installation varies substantially from the Work as originally shown. Mark the Drawing that is most capable of showing conditions fully and accurately. Where Shop Drawings are used, record a cross-reference at the corresponding location on the Drawings. Provide detailed and accurate field dimensions for concealed elements that would be difficult to measure and record at a later date.

1. Mark record sets with red erasable pencil. Use other colors to distinguish between variations in separate categories of the Work. Date and number entries in the same format as submitted. Call attention to entry by a “cloud” around the affected areas.
 2. Mark new information important to OWNER but was not shown on Drawings or Shop Drawings.
 3. Utility location and depth below finished grade and above ceilings and attic spaces shall be fully dimensioned and indicated on record drawings. Dimensions shall be measured from building lines or permanent landmarks and shall be triangulated to those features.
 4. Note related Change Order or Construction Directive numbers where applicable. RFC submissions shall be referenced on each affected sheet, Drawing and Shop Drawing.
 5. Organize record drawing sheets into manageable sets. Bind sets with durable-paper cover sheets; print suitable titles, dates, and other identification on the cover of each set.
 6. Prior to Contract Completion of the Work, review of the project record drawings by ARCHITECT; prepare a final set of project record drawings using reproducible vellum. Submit final set of transparencies to ARCHITECT.
- C. Record Specifications: Maintain two complete copies of the Specifications, including Addenda. Include with the Specifications two copies of other written Contract Documents, such as Change Orders or Construction Directives issued during construction.
1. Mark these record documents to show substantial variations in actual Work performed in comparison with the text of the Specifications and modifications.
 2. Give particular attention to substitutions and selection of options and information on concealed Work that cannot otherwise be readily discerned later by direct observation.
 3. Note related record document information with Product Data.
 4. Prior to Contract Completion of the Work, submit record Specifications to ARCHITECT for OWNER records.

- D. Record Product Data: Maintain two copies of each Product Data submittal. Note related Change Orders and Construction Directives and mark-up of record drawings and Specifications.
1. Mark these documents to illustrate significant variations in actual Work performed in comparison with information submitted. Include variations in products delivered to the Project site and from the manufacturer's installation instructions and recommendations.
 2. Provide detailed and accurate information regarding concealed products and portions of Work that cannot otherwise be readily discerned later by direct observation.
 3. Prior to Contract Completion, submit complete set of record Product Data to ARCHITECT for OWNER records.
- E. Record Samples: Immediately prior to Substantial Completion, CONTRACTOR shall meet with ARCHITECT and OWNER at the Project site to determine which Samples are to be transmitted to OWNER for record purposes. Comply with OAR instructions regarding delivery to OWNER storage area.
- F. Miscellaneous Records: Refer to other Specification sections for requirements of miscellaneous record keeping and submittals in connection with actual performance of the Work. Prior to the date of Contract Completion, complete and compile miscellaneous records and place in good order. Identify miscellaneous records properly and bind or file, ready for continued use and reference. Submit to Architect for OWNER records.
- G. Maintenance Manuals: Prior to Substantial Completion, organize operation and maintenance data into suitable two sets of manageable size. Bind properly indexed data in individual, heavy-duty, two to three-inch 3-ring, vinyl-covered binders, with pocket folders for folded sheet information. Mark appropriate identification on front and spine of each binder. Submit to ARCHITECT for OWNER records. Include the following types of information.
1. Emergency instructions.
 2. Spare parts list.
 3. Copies of warranties.
 4. Wiring diagrams.
 5. Recommended "turn-around" cycles.

6. Inspection procedures.
 7. Shop Drawings and Product Data.
 8. Fixture lamping schedule.
- H. Verified Reports: Construction progress of the Work shall be reported to DSA via a duly verified report as per Title 24, Part 1, Sections 4-336 and 4-343.c of the California Building Standards Commission's, California Administrative Code.

3.04 OPERATION AND MAINTENANCE:

- A. Operation and Maintenance Instructions: Prior to Substantial Completion, arrange for each installer of equipment that requires regular operation and maintenance to meet with designated OWNER personnel to provide instruction in proper operation and maintenance. Provide instruction by manufacturer's representatives if installers are not experienced in operation and maintenance procedures. Include a detailed review of the following items:
1. Maintenance manuals.
 2. Spare parts and materials.
 3. Tools.
 4. Lubricants.
 5. Fuels.
 6. Identification systems.
 7. Control sequences.
 8. Hazards.
 9. Cleaning.
 10. Warranties and bonds.
 11. Maintenance agreements and similar continuing commitments.
- B. As part of instruction for operating equipment, demonstrate the following procedures:
1. Start-up.

2. Shutdown.
3. Emergency operations.
4. Noise and vibration adjustments.
5. Safety procedures.
6. Economy and efficiency adjustments.
7. Effective energy utilization.

3.05 FINAL CLEANING

- A. General: Related sections of the Contract Documents specify general cleaning during performance of the Work. General cleaning is included in Division 01 Section "Construction Facilities and Temporary Controls".
- B. Cleaning: Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit to the condition expected in a normal, commercial building cleaning and maintenance program. Comply with manufacturer's instructions.
 1. Complete the following cleaning operations before requesting inspection for a certificate of Substantial Completion.
 - a. Remove labels that are not permanent labels.
 - b. Clean transparent materials, including mirrors and glass in doors and windows. Remove glazing compounds and other substances that are noticeable vision-obscuring materials. Replace chipped or broken glass and other damaged transparent materials.
 - c. Clean exposed exterior and interior hard-surfaced finished to a dust-free condition, free of stains, films, and similar foreign substances. Restore reflective surfaces to their original condition. Leave concrete floors broom clean. Vacuum carpeted surfaces.
 - d. Wipe surfaces of mechanical and electrical equipment. Remove excess lubrication and other substances. Clean plumbing fixtures to a sanitary condition. Clean light fixtures and lamps.
 - e. Clean the Project site, including landscape development areas, of rubbish, litter, and other foreign substances. Sweep paved areas broom clean; remove stains, spills, and other foreign deposits.

Rake grounds that are neither paved nor planted to a smooth, even-textured surface.

END OF SECTION

SECTION 01 7836

WARRANTIES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section includes administrative and procedural requirements for warranties, including manufacturers and installer's standard warranties on products and special product warranties.
 - 1. Refer to the General Conditions for terms of the guarantee period for the Work.

1.02 RELATED REQUIREMENTS

- A. Section 01 7700 - Contract Closeout.

PART 2 - PRODUCTS (Not applicable)

PART 3 - EXECUTION

3.01 WARRANTY REQUIREMENTS

- A. Disclaimers and Limitations: Manufacturer's disclaimers and limitations on product warranties shall not relieve CONTACTOR of the warranty of the Work incorporating such materials, products, and equipment. Manufacturer's disclaimers and limitations on warranties do not relieve suppliers, manufacturers, installers, and Subcontractors of the requirement to countersign special warranties with CONTRACTOR.
- B. Standard warranties are preprinted written warranties published by individual manufacturers for particular products and are specifically endorsed by the manufacturer to OWNER.
- C. Special warranties are written warranties required by or incorporated in the Contract Documents, either to extend time limits provided by standard warranties or to provide greater rights for OWNER.
- D. Related Damages and Losses: When correcting failed or defective warranted Work, remove and replace Work that has been damaged as a result of such failure

or which must be removed and replaced to provide access for correction of warranted Work.

- E. Reinstatement of Warranty: When Work covered by a warranty has failed and been corrected by replacement or rebuilding, reinstate the warranty by written endorsement with the reinstated warranty equal to the original warranty.
- F. Replacement Cost: Upon determination the Work covered by a warranty has failed and/or is defective, replace or rebuild the Work to an acceptable condition complying with requirements of the Contract Documents. CONTRACTOR is responsible for the cost of replacing or rebuilding defective Work regardless of whether OWNER has benefited from use of the Work through a portion of its anticipated useful service life.
- G. OWNER Recourse: Expressed warranties made to OWNER are in addition to implied warranties and shall not limit the duties, obligations, rights, and remedies otherwise available under the law. Expressed warranty periods shall not be interpreted as limitations on the time in which OWNER can enforce such other duties, obligations, rights, or remedies.
- H. Rejection of Warranties: OWNER reserves the right to reject warranties and to limit selection to products with warranties not in conflict with requirements of the Contract Documents.
- I. Where the Contract Documents require a special warranty, or similar commitment on the Work or part of the Work, OWNER reserves the right to refuse to accept the Work until CONTRACTOR presents evidence the entities required to countersign such commitments have done so.

3.02 SUBMITTALS

- A. Submit written preliminary warranties prior to Substantial Completion and final warranties prior to Contract Completion. If the certificate of Substantial Completion designates a commencement date for warranties other than the date of Substantial Completion for the Work, submit written warranties as set forth in the certificate of Substantial Completion.
 - 1. When a designated portion of the Work is partially used and/or occupied by OWNER, submit properly executed warranties to ARCHITECT within fifteen days of the Partial Use or Occupancy of the designated portion of the Work.
- B. When the Contract Documents require CONTRACTOR, or CONTRACTOR and a Subcontractor, installer, supplier or manufacturer to execute a special warranty, prepare a written document containing appropriate terms and identification, ready

for execution by the required parties. Submit a draft to OWNER, and ARCHITECT, for approval prior to final execution.

1. Refer to Divisions 02 through 49 for specific content requirements and particular requirements for submitting special warranties.
- C. Form of Submittal: Prior to Contract Completion, compile two copies of each required final warranty properly executed by CONTRACTOR, or by CONTRACTOR and Subcontractor, installer, supplier, or manufacturer. Organize the warranty documents into an orderly sequence based on the Specifications.
- D. Bind warranties and bonds in heavy-duty, commercial-quality, durable three ring, vinyl-covered loose-leaf binders, thickness as necessary to accommodate contents, and sized to receive 8½ by 11 paper.
1. Provide heavy paper dividers with celluloid covered tabs for each separate warranty. Mark the tab to identify the item or installation. Provide a typed description of the product or installation, including the name of the product, and the name, address, and telephone number of the installer.
 2. Identify each binder on the front and spine with the typed or printed title “WARRANTIES,” Project title and/or name, and name of CONTRACTOR.
 3. When warranted Work requires operation and maintenance manuals, provide additional copies of each required warranty, as necessary, for inclusion in each required manual.

END OF SECTION

SECTION 02 4116

DEMOLITION

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes: Furnishing labor, materials and equipment necessary for demolition, dismantling, cutting and alterations as indicated, specified, or required for completion of the Work. Includes items such as the following:

1. Protection of existing improvements to remain.
2. Cleaning existing improvements to remain.
3. Disconnecting and capping utilities.
4. Removing debris, waste materials, and equipment.
5. Removal of items for performance of the Work.
6. Salvageable items to be retained by the Owner.

- B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 01 1100 - Summary of Work.
3. Section 01 7329 - Cutting and Patching.
4. Section 01 7419 - Construction and Demolition Waste Management.

1.02 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating the extent of items and systems to be removed. Indicate items to be salvaged or items to be protected during demolition. Indicate locations of utility terminations and the extent of abandoned lines to be removed. Include details indicating methods and location of utility terminations.

1.03 QUALITY ASSURANCE

- A. Perform the Work of this section by workers skilled in the demolition of buildings and structures. Perform the Work of this section under direct superintendence at all times.
- B. Prior to commencement of Work, schedule a walkthrough with the OWNER, to confirm Owner property items have been removed from scheduled Work areas. Identify and mark remaining property items and schedule their removal.

- C. Coordinate demolition for the correct sequence, limits, and methods. Schedule demolition Work to create least possible inconvenience to the public and facility operations.
- D. Related Standards:
 - 1. ANSI/ASSE A10.6.
 - 2. CBC Chapter 33.
 - 3. CFC Chapters 11 and 33.
 - 4. NFPA 241

1.04 PROJECT CONDITIONS

- A. Drawings may not indicate in detail all demolition Work to be performed. Examine existing conditions to determine the full extent of required demolition.
- B. Repair damage to existing improvements or damage due to excessive demolition.
- C. Provide all measures to avoid excessive damage from inadequate or improper means and methods, improper shoring, bracing or support.
- D. If conditions are encountered that varies from those indicated, promptly notify the Architect for clarification before proceeding.

PART 2 - PRODUCTS

2.01 HANDLING OF MATERIALS

- A. Items scheduled for salvage by the OWNER shall be delivered to a location designated by the OWNER. Items shall be cleaned, packaged and labeled for storage.
- B. Items scheduled for reuse shall be stored on the Project site and protected from damage, theft and other deleterious conditions.

PART 3 - EXECUTION

3.01 GENERAL

- A. Protection:
 - 1. Do not commence demolition until safety partitions, barricades, warning signs and other forms of protection are installed.
 - 2. Provide safeguards, including warning signs, lights and barricades, for protection of workers, occupants, and the public.
- B. If safety of existing construction appears to be endangered, take immediate measures to correct such conditions; cease operations and immediately notify the OWNER.

3.02 DEMOLITION

- A. Do not throw or drop materials. Furnish ramps or chutes as required by the Work.
- B. Remove existing construction only to extent necessary for proper installation of Work and interfacing with existing construction. Cut back finished surfaces to straight, plumb or level lines as required for a smooth transition.
- C. Where openings are cut oversize or in improper locations, replace or repair to required condition.

3.03 CUTTING EXISTING CONCRETE

- A. Cutting of existing concrete shall be performed by skilled workers familiar with the requirements and space necessary for placing concrete. Perform concrete cutting with concrete cutting wheels and hand chisels. Do not damage concrete intended to remain.
- B. Extent of cutting of structural concrete shall be as indicated on Drawings. Cutting of non-structural concrete shall be as indicated on Drawings or as reviewed by the Architect or structural engineer. Replace concrete demolished in excess of amounts indicated.
- C. Prior to cutting or coring concrete, determine locations of hidden utilities or other existing improvements and provide necessary measures to protect them from damage.

3.04 REMOVAL OF EXISTING PLUMBING AND ELECTRICAL EQUIPMENT AND SERVICES

- A. Remove existing plumbing and electrical equipment fixtures and services not indicated for reuse and not necessary for completion of the Work. Remove abandoned lines and cap unused portions of existing lines.

3.05 REMOVAL OF OTHER MATERIALS

- A. Masonry: Cut back to joint lines and remove mortar without damaging units to remain. Allow space for repairs to backing where applicable.
- B. Woodwork: Cut or remove to a joint or panel line.
- C. Roofing: Remove as required, including accessory components such as insulation and flashings. At penetrations through existing roofing, trim cut edges back to sound roofing with openings restricted to the minimum size necessary to receive Work.
- D. Sheet Metal: Remove back to joint, lap, or connection. Secure loose and unfastened ends or edges and provide a watertight condition. Re-seal as required.
- E. Glass: Remove broken or damaged glass and clean rebates and stops of glazing channels.
- F. Modular materials such as acoustical ceiling panels, resilient tile, or ceramic tile: Remove to a natural joint without leaving damaged or defective Work where joining

new Work. After flooring removal, clean substrates to remove setting materials and adhesives.

- G. Gypsum Board: Remove to a panel joint line on a stud or support line.
- H. Plaster: Saw cut plaster on straight lines, leaving a minimum 2-inch width of firmly attached metal lath for installing new lath and plaster.
- I. Remove existing improvements not specifically indicated or required but necessary to perform Work. Cut to clean lines, allowing for installation of Work.

3.06 PATCHING

- A. Patch or repair materials to remain when damaged by the performance of the Work of this section. Finish material and appearance of patch and/or repair Work shall match existing.

3.07 CLEANING

- A. Clean existing materials to remain with appropriate tools and equipment.
- B. Protect existing improvements during cleaning operations.
- C. Debris shall be dampened by fog water spray prior to transporting by truck.
- D. Debris pick-up area shall be kept broom-clean and shall be washed daily with clean water.
- E. Remove waste and debris, other than items to be salvaged. Turn over salvaged items to Owner, or store and protect for reuse where required. Continuously clean up and remove items as demolition Work progresses.
- F. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 07 9200

JOINT SEALANTS

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Joint sealants.
2. Preparation for application of sealants.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 06 4000 – Architectural Woodwork.
3. Section 07 6000 - Flashing and Sheet Metal.
4. Section 07 8413 - Penetration Firestopping.
5. Division 08 - Openings.
6. Division 09 - Finishes.
7. Section 10 2813 - Toilet Accessories.

1.02 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating sealant joint locations, with full-size sealant joint details.
- B. Product Data: Submit manufacturer's literature for each sealant material.
- C. Material Samples: Submit Samples indicating color range available for each sealant material intended for installation in exposed locations.
- D. Certifications: Submit manufacturer's certification materials comply with requirements specified.
- E. Site Samples: At locations required, provide a Sample of sealant for each typical installation, approximately 24 inches long, including joint preparation, backing, sealant and tooling. Allow backing to extend 6 inches beyond end of sealant for inspection of substrate.
- F. Test Reports: Submit manufacturer's adhesion compatibility test reports according to ASTM C794 for each substrate.

1.03 QUALITY ASSURANCE

- A. Qualifications of Installer: The Work of this section shall be installed by a firm which has been in the business of installing similar materials for at least five consecutive years; and can show evidence of satisfactory completion of five projects of similar size and scope. Installer shall have applicators trained and approved by manufacturer for performing this Work.

1.04 DELIVERY, STORAGE AND HANDLING

- A. Store in accordance with manufacturer's recommendations. Provide a uniform ambient temperature between 60 and 80 degrees F.

1.05 WARRANTY

- A. Manufacturer: five year material warranty.
- B. Installer: two year installation/application warranty.

PART 2 - PRODUCTS

2.01 GENERAL

- A. Furnish sealants meeting following in-service requirements:
 - 1. Normal curing schedules are permitted.
 - 2. Non-staining, color fastness (resistance to color change), and durability when subjected to intense actinic (ultraviolet) radiation are required.
- B. Furnish the products of only one manufacturer unless otherwise required, sealant colors as selected to match the adjoining surfaces.

2.02 MATERIALS

- A. Sealants:
 - 1. Sealant 1: Acrylic latex, one-part, non-sag, mildew resistant acrylic emulsion compound complying with ASTM C834, Type S, Grade NS, formulated to be paintable.
 - a. Tremco Inc., Acrylic Latex Caulk.
 - b. Pecora Corporation, AC-20.
 - c. Equal.
 - 2. Sealant 2: Butyl sealant, one-part, non-sag, solvent-release-curing sealant complying with ASTM C1311, gun grade and formulated with a minimum of 75 percent solids.
 - a. Tremco Inc., Tremco Butyl Sealant.
 - b. Pecora Corp., BC-158.

- c. Equal.
- 3. Sealant 3: Silicone sealant, one-part non-acid-curing silicone sealant complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Dow Corning Corp., Dow Corning 790, 791, 795.
 - b. General Electric Co., Silpruf.
 - c. Tremco, Inc., Spectrem 1.
 - d. Pecora Corp., 864.
 - e. Equal.
- 4. Sealant 4: One-part mildew-resistant silicone sealant, complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Dow Corning Corp., Dow Corning 786.
 - b. General Electric Co., Sanitary 1700.
 - c. Tremco, Inc., Proglaze White.
 - d. Equal.
- 5. Sealant 5: One-part non-sag urethane sealant, complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Sika Corporation, Sikaflex -221e.
 - b. Equal.
- 6. Sealant 6: Multi-part pouring urethane sealant, complying with ASTM C920, Type M, Grade P, Class 25.
 - a. Sika Corporation, Sikaflex 2C NS/SL.
 - b. Equal.
- 7. Sealant 7: Acoustical sealant, non-drying, non-hardening permanently flexible conforming to ASTM D217.
 - a. Pecora Corp., BA-98 Acoustical Sealant.
 - b. Equal.
- B. See 07 8413 - Penetration Firestopping for rated sealants.
- C. .Joint Backing: ASTM D1056; round, closed cell Polyethylene Foam Rod; oversized 30 to 50 percent larger than joint width, reticulated polyolefin foam.
- D. Primer: Non-Staining Type. Provide primer as required and shall be product of manufacturer of installed sealant.

- E. Bond Breaker: Pressure sensitive tape recommended by sealant manufacturer.
- F. Sealants shall have normal curing schedules, shall be nonstaining, color fast and shall resist deterioration due to ultraviolet radiation.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that joint openings are ready to receive Work and field tolerances are within the guidelines recommended by sealant manufacturer.

3.02 SURFACE PREPARATION

- A. Joints and spaces to be sealed shall be completely cleaned of all dirt, dust, mortar, oil, and other foreign materials which might adversely affect sealing Work. Where necessary, degrease with a solvent or commercial degreasing agent. Surfaces shall be thoroughly dry before application of sealants.
- B. If recommended by manufacturer, remove paint and other protective coatings from surfaces to be sealed before priming and installation of sealants.
- C. Preparation of surfaces to receive sealant shall conform to the sealant manufacturer's specifications. Provide air pressure or other methods to achieve required results. Provide masking tape to keep sealants off surfaces that will be exposed in finished Work.
- D. Etch concrete or masonry surfaces to remove excess alkalinity, unless sealant manufacturer's printed instructions indicate that alkalinity does not interfere with sealant bond and performance. Etch with 5 percent solution of muriatic acid; neutralize with dilute ammonia solution, rinse thoroughly with water and allow to dry before sealant installation.
- E. Perform preparation in accordance with ASTM C804 for solvent release sealants, and ASTM C962 for elastomeric sealants.
- F. Protect elements surrounding Work of this section from damage or disfiguration.

3.03 SEALANT APPLICATION SCHEDULE

	<u>Location</u>	<u>Type</u>	<u>Color</u>
A.	Exterior and Interior joints in horizontal surfaces of concrete; between metal and concrete masonry and mortar.	Sealant 6	To match adjacent material
B.	Exterior door, entrance and window frames. Exterior and interior vertical joints in concrete and masonry metal flashing.	Sealant 3 or 5	To match adjacent material

C.	Joints within glazed curtain wall system. Skylight framing system. Aluminum entrance system glass and glazing.	Sealant 3	Translucent or Black
D.	Interior joints in ceramic tile and at plumbing fixtures.	Sealant 4	Translucent or White
E.	Under thresholds.	Sealant 2	Black
F.	All interior joints not otherwise scheduled	Sealant 1	To Match Adjacent Surfaces
G.	Heads and sills, perimeters of frames and other openings in insulated partitions	Sealant 7	Match Adjacent Surfaces

3.04

APPLICATION

- A. Provide sealant around all openings in exterior walls, and any other locations indicated or required for structure weatherproofing and/or waterproofing.
- B. Sealants shall be installed by experienced mechanics using specified materials and proper tools. Preparatory Work (cleaning, etc.) and installation of sealant shall be as specified and in accordance with manufacturer's printed instructions and recommendations.
- C. Concrete, masonry, and other porous surfaces, and any other surfaces if recommended by manufacturer, shall be primed before installing sealants. Primer shall be installed with a brush that will reach all parts of joints to be filled with sealant.
- D. Sealants shall be stored and installed at temperatures as recommended by manufacturer. Sealants shall not be installed when they become too jelled to be discharged in a continuous flow from gun. Modification of sealants by addition of liquids, solvents, or powders is not permitted.
- E. Sealants shall be installed with guns furnished with proper size nozzles. Sufficient pressure shall be furnished to fill all voids and joints solid. In sealing around openings, include entire perimeter of each opening, unless indicated or specified otherwise. Where gun installation is impracticable, suitable hand tools shall be provided.
- F. Sealed joints shall be neatly pointed on flush surfaces with beading tool, and internal corners with a special tool. Excess material shall be cleanly removed. Sealant, where exposed, shall be free of wrinkles and uniformly smooth. Sealing shall be complete before final coats of paint are installed.
- G. Comply with sealant manufacturer's printed instructions except where more stringent requirements are indicated on Drawings or specified.

- H. Partially fill joints with joint backing material, furnishing only compatible materials, until joint depth does not exceed 1/2 inch joint width. Minimum joint width for metal to metal joints shall be 1/4 inch. Joint depth, shall be not less than 1/4 inch and not greater than 1/2 inch.
- I. Install sealant under sufficient pressure to completely fill voids. Finish exposed joints smooth, flush with surfaces or recessed as indicated. Install non-tracking sealant to concrete expansion joints subject to foot or vehicular traffic.
- J. Where joint depth prevents installation of standard bond breaker backing rod, furnish non-adhering tape covering to prevent bonding of sealant to back of joint. Under no circumstances shall sealant depth exceed 1/2 inch maximum, unless specifically indicated on Drawings.
- K. Prime porous surfaces after cleaning. Pack joints deeper than 3/4 inch with joint backing to within 3/4 inch of surface. Completely fill joints and spaces with gun applied compound, forming a neat, smooth bead.

3.05 MISCELLANEOUS WORK

- A. Sealing shall be provided wherever required to prevent light leakage as well as moisture leakage. Refer to Drawings for condition and related parts of Work.
- B. Install sealants to depths as indicated or, if not indicated, as recommended by sealant manufacturer but within following general limitations:
 - 1. For joints in concrete walks, slab and paving subject to traffic, fill joints to a depth equal to 75 percent of joint width, but not more than 3/4 inch deep or less than 3/8 inch deep, depending on joint width.
 - 2. For building joints, fill joints to a depth equal to 50 percent of joint width, but not more than 1/2 inch deep or less than 1/4 inch deep.

3.06 CLEANING

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

3.07 CURING

- A. Sealants shall cure in accordance with manufacturer's printed recommendations. Do not disturb seal until completely cured.

3.08 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 08 1113
HOLLOW METAL DOORS

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Hollow metal doors as indicated.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 07 9200 - Joint Sealants.
3. Section 08 7100 - Door Hardware.
4. Section 09 9000 - Painting and Coating.

1.02 DESIGN REQUIREMENTS

- A. Door-and-frame assemblies or frames shall include reinforcing and provisions for hardware as shown and specified. Drawings indicate profile and general details of steel frame fabrication and installation.

1.03 SUBMITTALS

- A. Shop Drawings: Submit composite Shop Drawings indicating detailed relationships of installation including Work of adjacent construction, finish hardware, security, fire and life safety devices, glazing, sealing, and requirements for field installation. Include elevations of each hollow metal door type, details of each frame type, location schedule of doors and frames indicating same reference for details and openings as indicated on Drawings, conditions of openings of various wall sections and materials, typical and special details of construction, methods of assembling sections, location and installation requirements for hardware, material size, shape, and thickness, and joints and connections.
- B. Product Data: Submit manufacturer's Product Data indicating composition and construction for each fabricated item including louvers, coatings, finishes, and other components demonstrating compliance with referenced standards.
- C. Certification: Submit certification of compliance with referenced standards and specified criteria, including but not limited to fire ratings in accordance with UL 10C,

Physical Endurance in accordance with ANSI A250.4 and Prime Paint performance in accordance with ANSI A250.10..

D. Samples:

1. Hollow Metal Door: Section of typical interior door of sufficient composite size to illustrate edge, top, bottom, and core construction, hinge reinforcement and face stiffening, closer reinforcement and kick plate reinforcement, and corner of vision opening construction with glazing beads.

1.04 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Minimum documented experience of more than five years in work of this section.
- B. Installer Qualifications: Minimum documented experience of more than five years in work of this section
- C. Coordinate with hardware supplier for fabrication of doors and frames to receive hardware items.
- D. Coordinate with intrusion alarm supplier for fabrication of doors and frames to receive intrusion detection devices.
- E. References: Work shall comply with physical and performance requirements of following standards, including standards referenced in them, except for more stringent provisions specified herein or required by regulatory agencies:
 1. ANSI/SDI A250.8, SDI 100 Recommended Specifications for Standard Steel Doors and Frames.
 2. ANSI/NFPA 252, Fire Tests of Door Assemblies.
 3. ANSI/UL 10B, Fire Tests of Door Assemblies.
 4. ANSI/UL 10C, Positive-Pressure Fire Tests of Door Assemblies.
 5. ANSI/NFPA 80, Fire Doors and Fire Windows
 6. HMMA, Guide Specifications for Commercial Hollow Metal Doors & Frames (Standard of National Association of Architectural Metal Manufacturers).
 7. ANSI/SDI A250.4, Test Procedure and Acceptance Criteria for Physical Endurance for Steel Doors, Frames, Frame Anchors and Hardware Reinforcements.
 8. ANSI A250.10, Test Procedure and Acceptance Criteria for Prime Painted Steel Doors and Frames.

9. ANSI A250.6, Recommended Practice for Hardware Reinforcing on Standard Steel Doors and Frames.

F. Standards of Fabrication and Installation:

1. Finished Work shall be of uniform profile, accurately fabricated, rigid and strong, square and true, neat in appearance, smooth and free from dents, waves, warps, buckles, open joints, tool marks and/or other defects.
2. Steel sheet shall be clean with smooth surfaces free of scale, pitting or other defects.
3. Construction joints shall be flush, tight and welded their full length, ground flush and smooth on exposed surfaces.
4. Frame and door reinforcing and hardware provisions shall be performed in fabrication shop. Provide cuts, welds, and other fabrications before galvanizing or shop priming.
5. Lines and molded members shall be straight and true with angles as sharp as practical for thickness involved, surfaces flat, and fastenings concealed.

1.05 DELIVERY, STORAGE AND HANDLING

- A. Doors: Provide protection as required to protect doors during shipping and storage. Damaged doors will be rejected.
- B. Inspect hollow metal Work upon delivery for damage. Remove and replace damaged items with new Work as required.
- C. Store doors in an upright position at Project Site under cover and protected from weather-related elements. Store units on minimum 4-inch high wood blocking with ½ inch air spaces between stacked doors to provide circulation. Do not store doors under plastic or canvas shelters that can create a humidity chamber. If shipping packaging becomes wet, immediately remove packaging.

1.06 WARRANTY

- A. Manufacturer shall provide a five year material warranty.
- B. Installer shall provide a two year fabrication and installation warranty.

PART 2 - PRODUCTS

2.01 MANUFACTURERS

- A. Doors shall be products of a single manufacturer.

- B. The following are acceptable manufacturers, as are others that can demonstrate their products are equivalent in quality, performance and compliance with these specifications.
1. Security Metal Products Corp.
 2. Curries Manufacturing, Inc.
 3. Steelcraft.
 4. Amweld Metal Doors and Frames.
 5. Stiles Custom Metal, Inc.
 6. Door Components Inc.
 7. CECO Door.
 8. Equal.
- C. Materials, fabrication and installation must comply with requirements of standards referenced in Section 1.04, Quality Assurance.

2.02 MATERIALS

- A. Steel:
1. Exterior Doors and Frames: Galvanized Carbon Sheet Steel, Commercial Quality, A60 zinc coating (0.30 ounces per square foot per side), ASTM A653.
 2. Steel shall be free of scale, pitting, coil breaks or other surface blemishes, and free of buckles, waves or other defects.
 3. Steel thicknesses expressed in steel gages (MSG) is for reference only. Actual steel thicknesses must meet minimum requirements of ASTM standards and as described in ANSI/SDI A250.8.
- B. Supports and Anchors: Fabricate from a minimum 16 gauge galvanized sheet steel unless noted otherwise.
- C. Fasteners: Provide as shown on Drawings and to suit conditions of secure installations. Furnish 304 Grade stainless steel types at exterior doors.
- D. Shop Paint:
1. Conform to Steel Structures Painting Council (SSPC) for steel components.

2. Pretreatment/priming coatings shall be compatible with Project site finish painting system in accordance with Section 09 9000.

2.03 FABRICATION GENERAL

- A. General: Fabricate hollow metal units to be rigid, neat in appearance, and free from defects including warp or buckle.
 1. Accurately form metal to required sizes and profiles. Fit and assemble units in manufacturer's plant. Where practical, factory or shop fit and assemble units for shipment.
 2. Weld joints continuously; grind, dress, and make smooth, flush, and invisible. Filler to conceal manufacturing defects or damage is not permitted.
 3. Corner Joints: Finish corner joints by mitering, or coping and butting, or a combination of both. Trim and backbend shall be continuous around corner.

2.04 DOORS

- A. General: Custom-made, flush-panel "seamless type" with one-piece face panels; continuous weld, seamless edge construction with no visible seams or joints on faces or on vertical edges. Note that doors are scheduled to be installed in existing hollow metal door frames. In some cases, the swing is reversed. Care shall be taken to confirm required custom door sizes.
 1. Door thickness: 1 3/4 inches.
 2. Face Sheet Minimum Gage: 16 gage.
 3. Stiffeners: Stiffen door face sheets with continuous vertical-formed steel (rib) sections or back to back hat sections, minimum 20 gage, full thickness of interior space between door faces, spaced 6" on center maximum, and spot welded to both faces 4" on center maximum.
 4. Acoustical Insulation: Provide sound deadening and insulating material through entire core of door (full height, width, and thickness of door).
 - a. Doors shall have a minimum STC of 28 as tested under ASTM E90 and ASTM E413, unless noted otherwise..
 5. Thermal Insulation: Exterior doors shall be insulated to R values scheduled or indicated on drawings.
 6. Labeled Doors: Where fire-rated openings and conditions are indicated.

- a. Labeled doors shall be provided with fire-resistance rating indicated and shall be constructed as tested and approved by Underwriters' Laboratories (UL) for installation in labeled frame and door assemblies.
 - b. Gaskets: Gaskets are supplied under Section 08 7100 - Door Hardware. Gaskets and installation shall conform to requirements of CBC 716.5.3.1 and NFPA 105, "Installation of Smoke and Draft Control Door Assemblies."
 - c. Fabricate labeled doors with same finished appearance as specified for non-labeled hollow metal doors; with welded door edges, filled and ground smooth; with label affixed to door.
 - d. Where fire labels are required and continuous hinge is specified, install label on top of door within 6" of hinge side of door.
7. Door Edges: Join door face sheets at vertical edges of door with continuous weld full height of door. Grind, fill, and dress welds smooth to provide invisible seam with smooth, flush surface.
- a. Close ends of doors with continuous recessed channels, 16 gage steel minimum, spot welded to both face sheets. Close top and bottom edges of doors with a internal steel channel, screw attached into top and bottom of door. Channel shall be galvanized at exterior doors. No screws are allowed on visible faces of door. Provide openings in bottom closure of exterior doors to permit escape of entrapped moisture.
 - b. Profile of Door Edges:
 - 1) Single-acting swing doors: Bevel both vertical edges 1/8" in 2".
 - 2) Pairs of single-acting swing doors: Bevel hinge edge 1/8" in 2". Provide surface mounted astragals for labeled or unlabeled doors unless otherwise shown on Drawings or required.

B. Hardware Reinforcement and Accessories:

- 1. Provide sheet steel or plate reinforcement for finish hardware items wherever necessary. Mortise, drill and tap to template requirements for mortise type hardware.
- 2. Butt reinforcing: 7 gage minimum, of length 4" longer than length of butt. Minimum 3 spot welds at top and bottom.

3. Door closer reinforcement: 14 gage minimum steel channel, 6" high on each side of door.,. Reinforcement to extend full width of door in accordance with Detail #1 of this section.
4. Other Hardware Requirements: Cut, reinforce, drill, and tap doors and frames for other hardware, including energy management switches or contacts and security devices, in accordance with furnished hardware templates for accessory items. Thickness and size of reinforcement shall be as required by ANSI A250.6.

2.05 SHOP PRIMING

- A. Exposed and concealed metal surfaces of hollow metal doors, frames and other hollow metal Work of this Section shall be bonderized and then shop primed.
- B. Exposed surfaces of doors, frames and accessories shall be filled, sanded smooth and cleaned before painting.
- C. Exposed surfaces shall be shop primed after assembly.

PART 3 - EXECUTION

3.01 FRAME INSTALLATION

- A. Frames are existing. Prepare existing frames as required for new scheduled hardware and handing.

3.02 DOOR INSTALLATION

- A. Install steel doors in accordance with manufacturer's instructions and as indicated on Drawings and in Finish Hardware Specifications. Coordinate with Work of other trades.
- B. Ensure that door and jamb clearances comply with requirements of ANSI/NFPA 80. When wood doors are being installed in metal frames constructed pursuant to this section, allowable door and jamb clearances shall be as specified in Specification Section 08 1416.
- C. Adjust operable parts for correct function.
- D. Remove hardware, except primer-coated items, tag, box and install after finish painting has been completed.

3.03 PRIME COAT TOUCH-UP

- A. Immediately after installation, remove rust, repair damaged surfaces to new condition, sand smooth, and install touch-up primer.

111001

3.04 CLEAN UP

- A. Remove rubbish, debris and waste materials and legally dispose of off Project site.


3.05 PROTECTION

- A. Protect Work of this section until Substantial Completion.

END OF SECTION

DETAIL # 1 - DOOR REINFORCEMENT

ELEVATION

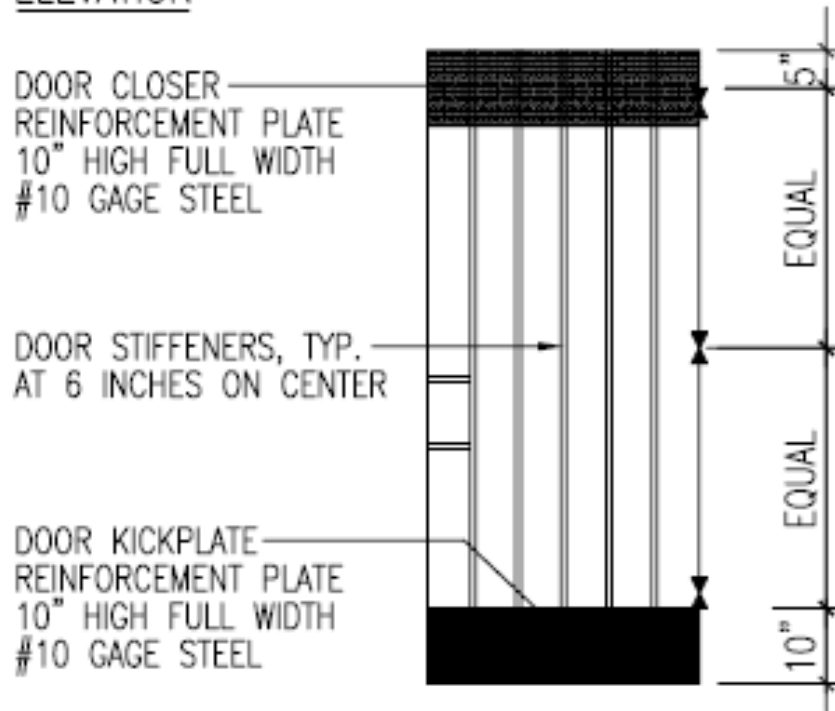

MPC Door Replacement (SS) Student Services Bldg.

Door Numbers	HwSet#
101	01
102	01
103	01
104	01
105	01
106	01
107A	02
108	01
108C	01
111A	02
111B	02
112	03
116	04
117	01
118	01
119	01

SECTION 08 71 00
DOOR HARDWARE

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Door hardware, including electric hardware.
2. Storefront and entrance door hardware.
3. Cylinders for doors fabricated with locking hardware.

B. Related Divisions:

1. Division 07 – Section “Joint Sealants” for sealant requirements applicable to threshold installation specified in this section
2. Division 08 – metal doors and frames.
3. Division 09 – sections for touchup finishing or refinishing of existing openings modified by this section

C. Specific Omissions: Hardware for the following is specified or indicated elsewhere.

1. Windows.
2. Cabinets, including open wall shelving and locks.
3. Signs.
4. Toilet accessories, including grab bars.
5. Installation.
6. Rough hardware.
7. Access doors and panels.

1.2 REFERENCES:

A. Use date of standard in effect as of Bid date.

1. American National Standards Institute
 - a) ANSI/BHMA A156.1 - A156.29, and ANSI/BHMA A156.31 - Standards for Hardware and Specialties.
 - b)
2. BHMA – Builders Hardware Manufacturers Association
3. 2022 California Building Code
 - a) Chapter 11B – Accessibility To Public Buildings, Public Accommodations, Commercial Buildings and Public Housing
4. DHI – Door and Hardware Institute
5. UL – Underwriters Laboratories
 - a) UL 305 – Panic Hardware
6. WHI – Warnock Hersey Incorporated State of California Building Code
7. Local applicable codes
8. SDI – Steel Door Institute
9. NAAMM – National Association of Architectural Metal Manufacturers

B. Abbreviations

1. Manufacturers: see table at 2.1.A of this section
2. Finishes: see 2.7 of this section.

1.3 SUBMITTALS & SUBSTITUTIONS

- A. **SUBMITTALS:** Submit electronic copy of schedule. Organize vertically formatted schedule into “Hardware Sets” with index of doors and headings, indicating complete designations of every item required for each door or opening. Minimum 10pt font size. Include following information:
1. Type, style, function, size, quantity and finish of hardware items.
 2. Use BHMA Finish codes per ANSI A156.18.
 3. Name, part number and manufacturer of each item.
 4. Fastenings and other pertinent information.
 5. Location of hardware set coordinated with floor plans and door schedule.
 6. Explanation of abbreviations, symbols, and codes contained in schedule.
 7. Mounting locations for hardware.
 8. Door and frame sizes, materials and degrees of swing.
 9. List of manufacturers used and their nearest representative with address and phone number.
 10. Catalog cuts.
 11. Date of jobsite visit.
- B. Bid and submit manufacturer’s updated/improved item if scheduled item is discontinued.
- C. **Deviations:** Highlight, encircle or otherwise identify deviations from “Schedule of Finish Hardware” on submittal with notations clearly designating those portions as deviating from this section.
- D. If discrepancy between drawings and scheduled material in this section, bid the more expensive of the two choices, note the discrepancy in the submittal and request direction from Architect for resolution.
- E. Substitutions per Division 1. Include product data and indicate benefit to the Project. Furnish operating samples on request.
- F. Items listed with no substitute manufacturers have been requested by Owner to meet existing standard.
- G. Furnish as-built/as-installed schedule with closeout documents, including keying schedule, riser and point-to-point wiring diagrams, manufacturers’ installation, adjustment and maintenance information, and supplier’s final inspection report.

1.4 QUALITY ASSURANCE:

- A. **Qualifications:**
1. Hardware supplier: direct factory contract supplier who employs a hardware consultant, available at reasonable times during course of work for project hardware consultation to Owner, Architect and Contractor.
 - a) Responsible for detailing, scheduling and ordering of finish hardware. Detailing implies that the submitted schedule of hardware is correct and complete for the intended function and performance of the openings.
- B. **Hardware:** Free of defects, blemishes and excessive play. Obtain each kind of hardware (latch and locksets, exit devices, hinges and closers) from one manufacturer.

- C. Exit Doors: Operable from inside with single motion without the use of a key or special knowledge or effort.
- D. Furnish hardware items required to complete the work in accordance with specified performance level and design intent, complying with manufacturers' instructions and code requirements.

1.5 DELIVERY, STORAGE AND HANDLING:

- A. Delivery: coordinate delivery to appropriate locations (shop or field).
 - 1. Permanent keys and cores: secured delivery direct to Owner's representative.
- B. Acceptance at Site: Items individually packaged in manufacturers' original containers, complete with proper fasteners and related pieces. Clearly mark packages to indicate contents, locations in hardware schedule and door numbers.
- C. Storage: Provide securely locked storage area for hardware, protect from moisture, sunlight, paint, chemicals, dust, excessive heat and cold, etc.

1.6 PROJECT CONDITIONS AND COORDINATION:

- A. Where exact types of hardware specified are not adaptable to finished shape or size of members requiring hardware, provide suitable types having as nearly as practical the same operation and quality as type specified, subject to Architect's approval.
- B. Coordination: Coordinate hardware with other work. Furnish hardware items of proper design for use on doors and frames of the thickness, profile, swing, security and similar requirements indicated, as necessary for proper installation and function, regardless of omissions or conflicts in the information on the Contract Documents. Furnish related trades with the following information:
 - 1. Location of embedded and attached items to concrete.
 - 2. Location of wall-mounted hardware, including wall stops.
 - 3. Location of finish floor materials and floor-mounted hardware.
 - 4. At masonry construction, coordinate with the anchoring and hollow metal supplier prior to frame installation by placing a strip of insulation, wood, or foam, on the back of the hollow metal frame behind the rabbet section for continuous hinges, as well as at rim panic hardware strike locations, silencers, coordinators, and door closer arm locations. When the frame is grouted in place, the backing will allow drilling and tapping without dulling or breaking the installer's bits.
 - 5. Locations for conduit and raceways as needed for electrical, electronic and electro-pneumatic hardware items. Fire/life-safety system interfacing. Point-to-point wiring diagrams plus riser diagrams to related trades.
 - 6. Coordinate: flush top rails of doors at outswinging exteriors, and throughout where adhesive-mounted seals occur.
 - 7. Manufacturers' templates to door and frame fabricators.
- C. Check Shop Drawings for doors and entrances to confirm that adequate provisions will be made for proper hardware installation.
- D. Environmental considerations: segregate unused recyclable paper and paper product packaging, uninstalled metals, and plastics, and have these sent to a recycling center.

- E. Prior to submittal, carefully inspect existing conditions to verify finish hardware required to complete Work, including sizes, quantities, existing hardware scheduled for re-use, and sill condition material. If conflict between the specified/scheduled hardware and existing conditions, submit request for direction from Architect. Include date of jobsite visit in the submittal.
- F. Submittals prepared without thorough jobsite visit by qualified hardware expert will be rejected as non-compliant.

1.7 WARRANTY:

- A. Part of respective manufacturers' regular terms of sale. Provide manufacturers' written warranties.
- B. Include factory order numbers with close-out documents to validate warranty information, required for Owner in making future warranty claims:
- C. Minimum warranties:

1. Extra Heavy-Duty Cylindrical Lock:	Seven Years
2. Exit Devices:	Three years mechanical
3. Closers:	Thirty years mechanical
4. Hinges:	One year
5. Continuous Hinges	Lifetime, One year for electrified
6. Other Hardware	Two years

1.8 COMMISSIONING:

- A. Conduct these tests prior to request for certificate of substantial completion:
 - 1. With installer present, test door hardware operation with climate control system and stairwell pressurization system both at rest and while in full operation.

1.9 REGULATORY REQUIREMENTS:

- A. Locate latching hardware between 34 inches to 44 inches above the finished floor, per-2022 California Building Code, Section 11B-404.2.7.
 - 1. Panic hardware: locate between 36 inches to 44 inches above the finished floor.
- B. Handles, pull, latches, locks, other operable parts:
 - 1. Readily openable from egress side with one hand and without tight grasping, tight pinching, or twisting of the wrist to operate. 2022 California Building Code Section 11B-309.4.
 - 2. Force required to activate the operable parts: 5.0 pounds maximum, per 2022 California Building Code Section 11B-309.4.
- C. Adjust doors to open with not more than 5.0-pounds pressure to open at exterior doors and 5.0-pounds at interior doors. As allowed per 2022 California Building Code Section 11B-404.2.9, local authority may increase the allowable pressure for fire doors to achieve positive latching, but not to exceed 15-pounds.

1. Exception: exterior doors' pressure-to-open may be increased to 8.5-pounds if: at a single location, and one of a bank of eight leafs or fraction of eight, and one leaf of this bank is fitted with a low- or high-energy operator.
- D. Adjust door closer sweep periods so that from an open position of 90 degrees, the door will take at least 5 seconds to move to a point 12 degrees from the latch, measured to the landing side of the door, per 2022 California Building Code Section 11B-404.2.8.
1. Spring hinges: adjust for 1.5 seconds minimum for 70 degrees to fully-closed.
- E. Smooth surfaces at bottom 10 inches of push sides of doors, facilitating push-open with wheelchair footrests, per 2022 California Building Code Section 11B-404.2.10.
1. Applied kickplates and armor plates: bevel the left and right edges; free of sharp or abrasive edges.
 2. Tempered glass doors without stiles: bottom rail may be less than 10 inches if top leading edge is tapered 60 degrees minimum.
- F. Door opening clear width no less than 32 inches, measured from face of frame stop, or edge of inactive leaf of pair of doors, to door face with door opened to 90 degrees. Hardware projection not a factor in clear width if located above 30 inches and below 80 inches, and the hardware projects no more than 4 inches. 2022 California Building Code Section 11B-404.2.3.
1. Exception: In alterations, a projection of 5/8 inch (15.9 mm) maximum into the required clear width shall be permitted for the latch side stop.
 2. Door closers and overhead stops: not less than 78 inches above the finished floor or ground, per 2022 California Building Code 11B-307.4.
- G. Thresholds: floor or landing no more than 0.50 inches below the top of the threshold of the doorway, per 2022 California Building Code Section 11B-404.2.5. Vertical rise no more than 0.25 inches, change in level between 0.25 inches and 0.50 inches: beveled to slope no greater than 1:2 (50 percent slope). 2022 California Building Code Section 11B-303.2 & ~.3.
- H. Floor stops: Do not locate in path of travel. Locate no more than 4 inches from walls, per DSA Policy #99-08 (Access).
- I. Pairs of doors with independently-activated hardware both leafs: limit swing of right-hand or right-hand-reverse leaf to 90 degrees to protect persons reading wall-mounted tactile signage, per 2022 California Building Code Section 11B-703.4.2.

PART 2 PRODUCTS

2.1 MANUFACTURERS:

- A. Listed acceptable alternate manufacturers: these will be considered; submit for review products with equivalent function and features of scheduled products.

ITEM:	MANUFACTURER:	ACCEPTABLE ALTERNATE:
Hinges	(IVE) Ives	Bommer
Key System	(CYB) CyberKey	Owner standard
Mechanical Locks	(SCH) Schlage	Owner standard
Exit Devices	(VON) Von Duprin	Owner standard
Closers	(LCN) LCN	Owner standard
Auto Flush Bolts	(IVE) Ives	DCI
Coordinators	(IVE) Ives	DCI
Kickplates	(IVE) Ives	Rockwood, Trimco
Stops & Holders	(IVE) Ives	Rockwood, Trimco
Thresholds	(ZER) Zero	NGP, Pemko
Seals & Bottoms	(ZER) Zero	NGP, Pemko

2.2 HINGING METHODS:

- A. Drawings typically depict doors at 90 degrees, doors will actually swing to maximum allowable. Use wide-throw conventional or continuous hinges as needed up to 8 inches in width to allow door to stand parallel to wall for true 180-degree opening. Advise architect if 8-inch width is insufficient.
- B. Conform to manufacturer's published hinge selection standard for door dimensions, weight and frequency, and to hinge selection as scheduled. Where manufacturer's standard exceeds the scheduled product, furnish the heavier of the two choices, notify Architect of deviation from scheduled hardware.
- C. Conventional Hinges: Steel or stainless-steel pins and approved bearings. Hinge open widths minimum, but of sufficient throw to permit maximum door swing.
1. Out-swinging exterior doors: non-ferrous with non-removable (NRP) pins and security studs.
 2. Non-ferrous material exteriors and at doors subject to corrosive atmospheric conditions.
- D. Continuous Hinges:
1. Geared-type aluminum.

- a) Use wide-throw units where needed for maximum degree of swing, advise architect if commonly available hinges are insufficient.
- b) If units are used at storefront openings, color-coordinate hinge finish with storefront color. Custom anodizing and custom powder coat finishes subject to Architect approval.

2.3 LOCKSETS, LATCHSETS, DEADBOLTS:

A. Extra Heavy Duty Cylindrical Locks and Latches: as scheduled.

- 1. Chassis: cylindrical design, corrosion-resistant plated cold-rolled steel, through-bolted.
- 2. Locking Spindle: stainless steel, integrated spring and spindle design.
- 3. Latch Retractors: forged steel. Balance of inner parts: corrosion-resistant plated steel, or stainless steel.
- 4. Latchbolt: solid steel.
- 5. Backset: 2.75 inches typically, more or less as needed to accommodate frame, door or other hardware.
- 6. Lever Trim: accessible design, independent operation, spring-cage supported, minimum 2.00 inches clearance from lever mid-point to door face.
- 7. Strikes: 16 gage curved steel, bronze or brass with 1.00 inch deep box construction, lips of sufficient length to clear trim and protect clothing.
- 8. Lock Series and Design: Schlage ND series, "Rhodes" design.
- 9. Certifications:
 - a) ANSI A156.2, Series 4000, Grade 1.
 - b) UL listed for A label and lesser class single doors up to 4 feet x 8 feet.
- 10. Accessibility: Require not more than 5 lb to retract the latchbolt or deadbolt, or both, per CBC 2022 11B-404.2.7 and 11B-309.4
- 11. Accepted substitutions: None.

2.4 EXIT DEVICES / PANIC HARDWARE

A. General features:

- 1. Independent lab-tested 1,000,000 cycles.
- 2. Push-through push-pad design. No exposed push-pad fasteners, no exposed cavities when operated. Return stroke fluid dampeners and rubber bottoming dampeners, plus anti-rattle devices.
- 3. Deadlocking latchbolts, 0.75 inch projection.
- 4. End caps: impact-resistant, flush-mounted. No raised edges or lips to catch carts or other equipment.
- 5. No exposed screws to show through glass doors.
- 6. Non-handed basic device design with center case interchangeable with all functions, no extra parts required to effect change of function.
- 7. Releasable in normal operation with 15-pound maximum operating force per UBC Standard 10-4, and with 32-pound maximum pressure under 250-pound load to the door.
- 8. Accessibility: Require not more than 5 lb to retract the latchbolt, per CBC 2022 11B-404.2.7 and 11B-309.4.

- a) Mechanical method: Von Duprin “AX-“ feature, where touchpad directly retracts the latchbolt with 5 lb or less of force. Provide testing lab certification confirming that the mechanical device is independent third-party tested to meet this 5 lb requirement.

B. Specific features:

- 1. Non-Fire Rated Devices: cylinder dogging with security indicator.
- 2. Lever Trim: breakaway type, forged brass or bronze escutcheon min. 0.130 inch thickness, compression spring drive, match lockset lever design.
- 3. Fire-Labeled Devices: UL label indicating “Fire Exit Hardware”. Vertical rod devices less bottom rod (LBR) unless otherwise scheduled.
- 4. Removable Mullions: Removable with single turn of building key. Securely reinstalled without need for key. Furnish storage brackets for securely stowing the mullion away from the door when removed.
- 5. Accepted substitutions: None.

2.5 CLOSERS

A. Surface Closers: 4040XP

- 1. Full rack-and-pinion type cylinder with removable non-ferrous cover and cast-iron body. Double heat-treated pinion shaft, single piece forged piston, chrome-silicon steel spring.
- 2. ISO 2000 certified. Units stamped with date-of-manufacture code.
- 3. Independent lab-tested 10,000,000 cycles.
- 4. Non-sized, non-handed, and adjustable. Place closer inside building, stairs, and rooms.
- 5. Plates, brackets and special templating when needed for interface with particular header, door and wall conditions and neighboring hardware.
- 6. Adjust doors to open with not more than 5.0-pounds pressure to open at exterior doors and 5.0-pounds at interior doors. As allowed per 2022 California Building Code Section 11B-404.2.9, local authority may increase the allowable pressure for fire doors to achieve positive latching, but not to exceed 15-pounds.
 - a) Exception: exterior doors’ pressure-to-open may be increased to 8.5-pounds if: at a single location, and one of a bank of eight leafs or fraction of eight, and one leaf of this bank is fitted with a low- or high-energy operator.
- 7. Separate adjusting valves for closing speed, latching speed and backcheck, fourth valve for delayed action where scheduled.
- 8. Extra-duty arms (EDA) at exterior doors scheduled with parallel arm units.
- 9. Exterior door closers: tested to 100 hours of ASTM B117 salt spray test, furnish data on request.
- 10. Exterior doors: seasonal adjustments not required for temperatures from 120 degrees F to -30 degrees F, furnish checking fluid data on request.
- 11. Non-flaming fluid, will not fuel door or floor covering fires.
- 12. Pressure Relief Valves (PRV) not permitted.
- 13. Accepted substitutions: None.

2.6 OTHER HARDWARE

A. Automatic Flush Bolts: Low operating force design.

- B. Overhead Stops: Non-plastic mechanisms and finished metal end caps. Field-changeable hold-open, friction and stop-only functions.
- C. Kick Plates: Four beveled edges, .050 inches minimum thickness, height and width as scheduled. Sheet-metal screws of bronze or stainless steel to match other hardware.
- D. Door Stops: Provide stops to protect walls, casework or other hardware.
 - 1. Unless otherwise noted in Hardware Sets, provide floor type with appropriate fasteners. Where floor type cannot be used, provide wall type. If neither can be used, provide overhead type.
 - 2. Locate overhead stops for maximum possible opening. Consult with Owner for furniture locations. Minimum: 90deg stop / 95deg deadstop. Note degree of opening in submittal.
- E. Seals: Four-fingered type at head & jambs. Inelastic, rigid back, not subject to stretching. Self-compensating for warp, thermal bow, door settling, and out-of-plumb. Adhesive warranted for life of installation.
 - 1. Proposed substitutions: submit for approval.
 - 2. Three-fingered type at hinge jambs of doors fitted with continuous hinges where jamb leaf of hinge is fastened to the frame reveal.
- F. Automatic door bottoms: low operating force units. Doors with automatic door bottoms plus head and jamb seals cannot require more than two pounds operating force to open when closer is disconnected.
 - 1. Include automatic type door bottoms, as opposed to fixed sweeps, at stairs and elevator lobbies to allow fine-tuning of pressurization systems.
- G. Thresholds: As scheduled and per details. Comply with CBC 2022 11B-404.2.5. Substitute products: certify that the products equal or exceed specified material's thickness. Proposed substitutions: submit for approval.
 - 1. Saddle thresholds: 0.125 inches minimum thickness.
 - 2. Exteriors: Seal perimeter to exclude water and vermin. Use sealant complying with requirements in Division 7 "Thermal and Moisture Protection". Minimum 0.25 inch diameter fasteners and lead expansion shield anchors, or Red-Head #SFS-1420 (or approved equivalent) Flat Head Sleeve Anchors. National Guard Products' "COMBO" or Pemko Manufacturing's "FHSL".
 - 3. Fire-rated openings, 90-minutes or less duration: use thresholds to interrupt floor covering material under the door where that material has a critical radiant flux value less than 0.22 watts per square centimeter, per NFPA 253. Use threshold unit as scheduled. If none scheduled, include a 0.25in high 5in wide saddle in the bid, and request direction from Architect.
 - 4. Fire-rated openings, 3-hour duration: Thresholds, where scheduled, to extend full jamb depth.
 - 5. Acoustic openings: Set units in full bed of Division-7-compliant, leave no air space between threshold and substrate.
 - 6. Plastic plugs with wood or sheet metal screws are not an acceptable substitute for specified fastening methods.
 - 7. Fasteners: Generally, exposed screws to be Phillips or Robertson drive. Pinned TORX drive at high security areas. Flat head sleeve anchors (FHSL) may be slotted drive. Sheet metal and wood screws: full-thread. Sleeve nuts: full length to prevent door compression.

- H. Through-bolts: Do not use. Coordinate with wood doors; ensure provision of proper blocking to support wood screws for mounting panic hardware and door closers. Coordinate with metal doors and frames; ensure provision of proper reinforcement to support machine screws for mounting panic hardware and door closers.
 - 1. Exception: surface-mounted overhead stops, holders, and friction stays.

2.7 FINISH:

- A. Generally: BHMA 613/643E Dark Bronze.
- B. Door closers: factory powder coated to match other hardware, unless otherwise noted.

2.8 KEYING REQUIREMENTS:

- A. Key System: existing Cyberkey/Videx system. Initiate and conduct meeting(s) with Owner to determine system structure, furnish Owner's written approval of the system; do not order keys or cylinders without written confirmation of actual requirements from the Owner. Furnish temporary construction-keyed and permanent cylinders. Contractor to demonstrate to the Owner that temporary keys no longer operate the locking cylinders at the end of the project.

PART 3 - EXECUTION

3.1 ACCEPTABLE INSTALLERS:

- A. Can read and understand manufacturers' templates, suppliers' hardware schedule and printed installation instructions. Can readily distinguish drywall screws from manufacturers' furnished fasteners. Available to meet with manufacturers' representatives and related trades to discuss installation of hardware.

3.2 PREPARATION:

- A. Ensure that walls and frames are square and plumb before hardware installation. Make corrections before commencing hardware installation. Installation denotes acceptance of wall/frame condition.
- A. Locate hardware per SDI-100 and applicable building, fire, life-safety, accessibility, and security codes.
 - 1. Notify Architect of code conflicts before ordering material.
 - 1. Locate latching hardware between 34 inches to 44 inches above the finished floor, per California Building Code, Section 1008.1.9.2 and 11B-404.2.7.
 - 2. Locate panic hardware between 36 inches to 44 inches above the finished floor.
 - 3. Where new hardware is to be installed near existing doors/hardware scheduled to remain, match locations of existing hardware.
 - 4. Where new hardware is to be installed near existing doors/hardware scheduled to remain, match locations of existing hardware.
- B. Overhead stops: before installing, determine proposed locations of furniture items, fixtures, and other items to be protected by the overhead stop's action.
- A. Existing frames and doors to be retrofitted with new hardware:

5. Field-verify conditions and dimensions prior to ordering hardware. Fill existing hardware cut outs not being reused by the new hardware. Remove existing hardware not being reused, return to Owner unless directed otherwise.
 6. Remove existing floor closers not scheduled for reuse, fill cavities with non-shrinking concrete and finish smooth.
 7. Cut and weld existing steel frames currently prepared with 2.25 inch height strikes. Cut an approximate 8 inch section from the strike jamb and weld in a reinforced section to accommodate specified hardware's strike.
 8. Patch and weld flush filler pieces into existing door hardware preparations in steel doors and frames, leave surfaces smooth.
- B. Glue in solid wood block fillers to fill cut outs in existing wood doors, sand surfaces smooth. Alternatively, use an approved epoxy-based wood filler product, submit product data for approval

3.3 INSTALLATION

- A. Install hardware per manufacturer's instructions and recommendations. Do not install surface-mounted items until finishes have been completed on substrate. Set units level, plumb and true to line and location. Adjust and reinforce attachment substrate for proper installation and operation. Remove and reinstall or replace work deemed defective by Architect.
1. Gaskets: install jamb-applied gaskets before closers, overhead stops, rim strikes, etc; fasten hardware over and through these seals. Install sweeps across bottoms of doors before astragals, cope sweeps around bottom pivots, trim astragals to tops of sweeps.
 2. When hardware is to be attached to existing metal surface and insufficient reinforcement exists, use RivNuts, NutSerts or similar anchoring device for screws
 3. Use manufacturers' fasteners furnished with hardware items, or submit Request for Substitution with Architect.
 4. Replace fasteners damaged by power-driven tools.
- B. Locate floor stops no more than 4 inches from walls and not within paths of travel. See paragraph 2.2 regarding hinge widths, door should be well clear of point of wall reveal. Point of door contact no closer to the hinge edge than half the door width. Where situation is questionable or difficult, contact Architect for direction.
- C. Locate overhead stops for minimum 90 degrees at rest and for maximum allowable degree of swing.
- D. Drill pilot holes for fasteners in wood doors and/or frames.
- E. Lubricate and adjust existing hardware scheduled to remain. Carefully remove and give to Owner items not scheduled for reuse.
- F. Field-verify existing conditions and measurements prior to ordering hardware. Fill existing hardware cut outs not being used by the new hardware.
- G. Remove existing hardware not being reused. Tag and bag removed hardware, turn over to Owner.
- H. Where existing wall conditions will not allow door to swing using the scheduled hinges, provide wide-throw hinges and if needed, extended arms on closers.
- I. Provide manufacturer's recommended brackets to accommodate the mounting of closers on doors with flush transoms.

3.4. ADJUSTING

- A. Adjust and check for proper operation and function. Replace units, which cannot be adjusted to operate freely and smoothly.
 - 1. Hardware damaged by improper installation or adjustment methods: repair or replace to Owner's satisfaction.
 - 2. Adjust doors to fully latch with no more than 1 pound of pressure.
 - a) Door closer valves: turn valves clockwise until at bottom – do not force. Turn valves back out one and one-half turns and begin adjustment process from that point. Do not force valves beyond three full turns counterclockwise.
 - 3. Adjust door closers per 1.9 this section.
- B. Final inspection: Installer to provide letter to Owner that upon completion installer has visited the Project and has accomplished the following:
 - 1. Has re-adjusted hardware.
 - 2. Has evaluated maintenance procedures and recommend changes or additions and instructed Owner's personnel.
 - 3. Has identified items that have deteriorated or failed.
 - 4. Has submitted written report identifying problems.

3.5 DEMONSTRATION:

- A. Demonstrate mechanical hardware, including adjustment and maintenance procedures.

3.6 PROTECTION/CLEANING:

- A. Cover installed hardware, protect from paint, cleaning agents, weathering, carts/barrows, etc. Remove covering materials and clean hardware just prior to substantial completion.
- B. Clean adjacent wall, frame and door surfaces soiled from installation / reinstallation process.

3.7 SCHEDULE OF FINISH HARDWARE

- A. See door schedule in drawings for hardware set assignments.
- B. Do not order material until submittal has been reviewed, stamped, and signed by Architect's door hardware consultant.
- C. The hardware sets represent the design intent and direction of the owner and architect. They are a guideline only and should not be considered a detailed hardware schedule. Discrepancies, conflicting hardware and missing items should be brought to the attention of the architect with corrections made prior to the bidding process. Omitted items not included in a hardware set should be scheduled with the appropriate additional hardware required for proper application and functionality.

Opt. #: OPT0457501-V2

HARDWARE GROUP NO. 01

Provide each SGL door(s) with the following:

1	EA	CONT. HINGE	157XY		313AN	IVE
3	EA	FILLER PLATE	JAMB HINGE FILLER PLATES AS REQUIRED			DON
1	EA	ENTRANCE/OFFICE LOCK W/ INSIDE INDICATOR	ND50TD RHO IS-LOC		643e	SCH
1	EA	PERMANENT CORE	VIDEX FSIC CORE AS REQUIRED		613	CYB
1	EA	LOCK GUARD	LG12		600	IVE
1	EA	SURFACE CLOSER	4040XP EDA		695	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS		613	IVE
1	EA	FLOOR STOP	FS18L/FS18S AS REQ'D		BLK	IVE
1	SET	GASKETING	429D-S		D	ZER
1	EA	DOOR SWEEP	8192D		D	ZER
1	EA	THRESHOLD	103A-223 (OR AS REQ'D. OR PER DETAILS/CONDITIONS)		A	ZER

HARDWARE GROUP NO. 02

Provide each SGL door(s) with the following:

1	EA	CONT. HINGE	157XY		313AN	IVE
3	EA	FILLER PLATE	JAMB HINGE FILLER PLATES AS REQUIRED			DON
1	EA	PANIC HARDWARE	CDSI-PA-AX-98-NL		643E	VON
1	EA	MORTISE CYL TURN	09-900 114 XB11-720 36-083		643e	SCH
1	EA	RIM CYLINDER	20-057 ICX		643e	SCH
1	EA	PERMANENT CORE	VIDEX FSIC CORE AS REQUIRED		613	CYB
1	EA	SURFACE CLOSER	4040XP EDA		695	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS		613	IVE
1	EA	FLOOR STOP	FS18L/FS18S AS REQ'D		BLK	IVE
1	SET	GASKETING	429D-S		D	ZER
1	EA	DOOR SWEEP	8192D		D	ZER
1	EA	THRESHOLD	103A-223 (OR AS REQ'D. OR PER DETAILS/CONDITIONS)		A	ZER

HARDWARE GROUP NO. 03

Provide each PR door(s) with the following:

2	EA	CONT. HINGE	157XY		313AN	IVE
6	EA	FILLER PLATE	JAMB HINGE FILLER PLATES AS REQUIRED			DON
1	EA	CONST LATCHING BOLT	FB51P/FB61P AS REQ'D		613	IVE
1	EA	DUST PROOF STRIKE	DP1		613	IVE
1	EA	ENTRANCE/OFFICE LOCK W/ INSIDE INDICATOR	ND50TD RHO IS-LOC		643e	SCH
1	EA	PERMANENT CORE	VIDEX FSIC CORE AS REQUIRED		613	CYB
1	EA	COORDINATOR	COR X FL		315AN	IVE
2	EA	MOUNTING BRACKET	MB1/MB2 AS REQ'D		BLK	IVE
2	EA	SURFACE CLOSER	4040XP EDA		695	LCN
2	EA	KICK PLATE	8400 10" X 1" LDW B-CS		613	IVE
2	EA	FLOOR STOP	FS18L/FS18S AS REQ'D		BLK	IVE
1	EA	HEAD SEAL	188SBK PSA (@ HEAD)		BK	ZER
2	EA	GASKETING	429D (@ JAMBS)		D	ZER
1	EA	ASTRAGAL	43SP		SP	ZER
2	EA	DOOR SWEEP	8192D		D	ZER
1	EA	THRESHOLD	103A-223 (OR AS REQ'D. OR PER DETAILS/CONDITIONS)		A	ZER

HARDWARE GROUP NO. 04

Provide each SGL door(s) with the following:

1	EA	CONT. HINGE	157XY		313AN	IVE
3	EA	FILLER PLATE	JAMB HINGE FILLER PLATES AS REQUIRED			DON
1	EA	STOREROOM LOCK	ND80TD RHO		643e	SCH
1	EA	PERMANENT CORE	VIDEX FSIC CORE AS REQUIRED		613	CYB
1	EA	LOCK GUARD	LG12		600	IVE
1	EA	SURFACE CLOSER	4040XP SHCUSH		695	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS		613	IVE
1	SET	GASKETING	429D-S		D	ZER
1	EA	DOOR SWEEP	8192D		D	ZER
1	EA	THRESHOLD	103A-223 (OR AS REQ'D. OR PER DETAILS/CONDITIONS)		A	ZER

END OF SECTION

SECTION 09 9000
PAINTING AND COATING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Interior and exterior painting.

B. Following items shall not be painted:

1. Brass valves, chromium or nickel-plated piping and fittings.
2. Boiler control panels and control systems.
3. Fabric connections to fans.
4. Flexible conduit connections to equipment, miscellaneous name plates, stamping, and instruction labels and manufacturer's data.
5. Mechanical and electrical utility lines, piping and heating and ventilation ductwork in tunnels, under-floor excavated areas or crawl spaces, attic spaces and enclosed utility spaces.
6. Flag, floodlight, parking light poles and loudspeaker poles, metal stairs, handrails and chain-link fence with a galvanized finish, unless otherwise noted.
7. Structural and miscellaneous steel, open web steel joists and metal floor decking, which will not be exposed in final construction, shall have no finish other than one coat of shop primer.
8. Hardboard covering on tops and backs of counters and benches.
9. Brass, bronze, aluminum, lead, stainless steel and chrome or nickel-plated surfaces.
10. Non-metallic walking surfaces unless specifically shown or specified to be painted.

1.02 REGULATORY REQUIREMENTS

- A. Paint materials shall comply with the Food and Drug Administration's (F.D.A.) Lead Law and the current rules and regulations of local, state and federal agencies governing the use of paint materials.

1.03 SUBMITTALS

- A. List of Materials: Before submittal of samples, submit a complete list of proposed paint materials, identifying each material by distributor's name, manufacturer's name, product name and number, including primers, thinners, and coloring agents, together with manufacturers' catalog data fully describing each material as to contents, recommended installation, and preparation methods. Identify surfaces to receive various paint materials.
- B. Material Samples: Submit manufacturer's standard colors samples for each type of paint specified. Once colors have been selected, submit Samples of each color selected for each type of paint accordingly:
 - 1. Samples of Paint and Enamel must be submitted on standard 8 ½" x 11" Leneta Opacity-Display Charts. Each display chart shall have the color in full coverage. The sample shall be prepared from the material to be installed on the Work. Identify the school on which the paint is to be installed, the batch number, the color number, the type of material, and the name of the manufacturer.
 - 2. Elastomeric shall be submitted in duplicate samples of the texture coating. Samples will be not less than 2 ½ by 3 ½ in size and installed upon backing. Finished Work will match the reviewed Sample in texture.
 - 3. Materials and color samples shall be reviewed before starting any painting.
- C. For transparent and stained finishes, prepare samples on same species and quality of wood to be installed in the Work, with written description of system used.

1.04 QUALITY ASSURANCE

- A. Certification of Materials: With every delivery of paint materials, the manufacturer shall provide written certification the materials comply with the requirements of this section.
- B. Coats: The number of coats specified is the minimum number. If full coverage is not obtained with the specified number of coats, install additional coats as required to provide the required finish.
- C. Install coats and undercoats for finishes in strict accordance with the recommendations of the paint manufacturer as reviewed by the Architect.
- D. Paint materials shall comply with the following as a minimum requirement:
 - 1. Materials shall be delivered to Project site in original unbroken containers bearing manufacturer's name, brand number and batch number.
 - 2. Open and mix ingredients on premises in presence of the Project Inspector.

1.05 DELIVERY, STORAGE AND HANDLING

- A. Storage and Mixing of Materials: Store materials and mix only in spaces suitable for such purposes. Maintain spaces clean and provide necessary precautions to prevent fire. Store paint containers so the manufacturer's labels are clearly displayed.

1.06 SITE CONDITIONS

- A. Temperature: Do not install exterior paint in damp, rainy weather or until surface has thoroughly dried from effects of such weather. Do not install paint, interior, or exterior, when temperature is below 50 degrees F, or above 90 degrees F, or dust conditions are unfavorable for installation.

1.07 WARRANTY

- A. Manufacturer shall provide a three year material warranty.
- B. Installer shall provide a three year application warranty.

1.08 MAINTENANCE

- A. Provide at least one gallon of each type, color and sheen of paint coating installed. Label containers with color designation indicated on Drawings.

PART 2 - PRODUCTS

2.01 PAINT MATERIALS

- A. Furnish the products of only one paint manufacturer unless otherwise specified or required. Primers, intermediate and finish coats of each painting system must all be the products of the same manufacturer, including thinners and coloring agents, except for materials furnished with shop prime coat by other trades.
- B. Factory mix paint materials to correct color, gloss, and consistency for installation to the maximum extent feasible.
- C. Paint materials to be minimum "Architectural Grade".
- D. Gloss degree standards shall be as follows:

HIGH GLOSS	70 and above	EGGSHELL	30 to 47
SEMI-GLOSS	48 to 69	SATIN	15 to 29

2.02 MANUFACTURERS

- A. Acceptable manufacturers, unless otherwise noted:
 1. Dunn-Edwards Corporation Paints
 2. Frazee Paints and Wall coverings
 3. Vista Paints
 4. Sherwin Williams
 5. ICI Paints

- 6. Equal.
- B. Exterior steel:
 - 1. Carboline
 - 2. Equal.

PART 3 - EXECUTION

3.01 PREPARATION

- A. Examine surfaces to receive paint finish. Surfaces which are not properly prepared and cleaned or which are not in condition to receive the finish specified shall be corrected before prime coat is installed.
- B. New woodwork shall be thoroughly cleaned, hand sandpapered, and dusted off. Nail holes, cracks or defects in Work shall be filled. On stained woodwork, fill shall be colored to match stain. Filling shall be performed after the first coat of paint, shellac or varnish has been installed.
- C. Plaster surfaces except veneer plaster shall be allowed to dry at least 3 weeks before painting. Veneer plaster shall be allowed to dry sufficiently to receive paint as determined by moisture meter tests.
- D. Metal surfaces to be painted shall be thoroughly cleaned of rust, corrosion, oil, foreign materials, blisters, and loose paint.
- E. Do not install painting materials to wet, damp, dusty, dirty, finger marked, rough, unfinished or defective surfaces.
- F. Concrete surfaces shall be dry, cleaned of dirt and foreign materials and in proper condition to receive paint. Neutralize spots demonstrating effects of alkali.
- G. Mask off areas where necessary.

3.02 APPLICATION

- A. Backpainting: Immediately upon delivery to the Project site, finish lumber and millwork shall be backpainted on surfaces that will be concealed after installation. Items to be painted shall be backpainted with priming coat specified under "Priming".
- B. Priming: New wood and metal surfaces specified to receive paint finish shall be primed. Surfaces of miscellaneous metal and steel not embedded in concrete, and surfaces of unprimed plain sheet metal Work shall be primed immediately upon delivery to the Project site. Galvanized metal Work and interior and exterior woodwork shall be primed immediately after installation. Priming of surfaces and priming coat shall be as follows:
 - 1. Knots, Pitch and Sap Pockets: Shellac before priming.

2. Exterior Woodwork and Wood Doors: Prime with one coat of exterior waterborne emulsion wood primer.
 3. Interior Woodwork: Where indicated to be painted, prime with one coat of waterborne wood primer.
 4. Stain: Woodwork indicated to receive a stain and varnish finish shall be stained to an even color with water borne stain. On open-grained hardwood, mix stain with paste filler and completely fill pores in wood.
 5. Galvanized Metal Work: Remove all soluble and insoluble contaminants and corrosion. Remove any storage stains per Section 6.2 of ASTM D6386. Chemically treat with Krud Kutter ME or Great Lakes Laboratories Clean & Etch or Equal, in accordance with manufacturer's written instructions. Ensure that all surfaces have been effectively and uniformly treated per the manufacturer's recommendation. Follow manufacturer's instructions for drying time, and then prime with one coat of Cycloaliphatic Amine Epoxy.
 6. Unprimed Iron, Steel, and Other Uncoated Metals: Where specified to be painted, prime with one coat of metal primer.
 7. Shop Primed Metal Items: Touch up bare and abraded areas with metal primer before installation of second and third coats.
 8. Coats shall be installed evenly and with full coverage. Finished surfaces shall be free of sags, runs and other imperfections.
- C. Allow at least 24 hours between coats of paint.
- D. Rollers shall not be used on wood surfaces.
- E. Each coat of painted woodwork and metal, except last coat, shall be sandpapered smooth when dry. Texture-coated gypsum board shall be sanded lightly to remove surface imperfections after first coat of paint has been installed.
- F. Each coat of paint or enamel shall be a slightly different tint as required. Each coat of paint, enamel, stain, shellac, and varnish will be inspected by the IOR before next coat is applied. Notify the Project Inspector that such Work is ready for inspection.
1. Tinting Guideline: The first coat, primer/undercoat(s) to be untinted or tinted up to 50 percent lighter or darker (at the discretion of the installer) than the finish coat. The second coat (or third coat if a seal coat and undercoat have been specified) is to be factory tinted in the range of 10 percent to 15 percent lighter or darker (at the discretion of the installer) than the finish coat. The final coat is to be factory tinted to the required color selected. These tinting guidelines shall be provided on all surfaces receiving paint.
- G. Do not "paint-out" UL labels, fusible links and identification stamps.
- H. Paint Roller, brush and spray.

1. Only Paint rollers shall be used on interior plaster, drywall, masonry/plaster and plywood surfaces, nap shall not exceed one half inch in length.
 2. First coat on wood overhang and ceilings shall have material applied by roller and then brushed out in a professional manner to leave surface free of imperfections. Finish coat may be sprayed.
 3. Other surfaces shall have all coatings applied with brushes of proper size.
 4. Spray work is permitted only on radiators, acoustic plaster, masonry and plaster.
- I. Where ceilings are specified to be painted, beams, cornices, coves, ornamental features, plaster grilles, etc. shall be included.
 - J. Ceilings shall be white, including classrooms, storage rooms, offices, arcades, etc. Boiler room and fan room ceiling color shall match adjacent walls.

3.03 CLEANING

- A. Remove rubbish, waste, and surplus material and clean woodwork, hardware, floors, and other adjacent Work.
- B. Remove paint, varnish and brush marks from glazing material and, upon completion of painting Work, wash and polish glazing material both sides. Glazing material, which is damaged, shall be removed and replaced with new material.
- C. Clean hardware and other unpainted metal surfaces with recommended cleaner. Do not furnish abrasives or edged tools.

3.04 SCHEDULE

- A. Interior:
 1. Woodwork, Painted: 3 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Interior enamel, semi-gloss or gloss as indicated.
 2. Woodwork, Stained and Varnished: 4 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second, Third and Fourth Coats: Varnish, semi-gloss.
 3. Wood Corridor doors: 4 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second, Third, and Fourth Coats: Varnish, gloss.

4. Other Wood Doors: 4 coats.
 - a. Varnished or painted as indicated.
 - b. If varnished, same finish system as painted woodwork, with semi-gloss or gloss finish to match adjacent wall.
5. Miscellaneous Woodwork: 4 coats. Wood items including, but not limited to: stair treads and risers, handrails, rolling ladders, wood base and shoe, chair rails, counter tops and locker room benches.
 - a. First Coat: As specified in this section under Priming.
 - b. Second, Third and Fourth: Exterior varnish, gloss.
6. Casework: Interior surfaces of casework (except plastic laminate-faced casework) including top, edges and underside of shelving, poles, surfaces of drawers (except fronts), interior surfaces of mailbox pigeonholes, and particle board.
 - a. First Coat: Waterborne stain.
 - b. Second and Third Coats: Satin varnish.
7. Plaster: 4 coats.
 - a. First Coats: Pigmented wall sealer.
 - b. Second coat: Enamel under coater.
 - c. Third and Fourth Coats – Interior enamel, semi-gloss or gloss as indicated.
8. Gypsum Board: 4 coats.
 - a. First Coat: Drywall sealer.
 - b. Second Coat: Enamel under coater.
 - c. Third and Fourth Coats: Interior enamel, semi-gloss or gloss as indicated.
9. Concrete: 3 coats.
 - a. First: Concrete sealer.
 - b. Second and Third: Interior enamel, semi-gloss or gloss as indicated.
10. Concrete Block: 3 coats.
 - a. First: Concrete block filler.

- b. Second and Third: Interior enamel, semi-gloss or gloss as indicated.
- 11. Metal: Shall be cleaned, pre-treated and painted with 3 coats. Items to be painted include, but are not limited to: exposed structural and miscellaneous steel, railings and handrails, metal doors and frames, ladders, table and bench legs.
 - a. First Coat: Cycloaliphatic Amine Epoxy.
 - b. Second and Third Coats: Aliphatic Acrylic-Polyester Polyurethane.

B. Exterior:

- 1. Woodwork: 3 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Exterior house and trim enamel.
- 2. Wood Doors: 3 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Exterior gloss enamel.
- 3. Plaster and Stucco: 3 coats. Flat 100 percent acrylic.
 - a. Prime Coat: Alkali resistant primer/sealer.
 - b. Exterior 100 percent acrylic.
- 4. Concrete: 3 coats. Flat 100 percent acrylic.
 - a. First Coat: Concrete sealer.
 - b. Second and Third Coats: Exterior 100 percent acrylic.
- 5. Metal: 3 coats. Shall be cleaned and pre-treated. Items to be painted include, but are not limited to: steel columns and miscellaneous steel items, railings and handrails gravel stops, metal doors and frames, hoods and flashings.
 - a. First Coat: Cycloaliphatic Amine Epoxy.
 - b. Second and Third Coats: Aliphatic Acrylic-Polyester Polyurethane.

C. Mechanical and Electrical Work:

- 1. Except where interior mechanical and electrical Work to be painted is specified to receive another paint finish, Work occurring in finished rooms and spaces shall be cleaned, pre-treated, and painted with 3 coats. Items to be painted include, but are not limited to: steel and copper piping, pipes, vents, fittings, ducts, plenums, miscellaneous supports and hangers, electrical conduit, fittings,

pull boxes, outlet boxes, unfinished surfaces of plumbing fixtures, miscellaneous metal cabinets, panels, and access doors and panels.

- a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Interior enamel, semi-gloss or gloss to match adjacent wall or ceiling finish.
2. Insulation and Taping on Pipes and Ducts: 3 coats.
- a. Finished Rooms:
 - 1) First Coat: Interior waterborne primer.
 - 2) Second and Third Coats: Interior semi-gloss or gloss enamel to match adjoining wall or ceiling finish.
 - b. Building Exterior:
 - 1) First Coat: Exterior waterborne primer.
 - 2) Second and Third Coats: Exterior gloss enamel.
3. Inside surfaces of ducts, vents, dampers and louvers as far back as visible from room in which they open shall be painted with 2 coats of flat black paint.

D. Miscellaneous:

- 1. Outside Storage Units (wood or metal): 3 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Exterior gloss enamel.
- 2. Exterior and interior surfaces of storage bins, and potting tables shall have 3 coats of acrylic stain.
- 3. Wood compost bins shall be finished with 3 coats of acrylic stain.

3.05 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.06 CLEANUP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 31 20 00

EARTHWORK

PART 1 – GENERAL

1.01 SUMMARY

- A. Section includes: Excavation, Compaction and Fill.

1.02 REFERENCE

- A. Standard Specifications for Public Works Construction (SSPWC), latest edition.

1.03 QUALITY ASSURANCE

- A. Codes and Standards: Perform earthwork in compliance with applicable requirements of governing authorities having jurisdiction.

1. Standard Specifications for Public Works Construction (SSPWC), latest edition.
2. CAL/OSHA Construction Safety Order Requirements.

- B. Soil Testing Service

1. The District will engage a soil testing service to include testing soil materials proposed for use in the Work and for quality control testing during grading operations.
2. Samples of materials shall be furnished to the testing service by the Contractor at least one week before their anticipated use.
3. Work for this Section includes smoothing out areas for density tests and otherwise facilitate testing work, as directed.
4. Shoring Systems: Pre-engineered systems, clearly labeled as such, may be used.

1.04 PROJECT CONDITIONS

- A. The Contractor shall visit the site and familiarize himself with existing site conditions.
- B. Additional test borings and other exploratory operations may be made by the Contractor at no cost or liability to the District.
- C. Existing Utilities:

1. Where uncharted or incorrectly charted piping or other utilities are encountered during excavation, consult District 's Representative immediately for directions. Cooperate with the District's Representative in keeping respective services and facilities in operation. Repair damaged utilities to the satisfaction of the District's Representative at no cost to the District. Disturbed trench sections shall be replaced in kind.
- D. Protection of Subgrade: Do not allow equipment to pump, rut, or disturb subgrade, stripped areas, or other areas prepared for Project.
- E. Contractor shall implement measures to prevent soil erosion, and where possible, sediment shall be retained onsite.

PART 2 – PRODUCTS (Not Applicable)

PART 3 – EXECUTION

3.01 SITE PREPARATION

A. General:

1. Remove vegetation, improvements, or obstructions interfering with installation of new construction. Transport and legally dispose of off site. Removal includes stumps and roots. Contractor shall utilize the best construction method to minimize the erosive effect from the removal of site vegetation.
2. Carefully and cleanly cut roots and branches of trees indicated to be left standing, where such roots and branches obstruct new construction. Paint cuts over one inch in size with tree pruning compound. Care shall be taken so as not to scar any area of the tree's bark.
3. In order to protect from sediment transfer or contamination from urban run-off during construction, the following grading and erosion control practices shall be followed:
 - a. If grading occurs during the rainy season (November through April), sediment traps, barriers, covers or other methods shall be used to reduce erosion and sedimentation.
 - b. Excavated materials shall not be deposited or stored where the material can be washed away by high water or storm run-off.
 - c. Grading operations on site shall be conducted so as to prevent damaging effects of sediment production and dust on the site and on adjoining properties.

- d. When vegetation has to be removed on site, the methods shall be one that minimizes the erosive effects from the removal.
- e. Exposure of soil to erosion by removing vegetation shall be limited to the area required for construction operations. The construction area shall be fenced to define the project.
- f. Temporary mulching, seeding, or other suitable stabilization shall be used to protect areas during construction or other land disturbance activities on site.
- g. Topsoil, removed from the surface in preparation for grading and construction activities on Campus is to be stored on or near the site and protected from erosion while grading operations are underway, provided that such storage may not be located where it would cause suffocation of root systems of trees to be preserved. After completion of such grading, topsoil is to be restored to exposed cut and fill embankments of building pads so as to provide a suitable base of seeding and planting.
- h. Sediment basins, sediment traps, or similar control measures shall be installed before extensive clearing and grading operations begin for site development.
- i. Water or dust palliatives shall be applied to exposed earth services as necessary to control dust emissions.
- j. Revegetation or stabilization of exposed earth surfaces shall take place as soon as possible.

B. Removals

- 1. Clear the site of trees, shrubs, and other vegetation, which is indicated to be removed.
- 2. Completely remove stumps, roots, and other debris to avoid problems with future utilities.
- 3. Use only hand methods for grubbing inside the drip line of trees indicated to be left standing.
- 4. Existing fills, soil containing debris, organics, pavement, or other unsuitable materials shall be excavated and removed prior to commencing grading operations. Demolition areas shall be cleared of old foundations, slabs, abandoned utilities, landscaping, and soils disturbed during the demolition process. Depressions or disturbed areas left from the removal of such material shall be replaced with compacted fill.

5. The limits and depths for removal of existing fill materials shall be evaluated by project soils engineer during grading.
6. Revegetation or stabilization of exposed earth surface shall take place as soon as possible.

C. Removal of Improvements

1. Remove above-grade and below-grade improvements necessary to permit construction and other work as indicated.
2. Remove from site and legally dispose of off-site, existing fill materials, soil debris, or other unsuitable materials prior to commencing grading operations.

3.02 EXCAVATION

- A. Excavation for Pavements: Cut surface under pavements to comply with cross-sections, elevations and grades as shown, within a tolerance of plus or minus 0.04 foot.
- B. Excavation for Planting Areas: Conform to cross-sections, elevations and dimensions shown, within a tolerance of plus or minus 0.10 foot.

3.03 COMPACTION

- A. General: Control soil compaction during construction providing minimum percentage of density specified on plans.
- B. Percentage of Maximum Density Requirements: Compact soil to not less than the percentages of maximum dry density specified in the plans and in accordance with ASTM D1557-91 method of compaction.
- C. Moisture Control:
 1. When moisture content of exposed scarified soil and/or fill material is below that sufficient to achieve recommended compaction, water shall be added to the soil and/or fill. While water is being added, soil shall be bladed and mixed to provide relatively uniform moisture content throughout the material.
 2. When moisture content of exposed scarified soil and/or fill material is excessive, material shall be aerated by blading or other methods. Fill placed in pavement areas shall be compacted at near optimum moisture content. Jetting is not permitted for compaction.

3.04 FILL

- A. In all excavations, use satisfactory excavated or borrow material sampled and tested by the District 's Testing Laboratory.
- B. Fill excavations as promptly as Work permits, but not until completion of the following:
 - 1. Acceptance by District's Representative of construction below finish grade including, where applicable, waterproofing, damp-proofing, and drainage pipe.
 - 2. Examination, testing, approval and recording locations of underground utilities.
 - 3. Removal of concrete formwork.
 - 4. Removal of shoring and bracing and backfilling of voids with satisfactory materials.
 - 5. Removal of trash and debris.
 - 6. Permanent or temporary horizontal bracing is in place on horizontally supported walls.
 - 7. Protect excavations by methods required to prevent cave-in or loose soil from falling into excavation.
- C. Continual dust control, as required by the District, and in accordance with County Air Pollution Control District's Standards shall be required for the project construction.

3.05 GRADING

- A. General: To provide support for building floor slabs, all existing fill and unsuitable natural soils shall be excavated and replaced as properly compacted fill.
- B. Compaction: After grading, compact subgrade surfaces to the depth and percentage of compaction for each area classification.
- C. Fill placement and grading operations shall be performed only under the observation of the District 's Testing Laboratory.
- D. The exterior grades around building areas shall be sloped to drain away from the buildings to prevent ponding of water adjacent to foundations.
- E. Grading operation shall be conducted so as to prevent damaging effects of sediment product and dust on the site and adjoining properties.

3.06 DISPOSAL OF EXCESS AND WASTE MATERIALS

- A. Transport excess excavated material and legally dispose of off site.

3.07 FIELD QUALITY CONTROL

- A. Quality Control Testing During Construction: District 's Testing Laboratory will observe, test and approve subgrades and fill layers before further construction Work can be performed. The District's Representative will determine the frequency of tests. Subgrade: Allow at least one field density test of subgrade to be made for every 2000 sq. ft. of paved area, but in no case less than 3 tests.
- B. Field examination and testing will be performed by the District 's Testing Laboratory. The Contractor shall cooperate with such testing and shall give the District's Representative advance notice of grading scheduling.
- C. Frequency of Tests for Trenching: As determined by the District's Representative.
- D. If in the opinion of the District's Representative, based on soil testing reports and observations, subgrades or fills which have been placed are below specified density, provide corrective work as specified at no additional expense to the District, and pay for retesting of the soil.

3.08 PROTECTION

- A. Protect newly graded areas from traffic and erosion. Keep free of trash and debris.
- B. Repair and re-establish grades in settled, eroded, and rutted areas to specified tolerances.
- C. Reconditioning Compacted Areas: Where completed compacted areas are disturbed by subsequent construction operations or adverse weather, scarify surface, reshape, compact to required density and provide other corrective work as specified, with retesting, prior to further construction.

END OF SECTION

SECTION 32 11 23

AGGREGATE BASE COURSES

PART 1 - GENERAL

1.01 SUMMARY

- A. Aggregate base course for curbs, gutters, sidewalks, and fire access driveway.

1.02 RELATED SECTIONS

- A. Section 31 20 00 Earthwork.
- B. Section 32 16 00 Curbs, Gutters, Sidewalks, and Driveways.

1.03 REFERENCES

- A. Standard Specifications for Public Works (SSPWC), latest edition.
- B. ASTM Standards.
- C. State Standard Specifications (SSS), Caltrans, latest edition.

1.04 SUBMITTALS:

- A. Submit material samples and reports in accordance with requirements of District.
- B. Submit samples in sufficient quantities for material testing.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Aggregate Base Material shall be either aggregate base as specified in Section 200-2.2 of the Standard Specifications for Public Works Construction (Latest Edition) or Class 2 Aggregate Base conforming to SSS Section 26-1.02A.
- B. Aggregate Base materials used within building areas shall be free of asphaltic materials.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify substrate has been inspected; gradients and elevations are correct, and dry.

3.02 AGGREGATE BASE PLACEMENT

- A. Aggregate base placement shall conform to the provisions of the SSPWC, Section 301
- B. Level and contour surfaces to elevations and gradients indicated.
- C. Add water to assist compaction. If excess water is apparent, remove aggregate and aerate to reduce moisture content.
- D. Where the required aggregate base thickness is 6 inches or less, the watered base may be spread and compacted in one layer. Where the required thickness is more than 6 inches, the aggregate base material shall be spread and compacted in 2 or more layers of approximately equal thickness. The maximum compacted thickness of any one layer shall not exceed 6 inches.
- E. Aggregate base course shall be dense and unyielding upon proof-rolling with full water truck.

3.03 TOLERANCES

- A. Flatness: Maximum variation of 1/4 inch.
- B. Scheduled Compacted Thickness shall conform to the provisions of the SSPWC Section 301-2.2.

3.04 FIELD QUALITY CONTROL

- A. Inspection and testing shall be performed by the District's Testing Laboratory. Compaction testing will be performed in accordance with ASTM D1557, latest edition.
- B. If tests indicate work does not meet specified requirements, remove work, replace and retest at Contractor's expense.

END OF SECTION

SECTION 32 16 00

CURBS, GUTTERS, SIDEWALKS

PART 1 – GENERAL

1.01 SUMMARY

- A. Concrete for curbs, gutters, sidewalks.

1.02 RELATED SECTIONS

- A. Section 31 20 00 – Earthwork

1.03 REFERENCES

- A. Standard Specifications for Public Works Construction (SSPWC), latest edition.
- B. ASTM Standards.

1.04 SUBMITTALS

- A. Submit the following:
 - 1. Product Data: Provide data on admixtures and curing compounds.
 - 2. Concrete mix design(s).
 - 3. Certificates from the batch plant.

1.05 QUALITY ASSURANCE

- A. Perform Work in accordance with the SSPWC, latest edition; and ASTM Standards, latest edition.
- B. Obtain cementitious materials from same source throughout.

1.06 ENVIRONMENTAL REQUIREMENTS

- A. Do not place concrete when base surface temperature is less than 40 degrees F or surface is wet.

PART 2 – PRODUCTS

2.01 FORM MATERIALS

- A. Form Materials: Section 303-5 of the SSPWC.

2.02 CONCRETE MATERIALS

- A. Concrete Material for Curbs, Walk (Path of Travel), and Pavement:
 - 1. Class 520-C-2500 for cast-in-place curbs, and gutters. Portland cement concrete per Standard Specifications for Public Works Construction Section 201-1.1.2.
 - 2. Concrete reinforcements shall be constructed per the Project Plans and Specifications.

2.03 ACCESSORIES

- A. Curing Compound shall conform to SSPWC Section 201-4. Pigmented compound shall not demonstrate any residual coloring of the concrete after one week.

2.04 CONCRETE MIX

- A. Mix and deliver concrete in accordance with ASTM C94.
- B. Use accelerating admixtures in cold weather only when approved by the District's Representative. Use of admixtures will not relax cold weather placement requirements.
- C. Use calcium chloride only when approved by the District 's Representative.
- D. Use set retarding admixtures during hot weather only when approved by the District 's Representative.

2.05 CONCRETE REINFORCEMENT

- A. Concrete reinforcement shall conform to SSPWC Section 201-2.

2.06 SOURCE QUALITY CONTROL

- A. Provide certificates of compliance from the batch plant.

PART 3 – EXECUTION

3.01 EXAMINATION

- A. Verify compacted subgrade is acceptable and ready to support imposed loads.
- B. Verify gradients and elevations of subgrade are correct.

3.02 PREPARATION

- A. Moisten subgrade to minimize absorption of water from fresh concrete. Compact subgrade material to a depth of 12" beneath 4" of sand below concrete pavements to a minimum 90% of the maximum dry density.
- B. Coat surfaces of catch basin frames with oil to prevent bond with concrete pavement.
- C. Notify District's Representative a minimum of 24 hours prior to commencement of concrete placement operations.

3.03 FORMING

- A. Place and secure forms to correct location, dimension, and profile.
- B. Assemble formwork to permit easy stripping and dismantling without damaging concrete.
- C. Place joint filler vertical in position, in straight lines. Secure to formwork during concrete placement.

3.04 PLACING CONCRETE

- A. Place concrete in accordance with SSPWC Section 303-5.
- B. Install ½" thick fiberboard expansion joint and snap cap. Seal with Sikaflex self-leveling sealant after removal of snap cap (typical).
- C. Construct weakened plane joints conforming to SSPWC Section 303-5.4.3, one inch deep, at intervals not exceeding 10 feet.
- D. The top edges of curbs shall have 0.5" radius.

3.05 FINISHING

- A. Concrete finishes shall be per SSPWC Section 303-5.5.
- B. Portland cement concrete paving shall have a medium salted finish for slopes less than 6%, and slip-resistant at slopes of 6% or greater.
- C. Walkway grades in excess of 5% shall conform to requirements of Section 1133B.7.3, California Building Code (2016 edition).
- D. Place curing compound in accordance with SSPWC Section 303-5.6 on exposed concrete surfaces immediately after finishing. Apply in accordance with manufacturer's instructions.

3.06 FIELD QUALITY CONTROL

- A. Inspection and testing shall be performed by the District's Testing Laboratory.

- B. District 's Testing Laboratory will perform slump and compressive strength tests.
- C. Contractor shall maintain records of placed concrete items. Record date, location of pour, quantity, air temperature, and test samples taken.

3.07 PROTECTION

- A. Immediately after placement, protect pavement from premature drying, excessive hot or cold temperatures, vandalism and mechanical injury.
- B. It is the Contractor's responsibility to replace all concrete work subject to vandalism and graffiti at no extra cost to the District.

END OF SECTION

SECTION 33 40 00

STORM DRAINAGE UTILITIES

PART 1 - GENERAL

1.01 SUMMARY

- A. Storm drainage piping, fittings, accessories, and bedding.
- B. Catch basins.
- C. Manholes.
- D. Inlet and outlet structures.

1.02 RELATED SECTIONS

- A. Section 31 20 00 Earthwork.

1.03 REFERENCES

- A. Standard Specifications for Public Works Construction (SSPWC), latest edition.
- B. ASTM Standards.

1.04 SUBMITTALS

- A. Submit the following in accordance with provisions in Division 1:
 - 1. Product Data: Provide data indicating pipe, pipe accessories and catch basin grates.
 - 2. Manufacturer's Installation Instructions: Indicate special procedures required to install Products specified.
 - 3. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.
 - 4. Layout diagram for storm drain components per plan.

1.05 PROJECT RECORD DOCUMENTS

- A. Submit record drawings. Accurately record locations of pipe runs, connections, catch basins, structures, manholes and invert elevations.
- B. Identify and describe unexpected variations to subsoil conditions or discovery of uncharted utilities.

1.06 FIELD MEASUREMENTS

- A. Verify that field measurements and elevations are as indicated on drawings.
- B. Complete pothole work per plans and notify the District of any discrepancy prior to commencing construction.

1.07 COORDINATION

- A. Coordinate the work with connection to existing storm drain mains, and trenching.

PART 2 – PRODUCTS

2.01 PIPE MATERIALS

- A. Polyvinyl Chloride (PVC) SDR35, per SSPWC Section 207-17.

2.02 PIPE ACCESSORIES

- A. Fittings: Same material as pipe molded or formed to suit pipe size and end design, in required tee, bends, elbows, cleanouts, reducers, traps and other configurations required. Fittings shall be watertight.
- B. Solvent cap cement: pipe with solvent cement joints per SSPWC Section 207-17.3.3.

2.03 CATCH BASINS AND MANHOLES

- A. Precast catch basins shall include ADA compliant traffic rated grate, as manufactured by Brooks or approved equal.
- B. Cast-in-Place catch basins per Utility Improvement Plan.

2.04 METAL

- A. All exposed metal parts are to be galvanized in accordance with SSPWC, Section 210-3.

2.05 CONCRETE

- A. All concrete shall be Class 560-C-3250, per SSPWC Section 201.

2.06 FILTER FABRIC

- A. Filter fabric shall be non-woven geosynthetic per SSPWC Section 213-5.

PART 3 – EXECUTION

3.01 EXAMINATION

- A. Verify that trench cut is ready to receive Work and excavations, dimensions, and elevations are as indicated on Drawings.

3.02 PREPARATION

- A. Hand trim excavations to required elevations. Correct over excavation with compacted bedding material.
- B. Remove large stones or other hard matter which could damage piping or impede consistent backfilling or compaction.

3.03 BEDDING

- A. Hand trim excavation for accurate placement of pipe to elevations indicated on Drawings.
- B. Place bedding material in trench bottom, level materials in continuous layer. Bedding shall be 1/2 of pipe diameter or 4" minimum thickness whichever is greater, compact to a minimum of 95 percent of maximum dry density.
- C. Maintain optimum moisture content of bedding material to attain required compaction density.

3.04 INSTALLATION - PIPE

- A. Install pipe, fittings, and accessories in accordance with manufacturer's instructions. Construct tongue-and-groove mortar type of joint on RCP per SSPWC Section 207-2.5.
- B. Lay pipe to slope gradients noted on drawings; with maximum variation from true slope of 1/8 inch in 10 feet.
- C. Install sand backfill along sides and over top of pipe. Provide sand backfill over top of pipe to minimum compacted thickness of 12 inches, compacted to a minimum of 95 percent of maximum dry density.
- D. Do not displace or damage pipe when compacting.

- E. The compaction of the backfill material along the sides and one foot above the pipe shall be done with hand tampers or equal to protect the pipe.

3.05 INSTALLATION - CATCH BASINS, MANHOLES

- A. Form bottom of excavation clean and smooth to correct elevation.
- B. Form and place cast-in-place concrete base with provisions for storm drainage pipe end sections.
- C. Level top surface of concrete base to receive shaft sections.
- D. Establish elevations and pipe inverts for inlets and outlets as indicated on drawings.
- E. Compact top 12" of native materials below the bottom of catch basins and manholes to minimum 95 percent of maximum dry density.

3.06 FIELD QUALITY CONTROL

- A. Inspection and testing shall be performed by the District's representative.
- B. Request inspection prior to and immediately after placing backfill cover over pipe.
- C. If tests indicate work does not meet specified requirements, remove work, replace and retest at no cost to the District.

3.07 PROTECTION

- A. Protect pipe and backfill cover from damage or displacement until backfilling operation is in progress.

END OF SECTION