


INSTALL NEW THERMOSTATS FOR EACH ZONE.
WIRE MOLD AT INTERIOR EXPOSED LOCATIONS.
PLENUM RATED WIRE ABOVE CEILING
INSTALL WIRE IN CONDUIT AT UNIT

THERMOSTAT LEGEND
AH # - ZONE NUMBER


##

- SHEET NOTES**
- THIS SHEET IS FOR AIR BALANCE PURPOSES ONLY. THERE IS NO CHANGE TO BUILDING STRUCTURE OR USE. THERE ARE NO NEW PENETRATIONS OF RATED WALLS OR FLOORS.
 - REMOVE AND REINSTALL CEILING TILES AS NEEDED FOR AIR BALANCE.
 - AT THE BEGINNING OF AIR BALANCING SURVEY TO DETERMINE THE LOCATION OF EXISTING VOLUME DAMPERS. PROVIDE RFI WITH ANY LOCATIONS WITH MISSING VOLUME DAMPERS. NEEDED FOR AIR BALANCING PURPOSES.

WALL RATING LEGEND
1 HOUR RATING



FIRST FLOOR AIR BALANCE PLAN
SCALE: 1/8"=1'0"

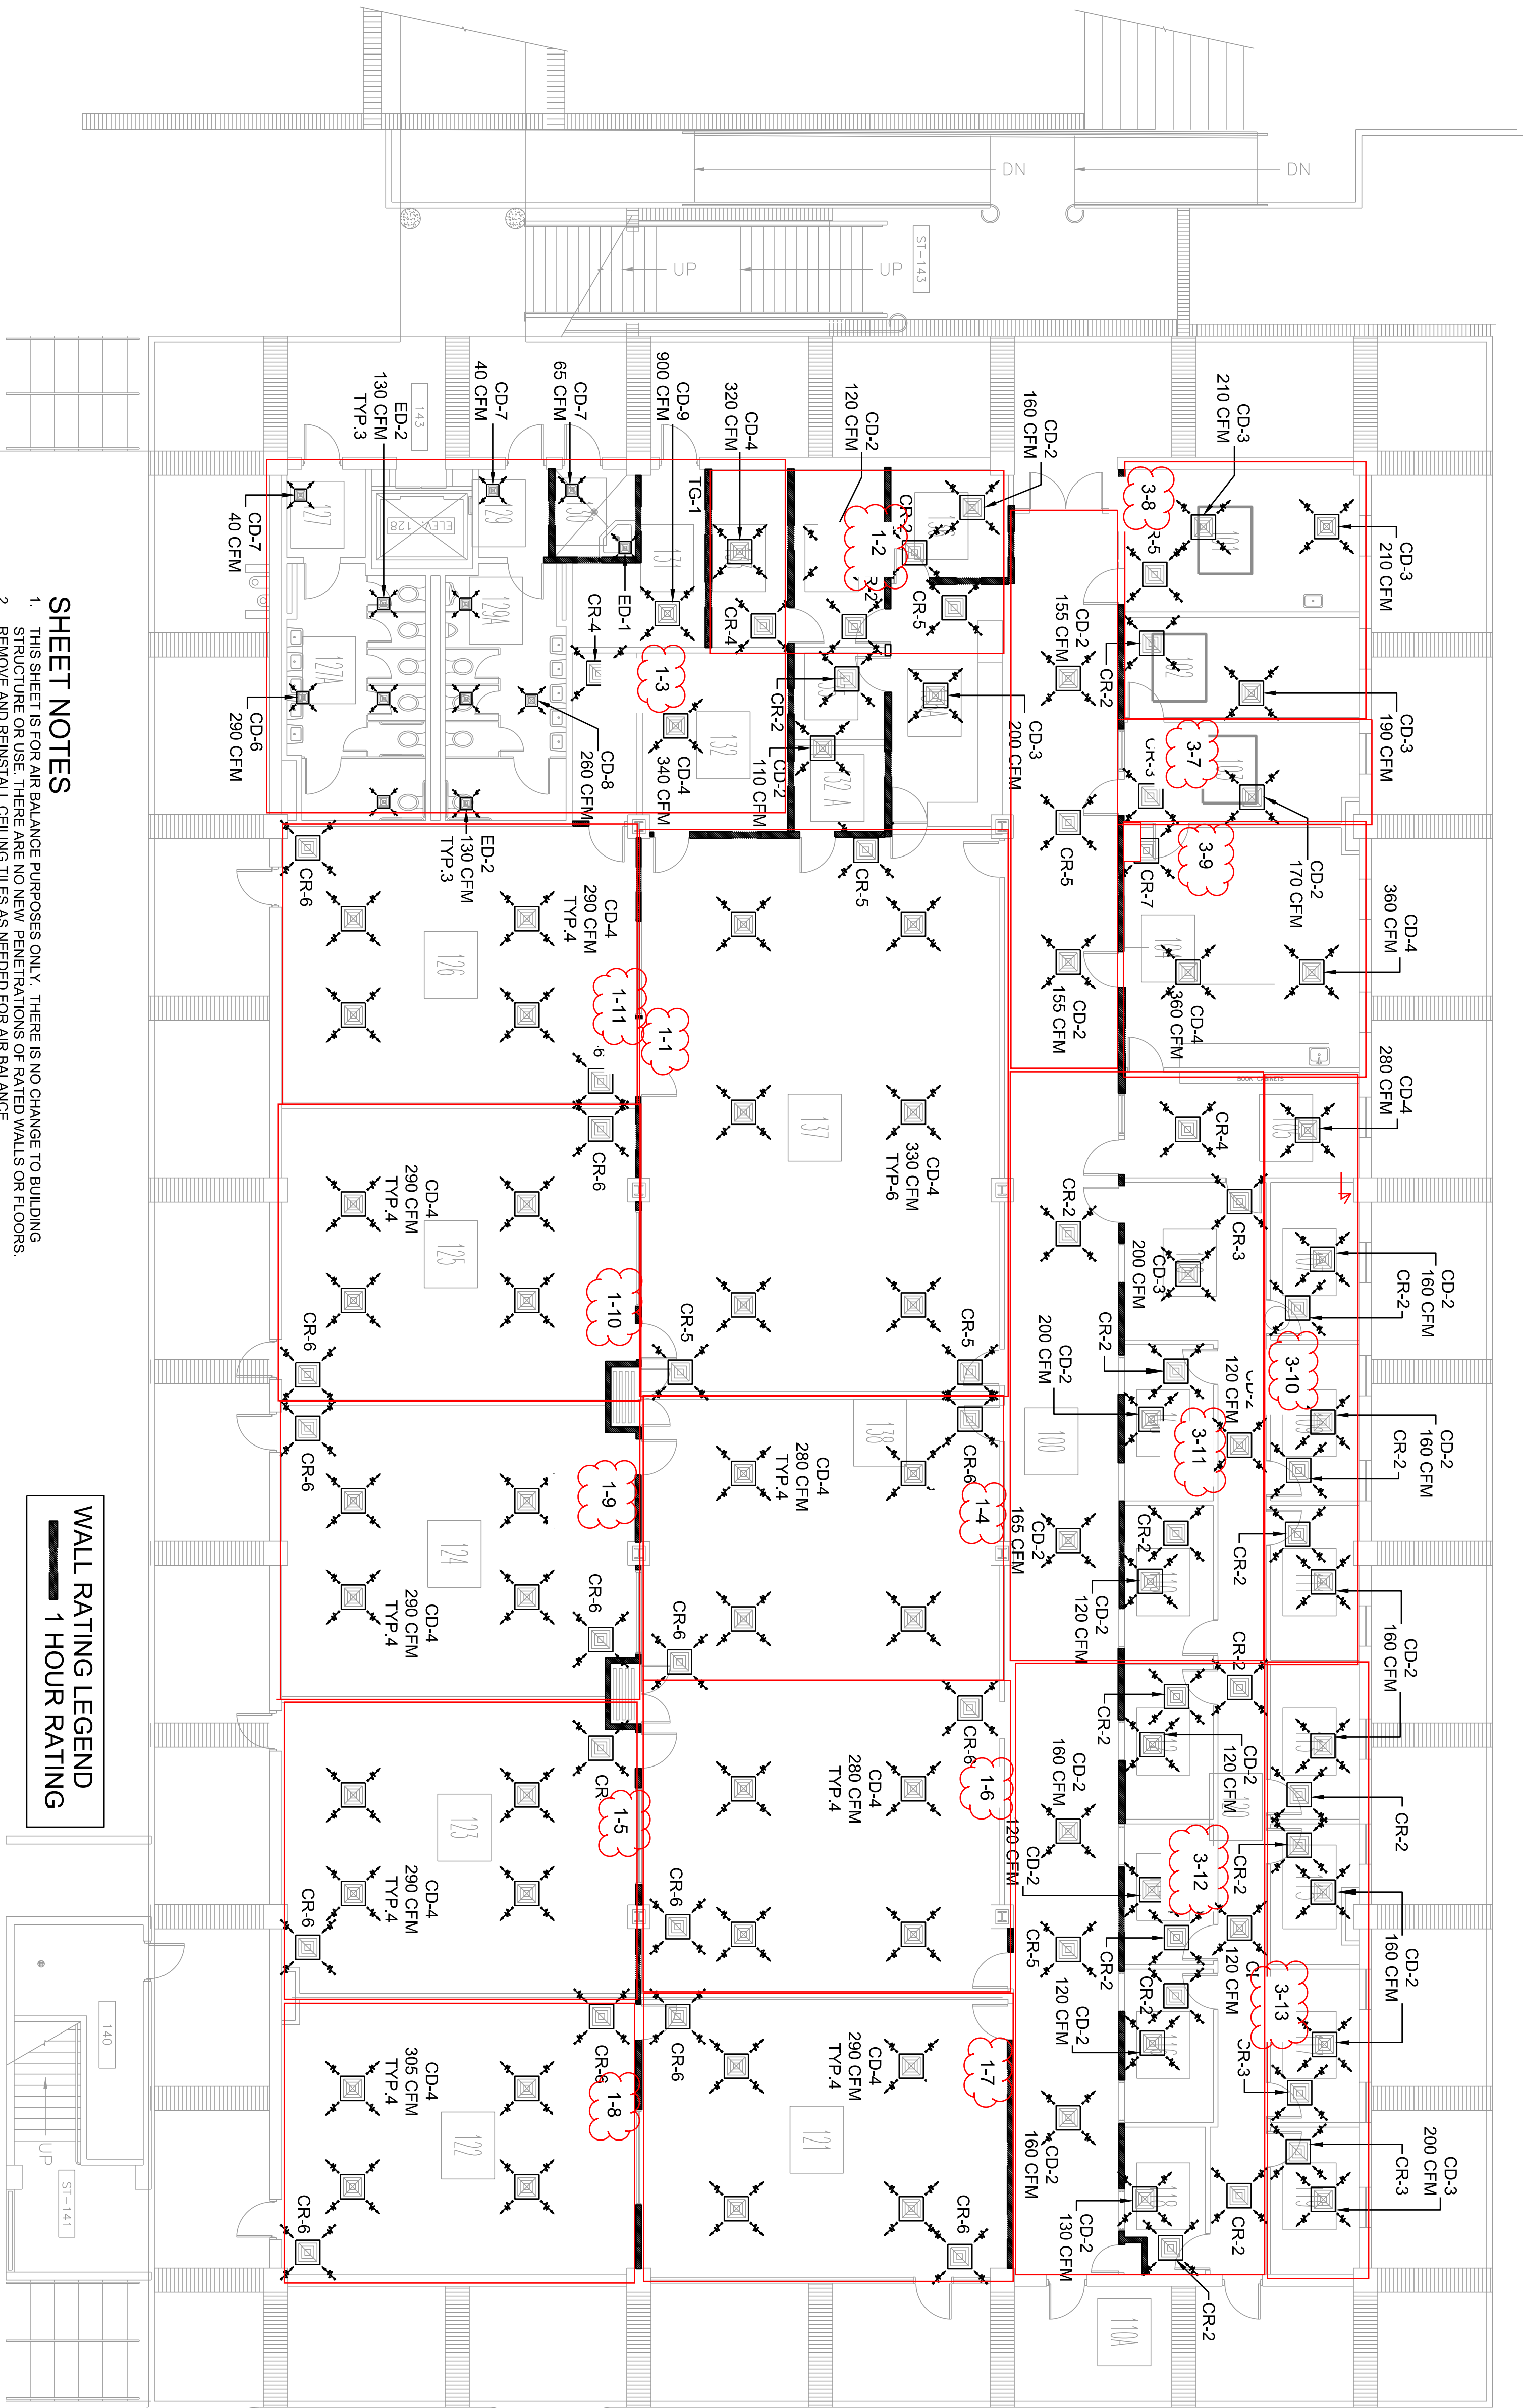

REV.	DATE	DESCRIPTION

AE Group Mechanical Engineers 638 East Front Street Ventura, CA 93001-2925 (805) 655-1722 hugh@ae-group.com	MOORPARK COLLEGE 7075 CAMPUS ROAD, MOORPARK, CALIFORNIA 93021 VENTURA COUNTY COMMUNITY COLLEGE DISTRICT	DEPARTMENT OF MAINTENANCE & OPERATIONS 7075 CAMPUS RD. MOORPARK, CA 93021 PHONE: (805) 376-454 FAX: (805) 376-183	SCALE AS SHOWN DATE: 9-3-25 REV. NO.	LM BUILDING HVAC REPLACEMENT PROJECT SHEET NO. M5.0
---	--	---	---	--