

TECHNICAL SPECIFICATIONS

FOR

**REPLACE AUTOMATIC SLIDING ENTRANCES
AT
MEDIA ARTS BUILDING (MA)
GYMNASIUM (GM)
LIFE SCIENCE / MATH BUILDING (LM)**

**VENTURA COUNTY COMMUNITY COLLEGE DISTRICT
Bid No.**

FOR

**MOORPARK COLLEGE
7075 CAMPUS ROAD
MOORPARK, CA 93021**

OCTOBER 2024



Lucas G. Amador, ARCHITECT
AMADOR WHITTLE ARCHITECTS, INC

**TECHNICAL SPECIFICATIONS
FOR
MOORPARK COLLEGE REPLACEMENT OF AUTO SLIDERS AT VARIOUS BUILDINGS**

DIVISION 00 – PROCUREMENT AND CONTRACTING REQUIREMENTS

00000 Title Page 01
 00100 Table of Contents..... 01

DIVISION 1 – GENERAL REQUIREMENTS

01 1100 Summary of Work 04
 01 3113 Project Coordination..... 04
 01 3300 Submittal Procedures..... 08
 01 7329 Cutting and Patching 07
 01 7700 Contract Close Out 06
 01 7836 Warranties 03

DIVISION 2 - DEMOLITION

02 4116 Demolition 04

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

07 9200 Joint Sealants.....06

DIVISION 8 - OPENINGS

08 4229 Sliding Automatic Entrances16
 08 8000 Glazing06

DIVISION 9 - FINISHES

09 9000 Painting and Coating09

END OF TABLE OF CONTENTS

SECTION 01 1100
SUMMARY OF WORK

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. The furnishing of all labor, materials, equipment, services, and incidentals necessary for Work of the **REPLACEMENT OF AUTOMATIC SLIDING ENTRANCES** at **MOORPARK COLLEGE** located at **7075 Campus Road, Moorpark, California 93021**, as set forth in the Construction Documents which include, but are not limited to, the Drawings, Addenda and Specifications.

PART 2 - PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 USE OF PREMISES

- A. CONTRACTOR shall coordinate Work of all trades, Subcontractors, utility service providers, with OWNER and/or Separate Work Contract. CONTRACTOR shall sequence, coordinate, and perform the Work to impose minimum hardship on the operation and use of the existing facilities and/or Project site. CONTRACTOR shall install all necessary protection for existing improvements, Project site, property, and new Work against dust, dirt, weather, damage, vandalism, and maintain and relocate all protection to accommodate progression of the Work.
- B. CONTRACTOR shall confine entrance and exiting to the Project site and/or facilities to routes designated by the OWNER.
- C. Within existing facilities, OWNER will remove portable equipment, furniture, and supplies from Work areas prior to the start of Work. CONTRACTOR shall cover and protect remaining items in areas of the Work.
- D. CONTRACTOR is advised school may be in session during performance of the Work. CONTRACTOR shall utilize all available means to prevent generation of unnecessary noise and maintain noise levels to a minimum. When required by the OWNER, CONTRACTOR shall immediately discontinue noise-generating activities and/or provide alternative methods to minimize noise generation. CONTRACTOR shall install and maintain air compressors, tractors, cranes, hoists, vehicles, and other

internal combustion engine equipment with mufflers, including unloading cycle of compressors. CONTRACTOR shall discontinue operation of equipment producing objectionable noise as required by the OWNER.

- E. CONTRACTOR shall furnish, install, and maintain adequate supports, shoring, and bracing to preserve structural integrity and prevent collapse of existing improvements and/or Work modified and/or altered as part of the Work.
- F. CONTRACTOR shall secure building entrances, exits, and Work areas with locking devices as required by the OWNER.
- G. CONTRACTOR assumes custody and control of OWNER property, both fixed and portable, remaining in existing facilities vacated during the Work.
- H. CONTRACTOR shall cover and protect surfaces of rooms and spaces in existing facilities turned over for the Work, including OWNER property remaining within as required to prevent soiling or damage from dust, dirt, water, and/or fumes. CONTRACTOR shall protect areas adjacent to the Work in a similar manner. Prior to OWNER occupancy, CONTRACTOR shall clean all surfaces including OWNER property.
- I. CONTRACTOR shall not use or allow anyone other than OWNER employees to use facility telephones and/or other equipment, except in an emergency. CONTRACTOR shall reimburse OWNER for telephone toll charges originating from the facility except those arising from emergencies or use by OWNER employees.
- J. CONTRACTOR shall protect all surfaces, coverings, materials, and finished Work from damage. Mobile equipment shall be provided with pneumatic tires.
- K. CONTRACTOR is advised OWNER may award Separate Work Contracts at this Project site.
- L. CONTRACTOR shall not permit the use of portable and/or fixed radio's or other types of sound producing devices including walkmans and similar devices.

3.02 PROPERTY INVENTORY

- A. Property, OWNER intends to remove; will be removed by OWNER before a room or space is vacated for the Work. Before performing Work in each room or space, OWNER and CONTRACTOR shall prepare a detailed initial written inventory of OWNER property remaining within, including equipment and telephone instruments and the condition thereof. OWNER and CONTRACTOR shall retain a signed copy of the inventory dated and signed by both parties. Prior to subsequent OWNER occupancy of each such room or space, OWNER and CONTRACTOR shall perform a

final inventory of OWNER property and all discrepancies between the initial inventory and final inventory shall be the responsibility of CONTRACTOR.

3.03 FURNITURE, FIXTURES AND EQUIPMENT (MATERIALS) OWNER FURNISHED CONTRACTOR INSTALLED (OFCI)

- A. Certain materials identified in the Contract Documents as OWNER Furnished CONTRACTOR Installed, OFCI, will be delivered to the Project site by the OWNER.
- B. If designated in the Contract Documents to be OWNER furnished CONTRACTOR installed, (OFCI), CONTRACTOR shall unload, store, uncrate, assemble, install, and connect OWNER supplied materials.
- C. Sixty days before the date the CONTRACTOR needs to have the OFCI materials on site, CONTRACTOR shall notify OWNER of the scheduled date for needed OFCI materials. Upon delivery to Project site, CONTRACTOR shall store OFCI materials inside rooms and/or protected spaces and will be responsible for security of OFCI materials until Substantial Completion. OWNER will sign receipt or bill of lading as applicable.
- D. CONTRACTOR shall, within ten days after delivery, uncrate and/or unpack OFCI materials in presence of OWNER who shall inspect delivered items. OWNER shall prepare an inspection report listing damaged or missing parts and accessories. OWNER shall transmit one copy of the report to CONTRACTOR. OWNER will procure and/or replace missing and or damaged OFCI materials, as indicated in inspection report.
- E. CONTRACTOR shall install OFCI materials in the locations and orientation as indicated in the Contract Documents. CONTRACTOR shall verify exact locations with OAR before final installation of OFCI materials.
- F. If required, ONWER will furnish setting and or placement drawings for OFCI materials.
- G. CONTRACTOR shall install OFCI materials by proper means and methods to ensure an installation as recommended by the manufacturer. CONTRACTOR shall furnish and install all necessary fasteners and required blocking to properly install OFCI materials.
- H. CONTRACTOR shall install OFCI materials with manufacturer recommended fasteners for the type of construction to which the OFCI materials are being fastened and/or anchored.

- I. CONTRACTOR shall provide final connections of any electrical, signal, gas, water, waste, venting and/or similar items to OFCI materials. CONTRACTOR shall, prior to final connection, verify the operating characteristics of OFCI materials are consistent with the designated supply.
- 3.04 FURNITURE, FIXTURES AND EQUIPMENT (Materials) - OWNER furnished, OWNER installed (OFOI)
- A. Certain materials are identified in the Contract Documents as OWNER Furnished, OWNER Installed (OFOI)
- B. On dates and during times designated by OWNER, CONTRACTOR shall provide clear off-loading, receiving, protected storage, and OWNER'S dumpster space areas for the use of OWNER or OWNER'S third party OFOI installation contractors. At such times, CONTRACTOR shall also make clear routes and access available to all rooms and spaces to receive OFOI materials.
- C. On dates and during times designated by OWNER, CONTRACTOR shall provide access to the elevators for use of OWNER or OWNER'S third party OFOI installation contractors.
- D. CONTRACTOR shall cooperate fully with OWNER or OWNER'S third part OFOI installation contractors.
- E. CONTRACTOR may be requested by OWNER to provide supplemental labor and equipment to support OFOI activities. Such requests must be submitted in accordance with the change order clauses of Contract.
- F. Immediately prior to mobilization of OWNER or OWNER'S third party OFOI installation contractors, OWNER shall document the condition of the Work in areas to be utilized for OFOI activities.
- G. CONTRACTOR shall not be responsible for damage caused by OWNER or OWNER'S forces. OWNER shall document the condition of the Work and report to CONTRACTOR any damage in areas utilized for OFOI activities.

END OF SECTION

SECTION 01 3113

PROJECT COORDINATION

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section specifies administrative and procedural requirements necessary for coordinating Work operations including, but not limited to, the following:
 - 1. General coordination procedures.
 - 2. Coordination drawings.

1.02. RELATED REQUIREMENTS

- A. Section 01 3300: Submittal Procedures.
- B. Section 01 7700: Contract Closeout.

PART 2 - PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 COORDINATION

- A. CONTRACTOR shall coordinate operations included in various sections of Contract Documents to assure efficient and orderly installation of each part of Work. Coordinate Work operations included under related sections of Contract Documents that depend on each other for proper installation, connection, and operation of Work, including but not limited to:
 - 1. Schedule construction operations in sequence required where installation of one part of Work depends on installation of other components, before or after its own installation.
 - 2. Coordinate installation of different components to assure maximum accessibility for required maintenance, service, and repair.
 - 3. Provide provisions to accommodate items scheduled for later installation.
 - 4. Prepare and administer provisions for coordination drawings.

- B. Where necessary, prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required in notices, reports, attendance at meetings, and:
 - 1. Prepare similar memoranda for OWNER and Separate Work Contract where coordination of their Work is required.
- C. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities to avoid conflicts and assure orderly progress of Work. Such administrative activities include, but are not limited to, following:
 - 1. Preparation of schedules.
 - 2. Installation, relocation, and removal of temporary facilities.
 - 3. Delivery and processing of submittals.
 - 4. Progress meetings.
 - 5. Project closeout activities.
- D. Conservation: Coordinate Work operations to assure operations are carried out with consideration given to conservation of energy, water, materials, and:
 - 1. Salvage materials and equipment involved in performance of, but not actually incorporated into Work.

3.02 SUBMITTALS

- A. Coordination Drawings: CONTRACTOR shall prepare coordination drawings to coordinate the installation of products and materials fabricated, furnished and installed by separate entities, under different parts of the Contract. CONTRACTOR shall notify OWNER and ARCHITECT of all major conflicts in writing in a timely manner so that the design team can respond without construction delays. Coordination drawings shall address the following at a minimum:
 - 1. Limitations in available space for installation or service. CONTRACTOR shall overlay plans of each trade and verify space requirements and conflicts between trades. Minor changes and adjustments that do not affect design intent shall be made by CONTRACTOR and shall be highlighted for ARCHITECT'S review.

2. Incompatibility between items provided under different trades (such as difference in voltage between equipment specified under Divisions 22 and 23 and electrical power provided under Division 26.)
 3. Inconsistencies between drawings, specifications and codes (between trades and within each trade).
 4. Additional items required for existing facilities construction projects shall be designed and prepared from available as-built drawings that are verified through non-invasive and non-destructive, visual observation only. CONTRACTOR shall field verify actual existing conditions during and upon completion of demolition work and incorporate findings into preparation of co-ordination drawings. Minor changes and adjustments that do not affect design intent shall be made by Sub-Contractor and shall be highlighted for OAR and ARCHITECT'S reviews.
- B. Prepare coordination drawings in CAD with each trade on a separate layer, in specified color and scale. CONTRACTOR and each Subcontractor shall provide and forward reproducible copies and CAD drawing files in the order described here:
1. Structural shop drawings shall indicate location and sizes of columns, beams and other structural members, as well as wall, roof and slab penetrations, and will be provided to electrical, and low voltage Sub-contractors for co-ordination. Structural items shall be indicated using black lines.
 2. Electrical and Low Voltage Subcontractors will indicate service and feeder conduit runs and other electrical equipment complete, including low voltage with installation and dimensioned service clearances, sizes, top or bottom of conduit and rack elevations, distances of conduits and equipment from building reference points and hanger and support locations. Co-ordinate with Fire Sprinkler, Plumbing and HVAC Subcontractors. Minor changes and adjustments that do not affect design intent shall be made by sub-contractors and shall be highlighted for OAR and ARCHITECT'S reviews. Upon completion drawings shall be forwarded to CONTRACTOR for further co-ordination. Electrical work shall be indicated in dark green lines. Low voltage work shall be indicated in light green lines.
 6. CONTRACTOR will be responsible for the overall coordination review. As each coordination drawing is completed, CONTRACTOR will meet with OAR to review and resolve all conflicts on coordination drawings.

7. Coordination meetings will be held in Project field office of CONTRACTOR. CONTRACTOR is required to distribute Shop Drawings, cut sheets and submittals to Subcontractors where appropriate. Reviewed coordination drawings will be maintained in Project field office of CONTRACTOR. Meeting minutes shall be developed by CONTRACTOR and submitted to OWNER within 5 days.

END OF SECTION

SECTION 01 3300

SUBMITTAL PROCEDURES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Administrative and procedural requirements for submittals required for the Work, including but not limited to; Shop Drawings, Product Data, Samples, material lists, and quality control items.
- B. Throughout the Contract Documents, the minimum acceptable quality of materials, fabrication, and execution have been defined by the name and catalog number of a manufacturer and by reference of recognized industry standards.
- C. To ensure that specified products are furnished and installed in accordance with the design intent, procedures have been established for submittal of design data and for its review by ARCHITECT, OWNER and others.

1.02 RELATED REQUIREMENTS

- A. Section 01 3113: Project Coordination.
- B. Section 01 7329: Cutting and Patching.
- C. Section 01 7700: Contract Closeout.

PART 2 – PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 PROCEDURES

- A. CONTRACTOR is required to review and approve every submittal and shop drawing prior to transmittal and delivery to ARCHITECT. Should CONTRACTOR determine a submittal contains errors, or does not meet the requirements of the contract, CONTRACTOR shall immediately return the submittals and shop drawings to the producer and expedite the corrections prior to transmitting the submittal to ARCHITECT. Submittals shall not be used by CONTRACTOR to request clarifications or submit questions. CONTRACTOR will affix stamp to each submittal certifying CONTRACTOR has performed, at minimum, the following:

1. Verified the submittal is complete in all respects and follows the requirements of the Contract Documents without variance.
 2. Confirmed that no substitutions have been included. If substitutions are included, CONTRACTOR shall eliminate them from the submittal and process them in accordance with Section 00 7000 General Conditions Article 6.14.
 3. Identified any variances from the requirements of the Contract Documents and confirmed that the identified variance meets, but does not exceed the allowable limitations or tolerances as defined in these specifications.
 4. Verified that all submitted materials, dimensions and tolerances are compatible with existing or planned conditions of the Work in order to erect, fabricate, or install the submitted assembly in conformance with the requirements of the Contract Documents.
 5. Coordinated and verified that the dimensions match CONTRACTOR measured field or installation conditions.
 6. Coordinated and verified that the products of separate manufacturers required within any field produced assembly are compatible in all respects for such assembly.
 7. Packaged together all related submittals or shop drawings where such is necessary for a comprehensive ARCHITECT review.
- B. CONTRACTOR shall package each submittal appropriately for transmittal and handling. Transmittal format shall be as required by OWNER. CONTRACTOR shall transmit one PDF format set of each submittal or re-submittal to ARCHITECT, which shall be returned to CONTRACTOR. CONTRACTOR shall provide the OWNER additional copies as specified or as requested by OWNER. ARCHITECT will not accept submittals received from sources other than from CONTRACTOR.
- C. After ARCHITECT'S review, ARCHITECT will transmit submittals to OWNER, CONTRACTOR, INSPECTOR and others as required. Work shall not commence, unless otherwise approved by OWNER, until approved submittals are transmitted to CONTRACTOR.
- D. CONTRACTOR shall clearly identify any deviations from the Contract Documents on each submittal. Any deviation not so noted even though stamped reviewed is not acceptable.

- E. CONTRACTOR shall coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities requiring sequential activity.
- F. Timing of Submittals:
1. In accordance with General Conditions, CONTRACTOR shall submit to ARCHITECT, with copy of transmittal to the OWNER, those Shop Drawings, Product Data, diagrams, materials lists, Samples and other submittals required by the Contract Documents.
 2. The scheduling of submittals shall be sequenced to support the progress of the Work, and shall be:
 - a. Submitted sufficiently in advance of construction, fabrication or installation in order to allow time for transmittal, review, modification, correction, (and resubmission and re-review when required.)
 - b. Phased with adequate time between submittals in order to allow for proper review by the ARCHITECT without negative impact to the Milestones Schedule.
 3. CONTRACTOR shall coordinate submittal of related items and ARCHITECT reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received by ARCHITECT.
 4. CONTRACTOR shall revise, update and submit submittal schedule to ARCHITECT and OWNER on the first of each month, or as required by OWNER.
 5. CONTRACTOR shall allow in the Construction Schedule, at least sixteen days for ARCHITECT review following ARCHITECT receipt of submittal. For mechanical, plumbing, electrical, low voltage, fire sprinklers, door and hardware, and other submittals requiring joint review with OWNER, CONTRACTOR shall allow a minimum of eighteen days following ARCHITECT receipt of submittal.
 6. No adjustments to the Contract Time or Milestones will be authorized because of a failure to transmit submittals to ARCHITECT sufficiently in advance of the Work to permit review and processing or where CONTRACTOR fails to provide ARCHITECT submittals on related items.

7. In case of product substitution, Shop Drawing preparation shall not commence until such time as OWNER accepts or rejects the proposed substitution in accordance with the procedures described in the General Conditions.
- G. If required, resubmit submittals in a timely manner. Resubmit as specified for initial submittal but identify as such. Review times for re-submitted items shall be as per the time frames for initial submittal review.
- H. Shop Drawing preparation shall not commence until such time as CONTRACTOR receives Product Data acceptance.
- I. ARCHITECT will stamp each submittal with a uniform, action stamp. ARCHITECT will mark the stamp appropriately to indicate the action taken, as follows:
 1. Final Unrestricted Release: When ARCHITECT marks a submittal “Reviewed” the Work covered by the submittal may proceed provided it complies with requirements of the Contract Documents. Final payment depends on that compliance.
 2. Final-But-Restricted Release: When ARCHITECT, or authorized agent, marks a submittal “Reviewed as Noted,” the Work covered by the submittal may proceed provided it complies with notations or corrections on the submittal and requirements of the Contract Documents. Final payment depends on that compliance.
 3. Returned for Re-submittal: When ARCHITECT, or authorized agent, marks a submittal “Rejected, Revise and Resubmit,” do not proceed with Work covered by the submittal, including purchasing, fabrication, delivery, or other activity. Revise or prepare a new submittal according to the notations; resubmit without delay. Repeat as necessary to obtain different action mark. In case of multiple submittals covering same items of Work, CONTRACTOR is responsible for any time delays, schedule disruptions, out of sequence Work, or additional costs due to multiple submissions of the same submittal item. Do not use, or allow others to use, submittals marked “Rejected, Revise and Resubmit” at the Project site or elsewhere where Work is in progress.
 4. Other Action: Where a submittal is for information or record purposes or special processing or other activity, ARCHITECT, or authorized agent, will return the submittal marked “Action Not Required “.

3.02 SHOP DRAWINGS

- A. Shop Drawings are original drawings prepared by CONTRACTOR, Sub-contractor, supplier, or distributor illustrating some portion of Work by showing fabrication, layout, setting, or erection and shall not be based on reproduced Contract Documents or copied standard information.
- B. Produce Shop Drawings to an accurate scale that is large enough to indicate all pertinent features and methods. Except for templates, patterns, and similar full-size drawings, submit Shop Drawings on sheets at least 8-1/2 by 11 inches but no larger than 24 by 36 inches.
- C. Shop Drawings shall include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings. Include the following information:
 - 1. Dimensions.
 - 2. Identification of products and materials included by sheet and detail number.
 - 3. Compliance with specified standards.
 - 4. Notation of coordination requirements.
 - 5. Notation of dimensions established by field measurement.
- D. Each submittal shall bear the following information:
 - 1. Project name.
 - 2. Date.
 - 3. Name and address of ARCHITECT.
 - 4. Name and address of CONTRACTOR.
 - 5. Name and address of Subcontractor.
 - 6. Name and address of supplier.
 - 7. Name and address of manufacturer.

8. Name and title of appropriate Specification section.
9. Drawing number and detail references, as appropriate.

3.03 PRODUCT DATA

- A. Collect Product Data into a single submittal for each element of Work or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, wiring diagrams, schedules, illustrations, or performance curves.
 1. Mark each copy to show or delineate pertinent materials, products, models, applicable choices, or options. Where Product Data includes information on several products that are not required, clearly mark copies to indicate the applicable information. Include the following information:
 - a. Manufacturer's printed recommendations.
 - b. Compliance with trade association standards.
 - c. Compliance with recognized testing agency standards.
 - d. Application of testing agency labels and seals.
 - e. Notation of dimensions verified by field measurement.
 - f. Notation of coordination requirements.
 - g. Notation of dimensions and required clearances.
 - h. Indicate performance characteristics and capacities.
 - i. Indicate wiring diagrams and controls.
 2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed by CONTRACTOR.

3.04 SAMPLES

- A. Procedure:

1. Submit Samples of sufficient size, quantity, cured and finished and physically identical to the proposed product or material. Samples include partial or full sections or range of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches denoting color, texture, and/or pattern.
 - a. Mount or display Samples in the manner to facilitate review of qualities indicated. Include the following:
 - 1) Specification section number and reference.
 - 2) Generic description of the Sample.
 - 3) Sampling source.
 - 4) Product name or name of manufacturer.
 - 5) Compliance with recognized standards.
 - 6) Availability and delivery time.
2. Submit Samples for review of size, kind, color, pattern, and texture. Submit Samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.
 - a. Where variations in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show the approximate limits of the variations.
 - b. Refer to other Specification sections for requirements for Samples that illustrate materials, fabrication techniques, assembly details, connections, operation, and similar construction characteristics.
 - c. Refer to other sections for Samples to be returned to CONTRACTOR for incorporation into the Work. Such Samples must be undamaged at time of installation. On the transmittal indicate special requests regarding disposition of Sample submittals.
 - d. Samples not incorporated into the Work, or otherwise not designated as Owner property, remain the property of CONTRACTOR and shall be removed from the Project site prior to Substantial Completion.

3. Color and Pattern: Whenever a choice of color or pattern is available in a specified product, submit accurate color chips and pattern charts to OWNER for review and selection.
 4. Number Required: Submit six, minimum, of each. Two will be returned to CONTRACTOR.
- B. When specified, erect field Samples and mock-ups at the Project site to illustrate products, materials, fabrications, or execution and to establish standards by which completed Work shall be judged.
 - C. Maintain sets of Samples, as returned, at the Project site, for quality comparisons throughout the course of the Work. Sample sets may be used to obtain final acceptance of the Work associated with each set.

3.05 QUALITY CONTROL SUBMITTALS

- A. Submit quality control submittals, including design data, certifications, manufacturer's field reports, and other quality control submittals as required under other sections of the Contract Documents.
- B. When other sections of the Contract Documents require manufacturer's certification of a product, material, or installation complies with specified requirements, submit a notarized certification from the manufacturer certifying compliance with specified requirements.
- C. Certification shall be signed by an officer of the manufacturer or other individual authorized to sign documents on behalf of the represented company.
- D. Requirements for submittal of inspection and test reports are specified in other sections of the Contract Documents.

END OF SECTION

SECTION 01 7329
CUTTING AND PATCHING

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section specifies procedural requirements for cutting and patching.

1.02 RELATED REQUIREMENTS

- A. Section 02 4116 - Demolition.

1.03 SUBMITTALS

- A. The word “cutting” as used in the Contract Documents includes, but is not limited to, cutting, drilling, chopping, and other similar operations and the word “patching” includes, but is not limited to, patching, rebuilding, reinforcing, repairing, refurbishing, restoring, replacing, or other similar operations.
- B. Cutting and Patching Proposal: CONTRACTOR shall submit a proposal describing procedures well in advance of the time cutting and patching will be performed if the Contract Documents requires approval of these procedures before proceeding. Include the following information, as applicable, in the proposal:
1. Describe the extent of cutting and patching required. Denote how it will be performed and indicate why it cannot be avoided.
 2. Describe anticipated results in terms of changes to existing construction. Include changes to structural elements and operating components as well as changes in the building’s appearance or other significant visual elements.
 3. List products to be used and firms or entities that will perform this Work.
 4. Indicate dates when cutting and patching will be performed.
 5. Utilities: List utilities that cutting and patching operations will disturb or affect. List utilities to be relocated and those that will be temporarily out-of-service. Indicate how long service will be disrupted.

6. Where cutting and patching involves adding reinforcement to structural elements, submit details and engineering calculations showing integration of reinforcement with the original structure.
7. Review by ARCHITECT prior to proceeding with cutting and patching does not waive ARCHITECT right to later require complete removal and replacement of defective Work.

1.04 QUALITY ASSURANCE

- A. Requirements for structural Work: Do not cut and patch structural elements in a manner that would change their load-carrying capacity or load-deflection ratio.
 1. Obtain approval from ARCHITECT of the cutting and patching proposal before cutting and patching the following structural elements:
 - a. Foundation construction.
 - b. Bearing and retaining walls.
 - c. Structural concrete.
 - d. Structural steel.
 - e. Lintels.
 - f. Timber and primary wood framing.
 - g. Structural decking.
 - h. Stair systems.
 - i. Miscellaneous structural metals.
 - j. Exterior curtain-wall construction.
 - k. Equipment supports.
 - l. Piping, ductwork, vessels, and equipment.
 - m. Structural systems of special construction in Division 13 Sections.
- B. Operational Limitations: Do not cut and patch operating elements or related components in a manner that would result in reducing their capacity to perform as intended. Do not cut and patch operating elements or related components in a manner that would result in increased maintenance or decreased operational life or safety.

1. Obtain review of the cutting and patching proposal before cutting and patching the following operating elements or safety related systems:
 - a. Primary operational systems and equipment.
 - b. Air or smoke barriers.
 - c. Water, moisture, or vapor barriers.
 - d. Membranes and flashings.
 - e. Fire protection systems.
 - f. Noise and vibration control elements and systems.
 - g. Control systems.
 - h. Communication and/or data systems.
 - j. Electrical wiring systems.
- C. Visual Requirements: Do not cut and patch construction exposed on the exterior or in occupied spaces in a manner that would, in the opinion of ARCHITECT, reduce the building's aesthetic qualities. Do not cut and patch construction in a manner that would result in visual evidence of cutting and patching. Remove and replace Work cut and patched in a visually unsatisfactory manner.

1.05 WARRANTY

- A. Existing Warranties: Replace, patch, and repair material and surfaces cut or damaged by methods and with materials in such a manner as not to void any warranties required or existing.

PART 2 - PRODUCTS (Not applicable)

PART 3 - EXECUTION

3.01 INSPECTION

- A. Examine surfaces to be cut and patched and conditions under which cutting and patching is to be performed before cutting. If unsafe or unsatisfactory conditions are encountered, take corrective action before proceeding.
 1. Before proceeding, meet at the Project site with parties involved in cutting and patching, including mechanical and electrical trades. Review areas of

potential interference and conflict. Coordinate procedures and resolve potential conflicts before proceeding.

3.02 PREPARATION

- A. Temporary support: Provide adequate temporary support of existing improvements or Work to be cut.
- B. Protection: Protect existing improvements and Work during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of existing improvements or Work that might be exposed during cutting and patching operations.
- C. Avoid interference with use of adjoining areas or interruption of free passage to adjoining areas.
- D. Where the Work requires sandblasting of existing surfaces in order to receive new materials secured by cementitious, adhesive or chemical bond, completely remove existing finishes, stains, oil, grease, bitumen, mastic and adhesives or other substances deleterious to the new bonding or fastening of new Work. Utilize wet sand blasting for interior surfaces and for exterior surfaces where necessary to prevent objectionable production of dust.

3.03 PERFORMANCE

- A. General: Employ skilled workmen to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time and complete without delay. Carefully remove existing Work to be salvaged and/or reinstalled. Protect and store for reuse into the Work. Verify compatibility and suitability of existing substrates before starting the Work.
- B. Cutting: Cut existing construction using methods least likely to damage elements retained or adjoining Work. Where possible, review proposed procedures with the original installer; comply with the original installer's recommendations.
 - 1. In general, where cutting, use hand or small power tools designed for sawing or grinding, not hammering and chopping. Cut holes and slots as small as possible, neatly to size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.
 - 2. To avoid marring existing finished surfaces, cut or drill from the exposed or finished side into concealed surfaces.
 - 3. Cut through concrete and masonry using a cutting machine, such as a carborundum saw or a diamond-core drill. Saw cut reinforcing bars and paint ends with bituminous paint except where bonded into new concrete.

When cutting concrete paving, cut and remove to nearest existing joint line.

4. Woodwork: Cut and or remove to a panel or joint line.
 5. Sheet Metal: Remove back to joint, lap, or connection. Secure loose or unfastened ends or edges and seal watertight.
 6. Glass: Remove cracked, broken, or damaged glass and clean rebates and stops of setting materials.
 7. Plaster: Cut back to sound plaster on straight lines, and back bevel edges of remaining plaster. Trim existing lath and prepare for new lath.
 8. Gypsum Wallboard: Cut back on straight lines to undamaged surfaces with at least two opposite cut edges centered on supports.
 9. Acoustical ceilings: Remove hanger wires and related appurtenances where ceilings are not scheduled to be installed.
 10. Tile: Cut back to sound tile and backing on joint lines.
 11. Flooring: Completely remove flooring and clean backing of prior adhesive. Carefully remove wood flooring for patching and repairing of existing wood flooring scheduled to remain.
- C. Patching: Patch with durable seams that are as invisible as possible. Comply with required tolerances.
1. Where feasible, inspect and test patched areas to demonstrate integrity of the installation. Verify conditions of existing substrates prior to executing Work.
 2. Restore exposed finishes of patched areas and extend finish restoration into retaining adjoining construction in a manner that will eliminate all evidence of patching and refinishing.
 3. Concrete: Maintain cut edges in a moist condition for twenty four hours prior to the placement of new concrete. In lieu of this an epoxy adhesive may be provided. Finish placed concrete to match existing unless noted otherwise. Concrete shall have a compressive strength of 3,000 psi where installed to repair and match existing improvements, unless noted otherwise.
 4. Metal Fabrications: Items to remain exposed shall have their edges cut and ground smooth and rounded.

5. Sheet Metal: Replace removed or damaged sheet metal items for new Work.
6. Glass: Install matching glass and re-seal exterior window assemblies.
7. Lath and Plaster: Install new lath materials to match existing and fasten to supports at 6-inch centers. Provide a 6-inch lap where new lath to adjoins existing lath. Fasten new lath as required for new Work. Restore paper backings as required. Apply a bonding agent on cut edges of existing plaster. Apply three coat plaster of the type, thickness, finish, texture, and color to match existing.
8. Gypsum Wallboard: Fasten cut edges of wallboard. Install patches with at least two opposite edges centered on supports and secure at 6-inch centers. Tape and finish joints and fastener heads. Patching shall be non-apparent when painted or finished.
9. Acoustical Ceilings: Comply with the requirements for new Work specified in related sections of the Contract Documents.
10. Resilient Flooring: Completely remove flooring and prepare substrate for new material.
11. Painting: Prepare areas to be patched, patch and paint as specified under related sections of the Contract Documents.

3.04 CLEANING

- A. Clean areas and spaces where cutting and patching are performed. Completely remove paint, mortar, oils, putty, and similar items. Thoroughly clean piping, conduit, and similar features before applying paint or other finishing materials. Restore damaged coverings to their original condition.

END OF SECTION

SECTION 01 7700

CONTRACT CLOSEOUT

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section includes administrative and procedural requirements for Contract Closeout, including but not limited to, the following:
1. Inspection procedures.
 2. Project record documents submittal.
 3. Operation and maintenance manual submittal.
 4. OWNER orientation and instruction.
 5. Final cleaning.

1.02 RELATED REQUIREMENTS:

1. Section 01 3300 - Submittal Procedures.
2. Section 01 7836 - Warranties.

PART 2 – PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 SUBSTANTIAL COMPLETION

- A. Inspection Procedures: On receipt of the Request For Certificate of Substantial Completion, OWNER will authorize commencement of inspection. INSPECTOR, OWNER, CONTRACTOR and ARCHITECT will inspect the Work.
1. If after inspection of the Work, OWNER does not consider the Work substantially complete, OWNER will notify CONTRACTOR.

2. If after inspection, OWNER considers the Work substantially complete, INSPECTOR shall prepare a comprehensive Punch List of items to be corrected.
 - a. INSPECTOR may repeat inspection to assure the Work is corrected.
 - b. Results of the completed inspection will form a partial basis of the requirements for Release of Retention.

3.02 ADMINISTRATIVE CLOSEOUT

- A. Re-inspection Procedures: INSPECTOR, OWNER, CONTRACTOR and ARCHITECT may inspect the Work upon notice, including final inspection of Punch List items from earlier inspections, has been corrected, except for items whose completion is delayed under circumstances acceptable to OWNER.
 1. OWNER has the right to preclude CONTRACTOR from Punch List correction and documents submittals after the Contract Completion date; unless OWNER elects to authorize CONTRACTOR to extend Administrative Contract duration. CONTRACTOR will be assessed actual cost for the unsettled items. Withholds amounts exceeding actual costs to correct or to obtain deliverable will be released.
 2. If allowed by the OWNER, re-inspection will be repeated, but may be assessed against CONTRACTOR if OWNER is subject to additional professional service and or additional costs of inspection.

3.03 PROJECT RECORD DOCUMENT SUBMITTAL

- A. General: Do not use project record documents for construction purposes. Protect record documents from deterioration and loss. Provide access to record documents for ARCHITECT, INSPECTOR and OWNER reference during normal working hours. Project record document shall be updated on a weekly basis. Prior to submitting each application for payment, secure INSPECTOR and ARCHITECT approval of project record documents.
- B. Record Drawings: Maintain a clean, undamaged set of prints of Drawings and Shop Drawings. Mark the set to show the actual installation where the installation varies substantially from the Work as originally shown. Mark the Drawing that is most capable of showing conditions fully and accurately. Where Shop Drawings are used, record a cross-reference at the corresponding location on the Drawings. Provide detailed and accurate field dimensions for concealed elements that would be difficult to measure and record at a later date.

1. Mark record sets with red erasable pencil. Use other colors to distinguish between variations in separate categories of the Work. Date and number entries in the same format as submitted. Call attention to entry by a “cloud” around the affected areas.
 2. Mark new information important to OWNER but was not shown on Drawings or Shop Drawings.
 3. Utility location and depth below finished grade and above ceilings and attic spaces shall be fully dimensioned and indicated on record drawings. Dimensions shall be measured from building lines or permanent landmarks and shall be triangulated to those features.
 4. Note related Change Order or Construction Directive numbers where applicable. RFC submissions shall be referenced on each affected sheet, Drawing and Shop Drawing.
 5. Organize record drawing sheets into manageable sets. Bind sets with durable-paper cover sheets; print suitable titles, dates, and other identification on the cover of each set.
 6. Prior to Contract Completion of the Work, review of the project record drawings by ARCHITECT; prepare a final set of project record drawings using reproducible vellum. Submit final set of transparencies to ARCHITECT.
- D. Record Product Data: Maintain two copies of each Product Data submittal. Note related Change Orders and Construction Directives and mark-up of record drawings and Specifications.
1. Mark these documents to illustrate significant variations in actual Work performed in comparison with information submitted. Include variations in products delivered to the Project site and from the manufacturer’s installation instructions and recommendations.
 2. Provide detailed and accurate information regarding concealed products and portions of Work that cannot otherwise be readily discerned later by direct observation.
 3. Prior to Contract Completion, submit complete set of record Product Data to ARCHITECT for OWNER records.
- E. Record Samples: Immediately prior to Substantial Completion, CONTRACTOR shall meet with ARCHITECT and OWNER at the Project site to determine which Samples are to be transmitted to OWNER for record purposes. Comply with OAR instructions regarding delivery to OWNER storage area.

- F. Miscellaneous Records: Refer to other Specification sections for requirements of miscellaneous record keeping and submittals in connection with actual performance of the Work. Prior to the date of Contract Completion, complete and compile miscellaneous records and place in good order. Identify miscellaneous records properly and bind or file, ready for continued use and reference. Submit to Architect for OWNER records.

- G. Maintenance Manuals: Prior to Substantial Completion, organize operation and maintenance data into suitable two sets of manageable size. Bind properly indexed data in individual, heavy-duty, two to three-inch 3-ring, vinyl-covered binders, with pocket folders for folded sheet information. Mark appropriate identification on front and spine of each binder. Submit to ARCHITECT for OWNER records. Include the following types of information.
 - 1. Emergency instructions.
 - 2. Spare parts list.
 - 3. Copies of warranties.
 - 4. Wiring diagrams.
 - 5. Recommended “turn-around” cycles.
 - 6. Inspection procedures.
 - 7. Shop Drawings and Product Data.
 - 8. Fixture lamping schedule.

- H. Verified Reports: Construction progress of the Work shall be reported to DSA via a duly verified report as per Title 24, Part 1, Sections 4-336 and 4-343.c of the California Building Standards Commission’s, California Administrative Code.

3.04 OPERATION AND MAINTENANCE:

- A. Operation and Maintenance Instructions: Prior to Substantial Completion, arrange for each installer of equipment that requires regular operation and maintenance to meet with designated OWNER personnel to provide instruction in proper operation and maintenance. Provide instruction by manufacturer’s representatives if installers are not experienced in operation and maintenance procedures. Include a detailed review of the following items:
 - 1. Maintenance manuals.
 - 2. Spare parts and materials.

3. Tools.
 4. Lubricants.
 5. Fuels.
 6. Identification systems.
 7. Control sequences.
 8. Hazards.
 9. Cleaning.
 10. Warranties and bonds.
 11. Maintenance agreements and similar continuing commitments.
- B. As part of instruction for operating equipment, demonstrate the following procedures:
1. Start-up.
 2. Shutdown.
 3. Emergency operations.
 4. Noise and vibration adjustments.
 5. Safety procedures.
 6. Economy and efficiency adjustments.
 7. Effective energy utilization.

3.05 FINAL CLEANING

- A. General: Related sections of the Contract Documents specify general cleaning during performance of the Work. General cleaning is included in Division 01 Section "Construction Facilities and Temporary Controls".
- B. Cleaning: Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit to the condition expected in a normal, commercial building cleaning and maintenance program. Comply with manufacturer's instructions.

1. Complete the following cleaning operations before requesting inspection for a certificate of Substantial Completion.
 - a. Remove labels that are not permanent labels.
 - b. Clean transparent materials, including mirrors and glass in doors and windows. Remove glazing compounds and other substances that are noticeable vision-obscuring materials. Replace chipped or broken glass and other damaged transparent materials.
 - c. Clean exposed exterior and interior hard-surfaced finished to a dust-free condition, free of stains, films, and similar foreign substances. Restore reflective surfaces to their original condition. Leave concrete floors broom clean. Vacuum carpeted surfaces.
 - d. Wipe surfaces of mechanical and electrical equipment. Remove excess lubrication and other substances. Clean plumbing fixtures to a sanitary condition. Clean light fixtures and lamps.
 - e. Clean the Project site, including landscape development areas, of rubbish, litter, and other foreign substances. Sweep paved areas broom clean; remove stains, spills, and other foreign deposits. Rake grounds that are neither paved nor planted to a smooth, even-textured surface.

END OF SECTION

SECTION 01 7836

WARRANTIES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section includes administrative and procedural requirements for warranties, including manufacturers and installer's standard warranties on products and special product warranties.
 - 1. Refer to the General Conditions for terms of the guarantee period for the Work.

1.02 RELATED REQUIREMENTS

- A. Section 01 7700 - Contract Closeout.

PART 2 - PRODUCTS (Not applicable)

PART 3 - EXECUTION

3.01 WARRANTY REQUIREMENTS

- A. Disclaimers and Limitations: Manufacturer's disclaimers and limitations on product warranties shall not relieve CONTACTOR of the warranty of the Work incorporating such materials, products, and equipment. Manufacturer's disclaimers and limitations on warranties do not relieve suppliers, manufacturers, installers, and Subcontractors of the requirement to countersign special warranties with CONTRACTOR.
- B. Standard warranties are preprinted written warranties published by individual manufacturers for particular products and are specifically endorsed by the manufacturer to OWNER.
- C. Special warranties are written warranties required by or incorporated in the Contract Documents, either to extend time limits provided by standard warranties or to provide greater rights for OWNER.
- D. Related Damages and Losses: When correcting failed or defective warranted Work, remove and replace Work that has been damaged as a result of such failure

or which must be removed and replaced to provide access for correction of warranted Work.

- E. Reinstatement of Warranty: When Work covered by a warranty has failed and been corrected by replacement or rebuilding, reinstate the warranty by written endorsement with the reinstated warranty equal to the original warranty.
- F. Replacement Cost: Upon determination the Work covered by a warranty has failed and/or is defective, replace or rebuild the Work to an acceptable condition complying with requirements of the Contract Documents. CONTRACTOR is responsible for the cost of replacing or rebuilding defective Work regardless of whether OWNER has benefited from use of the Work through a portion of its anticipated useful service life.
- G. OWNER Recourse: Expressed warranties made to OWNER are in addition to implied warranties and shall not limit the duties, obligations, rights, and remedies otherwise available under the law. Expressed warranty periods shall not be interpreted as limitations on the time in which OWNER can enforce such other duties, obligations, rights, or remedies.
- H. Rejection of Warranties: OWNER reserves the right to reject warranties and to limit selection to products with warranties not in conflict with requirements of the Contract Documents.
- I. Where the Contract Documents require a special warranty, or similar commitment on the Work or part of the Work, OWNER reserves the right to refuse to accept the Work until CONTRACTOR presents evidence the entities required to countersign such commitments have done so.

3.02 SUBMITTALS

- A. Submit written preliminary warranties prior to Substantial Completion and final warranties prior to Contract Completion. If the certificate of Substantial Completion designates a commencement date for warranties other than the date of Substantial Completion for the Work, submit written warranties as set forth in the certificate of Substantial Completion.
 - 1. When a designated portion of the Work is partially used and/or occupied by OWNER, submit properly executed warranties to ARCHITECT within fifteen days of the Partial Use or Occupancy of the designated portion of the Work.
- B. When the Contract Documents require CONTRACTOR, or CONTRACTOR and a Subcontractor, installer, supplier or manufacturer to execute a special warranty, prepare a written document containing appropriate terms and identification, ready

for execution by the required parties. Submit a draft to OWNER, and ARCHITECT, for approval prior to final execution.

1. Refer to Divisions 02 through 49 for specific content requirements and particular requirements for submitting special warranties.
- C. Form of Submittal: Prior to Contract Completion, compile two copies of each required final warranty properly executed by CONTRACTOR, or by CONTRACTOR and Subcontractor, installer, supplier, or manufacturer. Organize the warranty documents into an orderly sequence based on the Specifications.
- D. Bind warranties and bonds in heavy-duty, commercial-quality, durable three ring, vinyl-covered loose-leaf binders, thickness as necessary to accommodate contents, and sized to receive 8½ by 11 paper.
1. Provide heavy paper dividers with celluloid covered tabs for each separate warranty. Mark the tab to identify the item or installation. Provide a typed description of the product or installation, including the name of the product, and the name, address, and telephone number of the installer.
 2. Identify each binder on the front and spine with the typed or printed title “WARRANTIES,” Project title and/or name, and name of CONTRACTOR.
 3. When warranted Work requires operation and maintenance manuals, provide additional copies of each required warranty, as necessary, for inclusion in each required manual.

END OF SECTION

SECTION 02 4116

DEMOLITION

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes: Furnishing labor, materials and equipment necessary for demolition, dismantling, cutting and alterations as indicated, specified, or required for completion of the Work. Includes items such as the following:
1. Protection of existing improvements to remain.
 2. Cleaning existing improvements to remain.
 3. Disconnecting and capping utilities.
 4. Removing debris, waste materials, and equipment.
 5. Removal of items for performance of the Work.
 6. Salvageable items to be retained by the Owner.
- B. Related Requirements:
1. Division 01 - General Requirements.
 2. Section 01 1100 - Summary of Work.
 4. Section 01 7329 - Cutting and Patching.

1.02 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating the extent of items and systems to be removed. Indicate items to be salvaged or items to be protected during demolition. Indicate locations of utility terminations and the extent of abandoned lines to be removed. Include details indicating methods and location of utility terminations.

1.03 QUALITY ASSURANCE

- A. Perform the Work of this section by workers skilled in the demolition of buildings and structures. Perform the Work of this section under direct superintendence at all times.
- B. Prior to commencement of Work, schedule a walkthrough with the OWNER, to confirm Owner property items have been removed from scheduled Work areas. Identify and mark remaining property items and schedule their removal.

- C. Coordinate demolition for the correct sequence, limits, and methods. Schedule demolition Work to create least possible inconvenience to the public and facility operations.
- D. Related Standards:
 - 1. ANSI/ASSE A10.6.
 - 2. CBC Chapter 33.
 - 3. CFC Chapters 11 and 33.
 - 4. NFPA 241

1.04 PROJECT CONDITIONS

- A. Drawings may not indicate in detail all demolition Work to be performed. Examine existing conditions to determine the full extent of required demolition.
- B. Repair damage to existing improvements or damage due to excessive demolition.
- C. Provide all measures to avoid excessive damage from inadequate or improper means and methods, improper shoring, bracing or support.
- D. If conditions are encountered that varies from those indicated, promptly notify the Architect for clarification before proceeding.

PART 2 - PRODUCTS

2.01 HANDLING OF MATERIALS

- A. Items scheduled for salvage by the OWNER shall be delivered to a location designated by the OWNER. Items shall be cleaned, packaged and labeled for storage.
- B. Items scheduled for reuse shall be stored on the Project site and protected from damage, theft and other deleterious conditions.

PART 3 - EXECUTION

3.01 GENERAL

- A. Protection:
 - 1. Do not commence demolition until safety partitions, barricades, warning signs and other forms of protection are installed. Refer to Section 01 5000 - Construction Facilities and Temporary Controls.
 - 2. Provide safeguards, including warning signs, lights and barricades, for protection of workers, occupants, and the public.

- B. If safety of existing construction appears to be endangered, take immediate measures to correct such conditions; cease operations and immediately notify the OWNER.

3.02 DEMOLITION

- A. Do not throw or drop materials. Furnish ramps or chutes as required by the Work.
- B. Remove existing construction only to extent necessary for proper installation of Work and interfacing with existing construction. Cut back finished surfaces to straight, plumb or level lines as required for a smooth transition.
- C. Where openings are cut oversize or in improper locations, replace or repair to required condition.

3.03 CUTTING EXISTING CONCRETE

- A. Cutting of existing concrete shall be performed by skilled workers familiar with the requirements and space necessary for placing concrete. Perform concrete cutting with concrete cutting wheels and hand chisels. Do not damage concrete intended to remain.
- B. Extent of cutting of structural concrete shall be as indicated on Drawings. Cutting of non-structural concrete shall be as indicated on Drawings or as reviewed by the Architect or structural engineer. Replace concrete demolished in excess of amounts indicated.
- C. Prior to cutting or coring concrete, determine locations of hidden utilities or other existing improvements and provide necessary measures to protect them from damage.

3.04 REMOVAL OF EXISTING PLUMBING AND ELECTRICAL EQUIPMENT AND SERVICES

- A. Remove existing plumbing and electrical equipment fixtures and services not indicated for reuse and not necessary for completion of the Work. Remove abandoned lines and cap unused portions of existing lines.

3.05 REMOVAL OF OTHER MATERIALS

- A. Masonry: Cut back to joint lines and remove mortar without damaging units to remain. Allow space for repairs to backing where applicable.
- B. Woodwork: Cut or remove to a joint or panel line.
- C. Roofing: Remove as required, including accessory components such as insulation and flashings. At penetrations through existing roofing, trim cut edges back to sound roofing with openings restricted to the minimum size necessary to receive Work.
- D. Sheet Metal: Remove back to joint, lap, or connection. Secure loose and unfastened ends or edges and provide a watertight condition. Re-seal as required.
- E. Glass: Remove broken or damaged glass and clean rebates and stops of glazing channels.

- F. Modular materials such as acoustical ceiling panels, resilient tile, or ceramic tile: Remove to a natural joint without leaving damaged or defective Work where joining new Work. After flooring removal, clean substrates to remove setting materials and adhesives.
- G. Gypsum Board: Remove to a panel joint line on a stud or support line.
- H. Plaster: Saw cut plaster on straight lines, leaving a minimum 2-inch width of firmly attached metal lath for installing new lath and plaster.
- I. Remove existing improvements not specifically indicated or required but necessary to perform Work. Cut to clean lines, allowing for installation of Work.

3.06 PATCHING

- A. Patch or repair materials to remain when damaged by the performance of the Work of this section. Finish material and appearance of patch and/or repair Work shall match existing.

3.07 CLEANING

- A. Clean existing materials to remain with appropriate tools and equipment.
- B. Protect existing improvements during cleaning operations.
- C. Debris shall be dampened by fog water spray prior to transporting by truck.
- D. Debris pick-up area shall be kept broom-clean and shall be washed daily with clean water.
- E. Remove waste and debris, other than items to be salvaged. Turn over salvaged items to Owner, or store and protect for reuse where required. Continuously clean up and remove items as demolition Work progresses.
- F. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 07 9200

JOINT SEALANTS

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes:
 - 1. Joint sealants.
 - 2. Preparation for application of sealants.
- B. Related Requirements:
 - 1. Division 01 - General Requirements.
 - 3. Section 07 8413 - Penetration Firestopping.
 - 4. Division 08 - Openings.
 - 5. Division 09 - Finishes.

1.02 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating sealant joint locations, with full-size sealant joint details.
- B. Product Data: Submit manufacturer's literature for each sealant material.
- C. Material Samples: Submit Samples indicating color range available for each sealant material intended for installation in exposed locations.
- D. Certifications: Submit manufacturer's certification materials comply with requirements specified.
- E. Site Samples: At locations required, provide a Sample of sealant for each typical installation, approximately 24 inches long, including joint preparation, backing, sealant and tooling. Allow backing to extend 6 inches beyond end of sealant for inspection of substrate.
- F. Test Reports: Submit manufacturer's adhesion compatibility test reports according to ASTM C794 for each substrate.

1.03 QUALITY ASSURANCE

- A. Qualifications of Installer: The Work of this section shall be installed by a firm which has been in the business of installing similar materials for at least five consecutive years; and can show evidence of satisfactory completion of five projects of similar size and scope.

Installer shall have applicators trained and approved by manufacturer for performing this Work.

1.04 DELIVERY, STORAGE AND HANDLING

- A. Store in accordance with manufacturer's recommendations. Provide a uniform ambient temperature between 60 and 80 degrees F.

1.05 WARRANTY

- A. Manufacturer: five year material warranty.
- B. Installer: two year installation/application warranty.

PART 2 - PRODUCTS

2.01 GENERAL

- A. Furnish sealants meeting following in-service requirements:
 1. Normal curing schedules are permitted.
 2. Non-staining, color fastness (resistance to color change), and durability when subjected to intense actinic (ultraviolet) radiation are required.
- B. Furnish the products of only one manufacturer unless otherwise required, sealant colors as selected to match the adjoining surfaces.

2.02 MATERIALS

- A. Sealants:
 1. Sealant 1: Acrylic latex, one-part, non-sag, mildew resistant acrylic emulsion compound complying with ASTM C834, Type S, Grade NS, formulated to be paintable.
 - a. Tremco Inc., Acrylic Latex Caulk.
 - b. Pecora Corporation, AC-20.
 - c. Equal.
 2. Sealant 2: Butyl sealant, one-part, non-sag, solvent-release-curing sealant complying with ASTM C1311, gun grade and formulated with a minimum of 75 percent solids.
 - a. Tremco Inc., Tremco Butyl Sealant.
 - b. Pecora Corp., BC-158.
 - c. Equal.

3. Sealant 3: Silicone sealant, one-part non-acid-curing silicone sealant complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Dow Corning Corp., Dow Corning 790, 791, 795.
 - b. General Electric Co., Silpruf.
 - c. Tremco, Inc., Spectrem 1.
 - d. Pecora Corp., 864.
 - e. Equal.
 4. Sealant 4: One-part mildew-resistant silicone sealant, complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Dow Corning Corp., Dow Corning 786.
 - b. General Electric Co., Sanitary 1700.
 - c. Tremco, Inc., Proglaze White.
 - d. Equal.
 5. Sealant 5: One-part non-sag urethane sealant, complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Sika Corporation, Sikaflex -221e.
 - b. Equal.
 6. Sealant 6: Multi-part pouring urethane sealant, complying with ASTM C920, Type M, Grade P, Class 25.
 - a. Sika Corporation, Sikaflex 2C NS/SL.
 - b. Equal.
 7. Sealant 7: Acoustical sealant, non-drying, non-hardening permanently flexible conforming to ASTM D217.
 - a. Pecora Corp., BA-98 Acoustical Sealant.
 - b. Equal.
- B. See 07 8413 - Penetration Firestopping for rated sealants.
- C. Joint Backing: ASTM D1056; round, closed cell Polyethylene Foam Rod; oversized 30 to 50 percent larger than joint width, reticulated polyolefin foam.
- D. Primer: Non-Staining Type. Provide primer as required and shall be product of manufacturer of installed sealant.

- E. Bond Breaker: Pressure sensitive tape recommended by sealant manufacturer.
- F. Sealants shall have normal curing schedules, shall be nonstaining, color fast and shall resist deterioration due to ultraviolet radiation.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that joint openings are ready to receive Work and field tolerances are within the guidelines recommended by sealant manufacturer.

3.02 SURFACE PREPARATION

- A. Joints and spaces to be sealed shall be completely cleaned of all dirt, dust, mortar, oil, and other foreign materials which might adversely affect sealing Work. Where necessary, degrease with a solvent or commercial degreasing agent. Surfaces shall be thoroughly dry before application of sealants.
- B. If recommended by manufacturer, remove paint and other protective coatings from surfaces to be sealed before priming and installation of sealants.
- C. Preparation of surfaces to receive sealant shall conform to the sealant manufacturer's specifications. Provide air pressure or other methods to achieve required results. Provide masking tape to keep sealants off surfaces that will be exposed in finished Work.
- D. Etch concrete or masonry surfaces to remove excess alkalinity, unless sealant manufacturer's printed instructions indicate that alkalinity does not interfere with sealant bond and performance. Etch with 5 percent solution of muriatic acid; neutralize with dilute ammonia solution, rinse thoroughly with water and allow to dry before sealant installation.
- E. Perform preparation in accordance with ASTM C804 for solvent release sealants, and ASTM C962 for elastomeric sealants.
- F. Protect elements surrounding Work of this section from damage or disfiguration.

3.03 SEALANT APPLICATION SCHEDULE

| | <u>Location</u> | <u>Type</u> | <u>Color</u> |
|----|--|----------------|----------------------------|
| A. | Exterior and Interior joints in horizontal surfaces of concrete; between metal and concrete masonry and mortar. | Sealant 6 | To match adjacent material |
| B. | Exterior door, entrance and window frames. Exterior and interior vertical joints in concrete and masonry metal flashing. | Sealant 3 or 5 | To match adjacent material |

| | | | |
|----|--|-----------|----------------------------|
| C. | Joints within glazed curtain wall system. Skylight framing system. Aluminum entrance system glass and glazing. | Sealant 3 | Translucent or Black |
| D. | Interior joints in ceramic tile and at plumbing fixtures. | Sealant 4 | Translucent or White |
| E. | Under thresholds. | Sealant 2 | Black |
| F. | All interior joints not otherwise scheduled | Sealant 1 | To Match Adjacent Surfaces |
| G. | Heads and sills, perimeters of frames and other openings in insulated partitions | Sealant 7 | Match Adjacent Surfaces |

3.04 APPLICATION

- A. Provide sealant around all openings in exterior walls, and any other locations indicated or required for structure weatherproofing and/or waterproofing.
- B. Sealants shall be installed by experienced mechanics using specified materials and proper tools. Preparatory Work (cleaning, etc.) and installation of sealant shall be as specified and in accordance with manufacturer's printed instructions and recommendations.
- C. Concrete, masonry, and other porous surfaces, and any other surfaces if recommended by manufacturer, shall be primed before installing sealants. Primer shall be installed with a brush that will reach all parts of joints to be filled with sealant.
- D. Sealants shall be stored and installed at temperatures as recommended by manufacturer. Sealants shall not be installed when they become too jelled to be discharged in a continuous flow from gun. Modification of sealants by addition of liquids, solvents, or powders is not permitted.
- E. Sealants shall be installed with guns furnished with proper size nozzles. Sufficient pressure shall be furnished to fill all voids and joints solid. In sealing around openings, include entire perimeter of each opening, unless indicated or specified otherwise. Where gun installation is impracticable, suitable hand tools shall be provided.
- F. Sealed joints shall be neatly pointed on flush surfaces with beading tool, and internal corners with a special tool. Excess material shall be cleanly removed. Sealant, where exposed, shall be free of wrinkles and uniformly smooth. Sealing shall be complete before final coats of paint are installed.

- G. Comply with sealant manufacturer's printed instructions except where more stringent requirements are indicated on Drawings or specified.
- H. Partially fill joints with joint backing material, furnishing only compatible materials, until joint depth does not exceed 1/2 inch joint width. Minimum joint width for metal to metal joints shall be 1/4 inch. Joint depth, shall be not less than 1/4 inch and not greater than 1/2 inch.
- I. Install sealant under sufficient pressure to completely fill voids. Finish exposed joints smooth, flush with surfaces or recessed as indicated. Install non-tracking sealant to concrete expansion joints subject to foot or vehicular traffic.
- J. Where joint depth prevents installation of standard bond breaker backing rod, furnish non-adhering tape covering to prevent bonding of sealant to back of joint. Under no circumstances shall sealant depth exceed 1/2 inch maximum, unless specifically indicated on Drawings.
- K. Prime porous surfaces after cleaning. Pack joints deeper than 3/4 inch with joint backing to within 3/4 inch of surface. Completely fill joints and spaces with gun applied compound, forming a neat, smooth bead.

3.05 MISCELLANEOUS WORK

- A. Sealing shall be provided wherever required to prevent light leakage as well as moisture leakage. Refer to Drawings for condition and related parts of Work.
- B. Install sealants to depths as indicated or, if not indicated, as recommended by sealant manufacturer but within following general limitations:
 - 1. For joints in concrete walks, slab and paving subject to traffic, fill joints to a depth equal to 75 percent of joint width, but not more than 3/4 inch deep or less than 3/8 inch deep, depending on joint width.
 - 2. For building joints, fill joints to a depth equal to 50 percent of joint width, but not more than 1/2 inch deep or less than 1/4 inch deep.

3.06 CLEANING

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

3.07 CURING

- A. Sealants shall cure in accordance with manufacturer's printed recommendations. Do not disturb seal until completely cured.

3.08 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 08 42 29.23
SLIDING AUTOMATIC ENTRANCES

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Exterior single slide sliding automatic entrances.
- B. Exterior 3-panel telescoping sliding automatic entrances.
- C. Where scheduled, provide integral transoms.
- D. Access control locking shall be on entrances as scheduled.

1.2 RELATED REQUIREMENTS

- A. Section 07 90 00 - Joint Protection: Caulking to the extent not specified in this section.
- B. Section 08 80 00 – Glazing: Materials and installation requirements of glazing for automatic entrances.

1.3 DEFINITIONS

- A. Activation Device: Device that, when actuated, sends an electrical signal to the door operator to open the door.
- B. Safety Device: Device that prevents a door from opening or closing, as appropriate.
- C. Knowing act: Consciously initiating the opening of power operated door using acceptable methods including wall mounted switches such as push plates and controlled access devices such as keypads, card readers and key switches.

1.4 REFERENCE STANDARDS

- A. General: Standards listed by reference, including revisions by issuing authority, form part of this specification section to extent indicated. Standards listed are identified by issuing authority, authority abbreviation, designation number, title or other designation established by issuing authority. Standards subsequently referenced herein are referred to by issuing authority abbreviation and standard designation.
- B. American Architectural Manufacturers Association (AAMA):
 - 1. AAMA 606.1 – Integral Color Anodic Finishes for Architectural Aluminum.
 - 2. AAMA 611 Voluntary Specification for Anodized Architectural Aluminum.
 - 3. AAMA 701 Voluntary Specification for Pile Weatherstripping and Replaceable Fenestration Weatherseals.

- C. American Association of Automatic Door Manufacturers (AAADM).
 - D. American National Standards Institute (ANSI) / Builders' Hardware Manufacturers Association (BHMA):
 - 1. ANSI/BHMA A156.10: Standard for Power Operated Pedestrian Doors.
 - 2. ANSI/BHMA A156.5: Standard for Auxiliary Locks and Associated Products.
 - E. American Society for Testing and Materials (ASTM):
 - 1. ASTM B221 - Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
 - 2. ASTM B209 - Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate.
 - F. California Department of Forestry and Fire Protection, Office of the State Fire Marshall (CSFM).
 - G. International Code Council (ICC):
 - 1. IBC: International Building Code
 - H. International Organization for Standardization (ISO):
 - 1. ISO 9001 - Quality Management Systems.
 - 2. ISO 14025 – Environmental Labels and Declarations -- Type III Environmental Declarations -- Principles and Procedures.
 - 3. ISO14040 – Environmental Management -- Life Cycle Assessment -- Principles and Framework.
 - 4. ISO 14044 – Environmental Management -- Life Cycle Assessment -- Requirements and Guidelines.
 - 5. ISO 21930 – Sustainability in Buildings and Civil Engineering Works -- Core Rules For Environmental Product Declarations Of Construction Products And Services.
 - I. National Fire Protection Association (NFPA):
 - 1. NFPA 101 – Life Safety Code.
 - 2. NFPA 70 – National Electric Code.
 - J. National Association of Architectural Metal Manufacturers (NAAMM):
 - 1. Metal Finishes Manual for Architectural and Metal Products.
 - K. Underwriters Laboratories (UL):
 - 1. UL 325 – Standard for Door, Drapery, Gate, Louver, and Window Operators and Systems.
 - L. United Nations Central Product Classification (UNCPC):
 - 1. UNCPC 4212 - Product Category Rules for Preparing an Environmental Product Declaration for Power-Operated Pedestrian Doors and Revolving Doors.
- 1.5 COORDINATION
- A. Templates: Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing automatic entrances to comply with indicated requirements.

- B. Electrical System Roughing-in: Coordinate layout and installation of automatic entrance door assemblies with connections to power supplies and remote activation devices, and security access control system. See Division 28 00 00 - Electronic Safety and Security for systems not provided under this section.
- C. System Integration: Integrate sliding automatic entrances with other systems as required for a complete working installation.
 - 1. Provide electrical interface control capability for activation of sliding automatic entrances by security access system on doors with electric locking.
 - 2. Provide electrical interface to allow automatic entrance controls, mode of operation, to be changed by Owner's access control system. Provide supplemental relays required to control mode of operation.

1.6 SUBMITTALS

- A. General: Submit the following in accordance with Conditions of the Contract and Section 01 30 00 – Administrative Requirements, submittal procedures.
- B. Action Submittals:
 - 1. Shop Drawings: Include plans, elevations, sections, details, hardware mounting heights, and attachments to other work.
 - 2. Color Samples for selection of factory-applied color finishes.
- C. Information Submittals:
 - 1. Evaluation Service Reports: Based on evaluation performed by a qualified agency, for automatic entrance door assemblies.
 - a. Environmental Product Declaration.
 - b. Evaluation Report for compliance with IBC.
- D. Closeout Submittals:
 - 1. Owner's Manual.
 - 2. Warranties.

1.7 QUALITY ASSURANCE

- A. Source Limitations: Obtain automatic entrance door assemblies through one source from a single manufacturer.
- B. Qualifications:
 - 1. Installer Qualifications: Manufacturer's authorized representative, with certificate issued by AAADM, who is trained for installation and maintenance of units required for this Project.
 - 2. Manufacturer Qualifications: Qualified manufacturer with a manufacturing facility compliant with ISO 9001.
 - a. Manufacturer shall have in place a national service dispatch center providing 24 hours per day, 7 days per week, emergency call back service.
- C. Certifications:
 - 1. Automatic sliding door systems shall be certified by manufacturer to meet performance design criteria in accordance with following standards:

- a. ANSI/BHMA A156.10.
 - b. CSFM, Listed.
 - c. IBC.
 - d. NFPA 101.
 - e. UL 325 listed.
2. Environmental Product Declaration (EPD): EPD for automatic sliding entrances shall be certified by the manufacturer to comply with the following:
- a. Prepared under Product Category Rule (PCR) UNCPC 4212.
 - b. Conform to ISO standards 14025, 14040, 14044, 21930.
 - c. Life Cycle Assessment Basis: Cradle to Gate, minimum.

1.8 FIELD CONDITIONS

- A. Field Measurements: General Contractor shall verify openings to receive automatic entrance door assemblies by field measurements before fabrication and indicate measurements on Shop Drawings.
- B. Mounting Surfaces: General Contractor shall verify all surfaces to be plumb, straight and secure; substrates to be of proper dimension and material.
- C. Other trades: General Contractor shall advise of any inadequate conditions or equipment.

1.9 WARRANTY

- A. Automatic Entrances shall be free of defects in material and workmanship for period of one (1) year from the date of substantial completion.
- B. During warranty period Owner shall engage a factory-trained technician to perform service and affect repairs. Safety inspection shall be performed after each adjustment or repair and completed inspection form shall be submitted to the Owner.
- C. During the warranty period all warranty work, including but not limited to emergency service, shall be performed during normal working hours.

PART 2 - PRODUCTS

2.1 AUTOMATIC ENTRANCES

- A. Manufacturer: Stanley Access Technologies (www.stanleyaccess.com)
 - 1. Dura-Glide™ 3000 Series sliding automatic entrances.
 - 2. Dura-Glide™ 5300 Series telescopic sliding automatic entrances.
 - 3. Contact: Stanley Access Technologies, Attn: Jorge Sicairos; Phone: 951-334-7786, Email: jorge.sicairos@allegion.com.
- B. Substitutions: Refer to Section 01 25 00 – Substitution Procedures.
- C. Product Options: Drawings indicate sizes, profiles, and dimensional requirements of automatic entrance door assemblies and are based on the specific system indicated. Refer to Section 01 60 00 – Product Requirements: Product Options.

2.2 AUTOMATIC ENTRANCE DOOR ASSEMBLIES

- A. General: Provide manufacturer's standard automatic entrance door assemblies including doors, sidelights, framing, headers, carrier assemblies, roller tracks, door operators, activation and safety devices, and accessories required for a complete installation.
- B. Sliding Automatic Entrances:
 - 1. Single Slide Entrances:
 - a. Configuration: One sliding leaf and one full sidelight; single slide.
Traffic Pattern: Two-way.
 - b. Emergency Breakaway Capability: Sliding leaf and sidelight.
 - c. Mounting: Between jambs
 - d. Entrances: MA101 and MA102.
 - 2. Bi-Parting Entrances:
 - a. Configuration: Two sliding leaves and two full sidelights; biparting.
 - b. Traffic Pattern: Two-way.
 - c. Emergency Breakaway Capability: Sliding leaves and sidelights.
 - d. Mounting: Between jambs.
 - e. Entrances: GM101 and GM102
 - 3. 3-Panel Telescoping
 - a. Configuration: Two sliding leaves and one full sidelight; telescoping.
 - b. Traffic Pattern: Two-way.
 - c. Emergency Breakaway Capability: Sliding leaves and sidelights.
 - d. Mounting: Between jambs.
 - e. Entrances: LCM101 & LCM201

2.3 DESIGN / PERFORMANCE CRITERIA

- A. General: Provide automatic entrance door assemblies capable of withstanding loads and thermal movements based on testing manufacturer's standard units in assemblies similar to those indicated for this Project.
- B. Operating Range: Minus 30 deg F (Minus 34 deg C) to 130 deg F (54 deg C).
- C. Opening-Force Requirements for Egress Doors: Force shall be adjustable; but, not more than 50 lbf (222 N) required to manually set swinging egress door panel(s) in motion.
- D. Closing-Force Requirements: Not more than 30 lbf (133 N) required to prevent door from closing.
- E. Sliding automatic entrances specified with access control locking shall be designed to function as follows when set for secure operation:
 - 1. Entrances shall be normally closed and locked by access control locking system with exterior motion activation system disabled. Interior motion activation system to remain enabled, free egress.
 - 2. Upon signal from exterior secure activation device, sliding automatic entrances will unlock and open enabling motion activation system. Entrance will be held open as long as object or pedestrian remains in activation or safety zones.
 - 3. Once all activation and safety zones have cleared entrance will close and re-lock, returning to normal state.

4. At any time during cycle emergency egress can be achieved by utilizing emergency breakaway feature.

2.4 REGULATORY REQUIRMENTS

- A. Emergency-Exit Door Requirements: Comply with requirements of authorities having jurisdiction for automatic entrances serving as a required means of egress.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

2.5 MATERIALS

- A. Aluminum: Alloy and temper recommended by manufacturer for type of use and finish indicated.
 1. Headers, stiles, rails, and frames: 6063-T6.
 2. Extruded Bars, Rods, Profiles, and Tubes: ASTM B 221.
 3. Sheet and Plate: ASTM B 209.
- B. Sealants and Joint Fillers: Performed under Section 07 90 00 - Joint Protection.

2.6 COMPONENTS

- A. Framing and Transom (where scheduled) Members: Manufacturer's standard extruded aluminum reinforced as required to support imposed loads.
 1. Nominal Size:
 - a. Biparting and Single Slide Entrances: 1 3/4 inch by 4 1/2 inch (44 by 115 mm).
 - b. Telescoping, 3-panel Entrances: 1 3/4 inch by 6 inch (44 by 152 mm).
 2. Concealed Fastening: Framing shall incorporate a concealed fastening pocket, and continuous flush insert cover, extending full length of each framing member.
 3. Transoms shall be integral to sliding automatic entrance framing system and shall be flush glazed.
 - a. Provide integral transom at Entrances: GM101, GM102, LM101 and LM201
- B. Stile and Rail Doors and Sidelights: Manufacturer's standard 1 3/4 inch (45 mm) thick glazed doors with extruded-aluminum tubular stile and rail members. Incorporate concealed tie-rods that span full length of top and bottom rails.
 1. Glazing Stops and Gaskets: Snap-on, extruded-security aluminum stops and preformed gaskets.
 2. Stile Design: Narrow stile; 2 inch (51 mm) nominal width.
 3. Bottom Rail Design: Minimum 10 inch (254 mm) 12 inch (305 mm) nominal height.
 4. Muntin Bars: Horizontal tubular rail member for each door; 2 inch (51 mm) nominal height.
- C. Glazing: Furnished under Section 08 80 00 - Glazing. All Glazing furnished under separate section shall be:
 1. Entrances GM101 and GM102: 1/4 inch (6 mm) tempered.
 2. Entrances MA101 and MA102: 1 inch (25 mm) insulated glazing units with not less than 1/2-inch (13 mm) air space.

3. LM101 and LM201: 5/8-inch (16 mm) insulated glazing units with not less than 1/4-inch (6 mm) air space.
- D. Headers: Fabricated from extruded aluminum and extending full width of automatic entrance door units to conceal door operators, carrier assemblies, and roller tracks. Provide hinged or removable access panels for service and adjustment of door operators and controls. Secure panels to prevent unauthorized access.
 1. Mounting: Concealed, with one side of header flush with framing.
 2. Capacity:
 - a. Entrances GM101, GM102, MA101 and MA102: Capable of supporting up to 220 lb. (100 kg) per panel, up to four panels, over spans up to 14 feet (4.3 m) without intermediate supports.
 - b. Entrances LM101 and LM201: Capable of supporting up to 150 lb. (68 kg) per panel, up to three panels, over spans up to 12 feet (3.7 m) without intermediate supports.
 - E. Carrier Assemblies and Overhead Roller Tracks: Manufacturer's standard carrier assembly that allows vertical adjustment of at least 1/8 inch (3 mm); consisting of urethane with precision steel lubricated ball-bearing wheels, operating on a continuous roller track. Support panels from carrier assembly with load wheels and factory adjusted cantilever and pivot assembly and integrated anti-riser mechanism. Minimum two ball-bearing load wheels for each active leaf. Minimum load wheel diameter shall be 1 3/8 inch (35 mm).
 - F. Thresholds: Manufacturer's standard thresholds as indicated below:
 1. Continuous standard tapered extrusion double bevel.
 2. All thresholds to conform to details and requirements for code compliance.
 - G. Fasteners and Accessories: Manufacturer's standard corrosion-resistant, non-staining, non-bleeding fasteners and accessories compatible with adjacent materials.
 - H. Signage: Provide signage in accordance with ANSI/BHMA A156.10.

2.7 DOOR OPERATORS

- A. General: Provide door operators of size recommended by manufacturer for door size, weight, and movement; for condition of exposure; and for long-term, operation under normal traffic load for type of occupancy indicated.
- B. Electromechanical Operators: Self-contained overhead unit powered by minimum of 1/4 horsepower, permanent-magnet DC motor with gear reduction drive, microprocessor controller; and encoder.
 1. Operation: Power opening and power closing.
 2. Features:
 - a. Adjustable opening and closing speeds.
 - b. Adjustable open check and close check speeds.
 - c. Adjustable hold-open time between 0 and 30 seconds.
 - d. Obstruction recycle.
 - e. On/Off switch to control electric power to operator.
 - f. Energy conservation switch that reduces door-opening width.
 - g. Closed loop speed control with active braking and acceleration.

- h. Adjustable obstruction recycle time delay.
 - i. Self-adjusting stop position.
 - j. Self-adjusting closing compression force.
 - k. Onboard sensor power supply.
 - l. Onboard sensor monitoring.
 - m. Optional Switch to open/Switch to close operation.
 - n. Fire alarm interface, configurable to safely open or close the entrance on signal from fire alarm system.
- 3. Mounting: Concealed.
 - 4. Drive System: Synchronous belt type.

C. Electrical service to door operators shall be provided under Division 26 00 00 - Electrical. Minimum service to be 120 VAC, 5 amps.

2.8 ELECTRICAL CONTROLS

- A. Electrical Control System: Electrical control system shall include microprocessor controller and high-resolution position encoder. Encoder shall monitor revolutions of the operator shaft and send signals to microprocessor controller to define door position and speed.
 - 1. High-resolution encoder shall have resolution of not less than 1024 counts per revolution. Systems utilizing external magnets and magnetic switches are not acceptable.
 - 2. Electrical control system shall include a 24 VDC auxiliary output rated at 1 amp.
- B. Performance Data: Microprocessor shall collect, and store performance data as follows:
 - 1. Counter: Non-resettable counter to track operating cycles.
 - 2. Event Reporting: Unit shall include non-volatile event and error recording including number of occurrences of events and errors, and cycle count of most recent events and errors.
 - 3. LED Display: Display presenting current operating state of controller.
- C. Controller Protection: Microprocessor controller shall incorporate following features to ensure trouble free operation:
 - 1. Automatic Reset Upon Power Up.
 - 2. Main Fuse Protection.
 - 3. Electronic Surge Protection.
 - 4. Internal Power Supply Protection.
 - 5. Resettable sensor supply fuse protection.
 - 6. Motor Protection, over-current protection.
- D. Soft Start/Stop: "Soft-start" "soft-stop" motor driving circuit shall be provided for smooth normal opening and recycling.
- E. Obstruction Recycle: Provide system to recycle sliding panels when obstruction is encountered during closing cycle. If obstruction is detected, system shall search for that object on next closing cycle by reducing door closing speed prior to previously encountered obstruction location and will continue to close in check speed until doors are fully closed, at which time doors will reset to normal speed. If obstruction is encountered again, door will come to full stop. Doors shall remain stopped until obstruction is removed and operate signal is given, resetting door to normal operation.

- F. Programmable Controller: Microprocessor controller shall be field programmable.
 - 1. Following parameters may be adjusted:
 - a. Operating speeds and forces as required to meet specified ANSI/BHMA standard.
 - b. Adjustable and variable features specified.
 - c. Reduced opening position.
 - d. Fail-secure control.
 - 2. Manual programming shall be available through local interface which has two-digit display with selection control including three push buttons.

2.9 ACTIVATION AND SAFETY DEVICES

- A. Primary Activation for Afterhours Access: Secure activation device provided by others as specified in Division 28 00 00 - Electronic Safety and Security.
- B. Combined Activation and Safety Sensors: Combined activation and safety sensors shall, in single housing, detect motion and presence in accordance with ANSI/BHMA A156.10. Motion shall be detected using K-band microwave technology, presence by active infrared reflection technology.
 - 1. Mounting Height: Up to 11.5 feet (3.5 m) above finish floor
 - 2. Temperature Range: Between -31°F and 131°F (-35°C to 55°C) in all environmental conditions
 - 3. Relays: Form C, 50V at 0.3A for both activation and safety. Hold time of less than 0.5 seconds.
 - 4. Detection Pattern: When detection is made in activation zone, and entrance opens, safety zone shall extend through the threshold on each side; creating X-pattern. When activation and safety zones are cleared, and entrance closes sensor will ignore X-pattern safety zones.
 - 5. Combined motion and presence sensors shall be equal to or better than X-Zone T Sensor by Optex.
 - a. Cover color: Black.
- C. Photoelectric Beams: In addition to threshold sensor include minimum of two (2) doorway holding beams. Photoelectric beams shall be pulsed infrared type, including sender receiver assemblies for recessed mounting. Beams shall be monitored by electrical controls for faults and shall fail safe.
- D. Presence Sensor Monitoring: Sliding automatic entrances control system shall include a means to verify the functionality of all active presence sensors in accordance with ANSI/BHMA A156.10. Detected fault shall cause automatic operation to cease until the fault is corrected.

2.10 HARDWARE

- A. General: Provide units in sizes and types recommended by automatic entrance door and hardware manufacturers for entrances and uses indicated.
- B. Emergency Breakaway Feature: Provide release hardware that allows panel(s) to swing out in direction of egress to full 90 degrees from any position in sliding mode. Maximum force to open panel shall be 50 lbf (222 N) according to ANSI/BHMA A156.10. Interrupt powered operation of panel operator while in breakaway mode.

1. Emergency breakaway feature shall include at least one adjustable detent device mounted in the top of each breakaway panel to control panel breakaway force.
2. Limit Arms: Limit arms shall be provided to control swing of non-sliding panels on break-out; swing shall not exceed 90 degrees. Limit arms shall be spring loaded to prevent shock and include adjustable friction damping.

C. Deadlocks: None

D. Access Control Locking System: Provide access control locking hardware on sliding automatic entrances as follows:

1. System shall include:
 - a. Fail-secure electric solenoid locking device with self-contained solid-state electronic control factory mounted inside header.
 - b. Vertical rod exit devices incorporated into the sliding door panels that prevent breakout until rod is released.
2. When set for secure operation, automatic sliding entrance(s) shall electrically latch in closed position preventing door panels from sliding manually, returning system to its locked status.
3. During power interruption:
 - a. Solenoid lock shall be engaged, preventing the doors from sliding manually.
 - b. Means of egress shall be accomplished by exit device. Exit device shall be concealed vertical rod tamper proof exit device with recessed flush mounted interior release hardware that shall prohibit manual breakout of door(s) from exterior. Flush mounted release hardware shall be concealed within the horizontal muntin bar.

E. Control Switch: Provide manufacturer's standard rotary key switch mounted on interior jamb to allow for full control of automatic entrance door. Controls to include, but are not limited to:

1. Open.
2. Closed Locked,
3. Automatic.
4. One-way.
5. Reduced.
6. Reduced One-way.

F. Keyed Power Switch: Sliding automatic entrances shall be equipped with two position "On/Off" switch to control power to door.

G. Sliding Weather Stripping: Manufacturer's standard replaceable components complying with AAMA 701; made of wool, polypropylene, or nylon woven pile with nylon-fabric or aluminum-strip backing.

H. Weather Sweeps: Manufacturer's standard adjustable nylon brush sweep mounted to underside of door bottom.

2.11 FABRICATION

A. General: Factory fabricates automatic entrance door assembly components to designs, sizes, and thickness indicated and to comply with indicated standards.

1. Form aluminum shapes before finishing.

2. Use concealed fasteners to greatest extent possible.
 - a. Where fasteners are subject to loosening or turning out from thermal and structural movements, wind loads, or vibration, use self-locking devices.
 - b. Reinforce members as required to receive fastener threads.

- B. Framing: Provide automatic entrances as prefabricated assemblies.
 1. Fabricate tubular and channel frame assemblies with manufacturer's standard mechanical or welded joints. Provide sub-frames and reinforcement as required for complete system to support required loads.
 2. Perform fabrication operations in manner that prevents damage to exposed finish surfaces.
 3. Form profiles that are sharp, straight, and free of defects or deformations.
 4. Prepare components to receive concealed fasteners and anchor and connection devices.
 5. Fabricate components with accurately fitted joints with ends coped or mitered to produce hairline joints free of burrs and distortion.

- C. Doors: Factory fabricated and assembled in profiles indicated. Reinforce as required to support imposed loads and for installing hardware.

- D. Door Operators: Factory fabricated and installed in headers, including adjusting and testing.

- E. Glazing: Fabricate framing with minimum glazing edge clearances for thickness and type of glazing indicated.

- F. Hardware: Factory install hardware to greatest extent possible; remove only as required for final finishing operation and for delivery to and installation at Project site.

2.12 ALUMINUM FINISHES

- A. General: Comply with NAAMM Metal Finishes Manual for Architectural and Metal Products for recommendations for applying and designing finishes. Finish designations prefixed by AA comply with system established by Aluminum Association for designing finishes.

- B. Class I, Color Anodic Finish: AA-M12C22A42/A44 Mechanical Finish: as fabricated; Chemical Finish: etched, medium matte; Anodic Coating: Architectural Class I, integrally colored or electrolytically deposited color coating 0.70 mils minimum complying with AAMA 611-98, and the following:
 1. Color: Dark Bronze.
 2. AAMA 606.1
 3. Applicator must be fully compliant with all applicable environmental regulations and permits, including wastewater and heavy metal discharge.

PART 3 - EXECUTION

3.1 INSPECTION

- A. Examine conditions for compliance with requirements for installation tolerances, header support, and other conditions affecting performance of automatic entrances. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. General: Do not install damaged components. Fit frame joints to produce joints free of burrs and distortion. Rigidly secure non-movement joints.
- B. Entrances: Install automatic entrances plumb and true in alignment with established lines and grades without warp or rack of framing members and doors. Anchor securely in place.
 - 1. Install surface-mounted hardware using concealed fasteners to greatest extent possible.
 - 2. Set headers, carrier assemblies, tracks, operating brackets, and guides level and true to location with anchorage for permanent support.
- C. Door Operators: Connect door operators to electrical power distribution system as specified in Division 26 00 00 – Electrical.
- D. Glazing: Performed under Section 08 80 00 – Glazing in accordance with sliding automatic entrance manufacturer’s instructions.
- E. Sealants: Comply with requirements specified in Section 07 90 00 - Joint Protection.

3.3 FIELD QUALITY CONTROL

- A. Testing Services: Factory Trained Installer shall test and inspect each automatic entrance door to determine compliance of installed systems with applicable ANSI standards.

3.4 REPAIR

- A. Repair damaged finish to match original finish.


3.5 ADJUSTING

- A. Adjust door operators, controls, and hardware for smooth and safe operation, for tight closure, and complying with requirements in ANSI/BHMA A156.10.


3.6 CLEANING

- A. Clean glass and aluminum surfaces promptly after installation. Remove excess glazing and sealant compounds, dirt, and other substances. Comply with requirements in Section 08 80 00 - Glazing, for cleaning and maintaining glass.


END OF SECTION 08 42 29.23

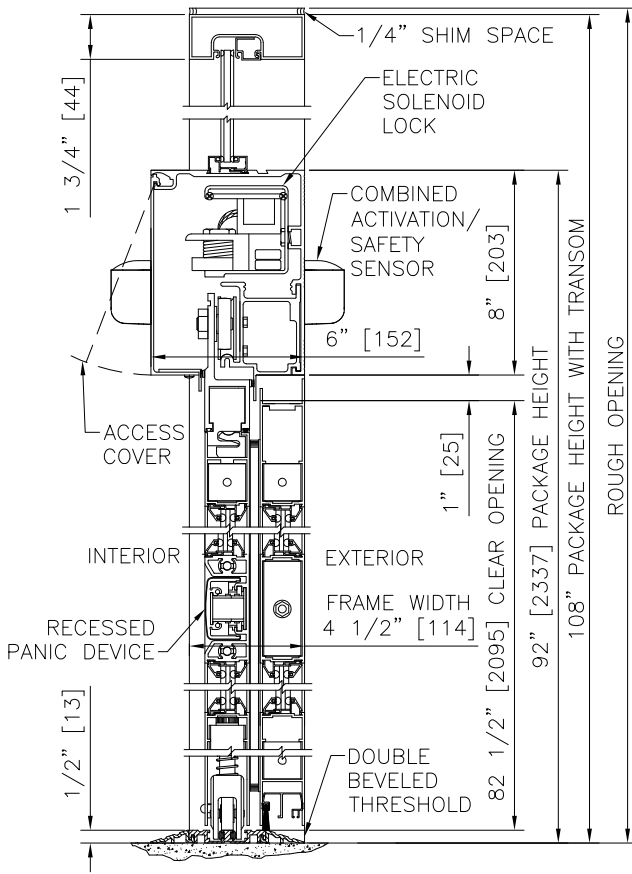

1 VERTICAL SECTION

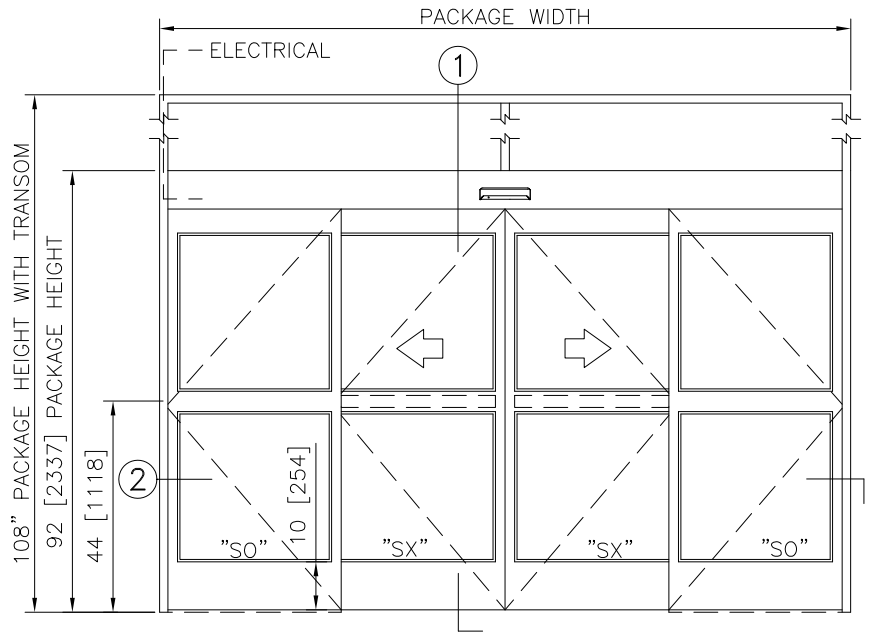


ELEVATION

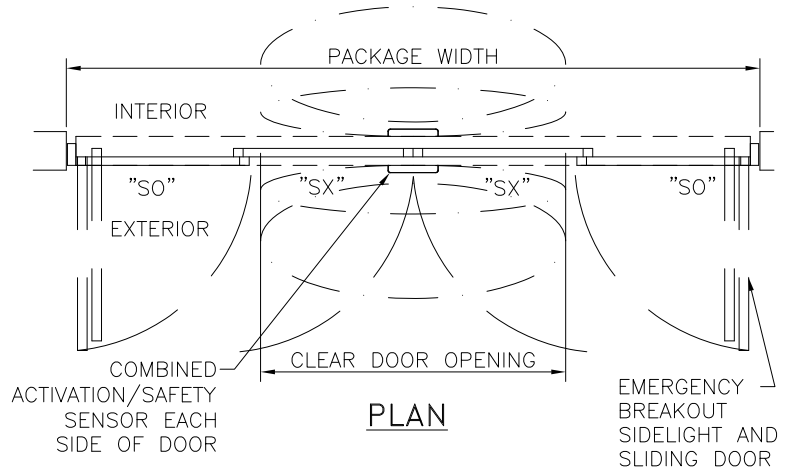

PLAN

NOTES


1. ELECTRICAL REQUIREMENTS: BY ELECTRICAL CONTRACTOR
120 VAC, 5 AMP MIN TO POWER OPERATOR
CONTROL CIRCUIT FROM SECURE ACTIVATION TO OPERATOR
2. ROUGH OPENING SHALL PROVIDE 1/4"[6] SHIM SPACE ON SIDES AND TOP OF PACKAGE.
3. LIMITS OF ACTIVATION AND SAFETY ZONES ARE FOR REFERENCE ONLY; SEE ANSI/BHMA A156.10 FOR DETAILED REQUIREMENTS.
4. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.

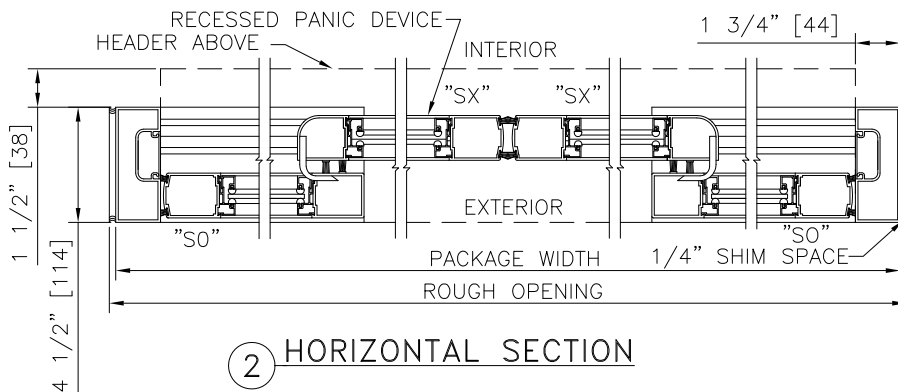


2 HORIZONTAL SECTION

PACKAGE DIMENSIONS (NARROW STILE)


| PACKAGE WIDTH | NOMINAL CLEAR DOOR OPENING | DOOR PANEL NOMINAL WIDTH | EMERGENCY BREAKOUT NOM. WIDTH |
|---------------|----------------------------|--------------------------|-------------------------------|
| 164" | 70.3" | 41.34" | 149.5" |

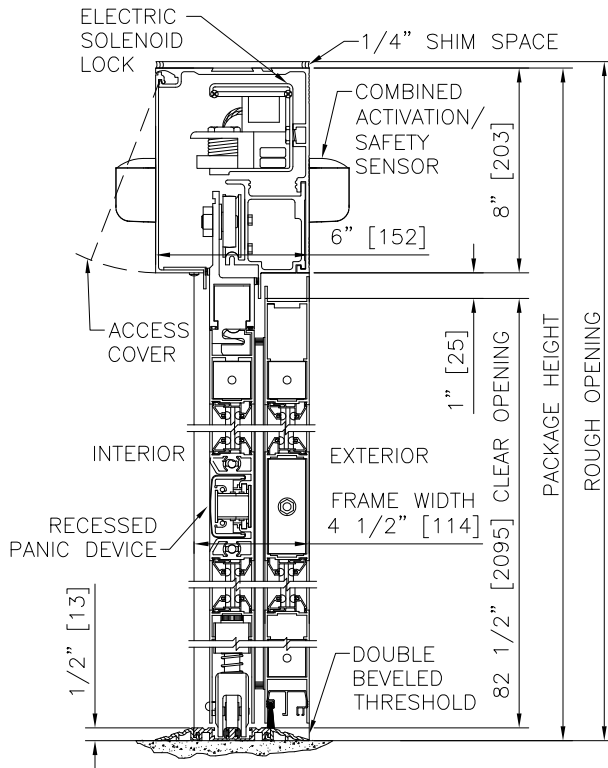

1 VERTICAL SECTION

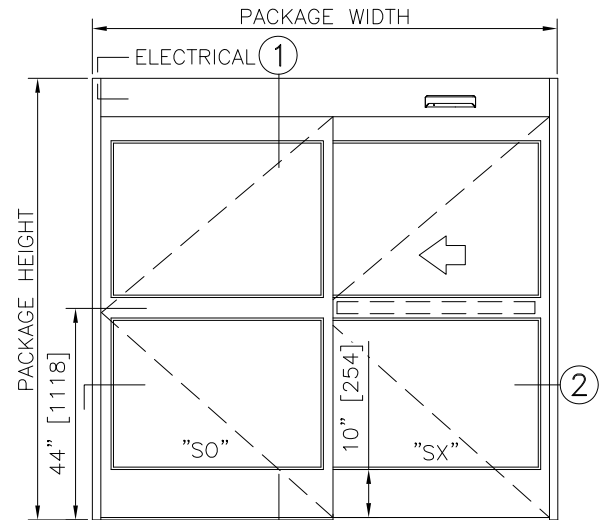


ELEVATION

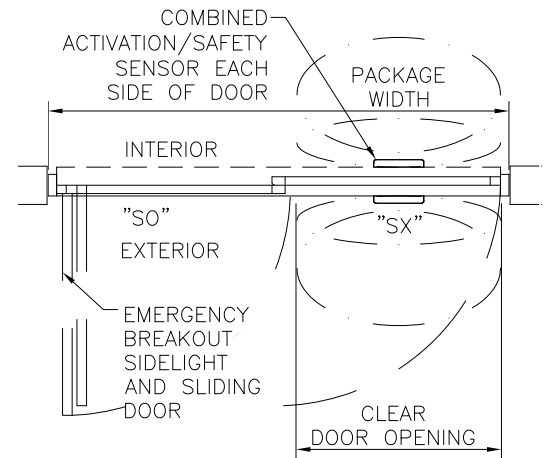

PLAN

NOTES

1. ELECTRICAL REQUIREMENTS: BY ELECTRICAL CONTRACTOR
120 VAC, 5 AMP MIN TO POWER OPERATOR
CONTROL CIRCUIT FROM SECURE ACTIVATION TO OPERATOR
2. ROUGH OPENING SHALL PROVIDE 1/4"[6] SHIM SPACE ON SIDES AND TOP OF PACKAGE.
3. LIMITS OF ACTIVATION AND SAFETY ZONES ARE FOR REFERENCE ONLY; SEE ANSI/BHMA A156.10 FOR DETAILED REQUIREMENTS.
4. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.

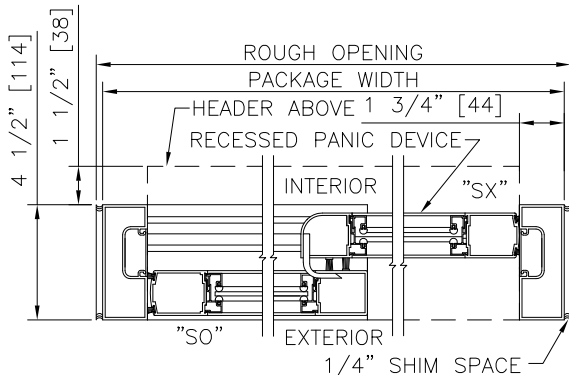

2 HORIZONTAL SECTION

| PACKAGE HEIGHT DIMENSIONS | |
|---------------------------|--------------------|
| PACKAGE HEIGHT | CLEAR DOOR OPENING |
| 90" | 80.5" |

| PACKAGE DIMENSIONS (NARROW STILE) | | | |
|-----------------------------------|----------------------------|--------------------------|-------------------------------|
| PACKAGE WIDTH | NOMINAL CLEAR DOOR OPENING | DOOR PANEL NOMINAL WIDTH | EMERGENCY BREAKOUT NOM. WIDTH |
| 84.5" | 35.53" | 41.72" | 75.50" |

**DURA-GLIDE
3000
SERIES**

SINGLE SLIDE RIGHT HAND WITH ACCESS CONTROL, RECESSED

PROJECT INFORMATION


PROJECT NAME: MOORPARK COLLEGE AUTOMATIC DOOR REPLACEMENT

LOCATION: MOORPARK, CA


DOOR NUMBER(S): MA102

DATE: 10/04/2024


SHEET: 2 OF 2

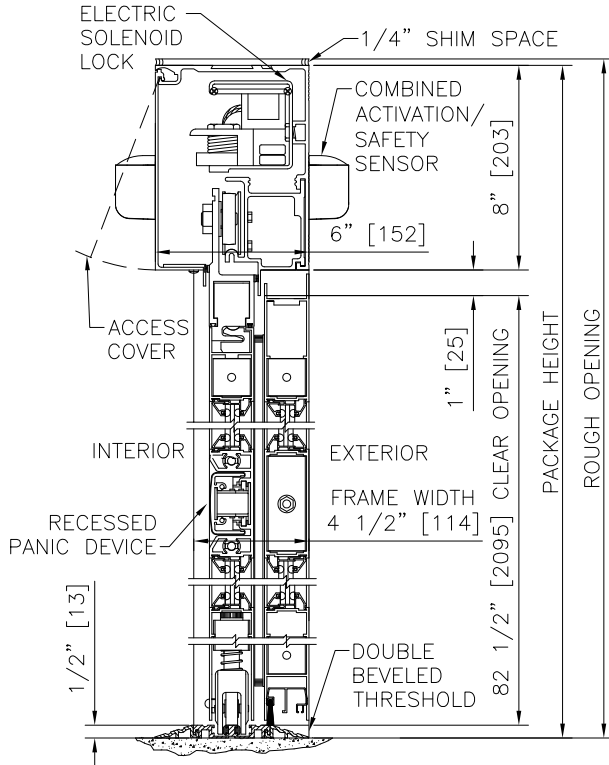

① VERTICAL SECTION

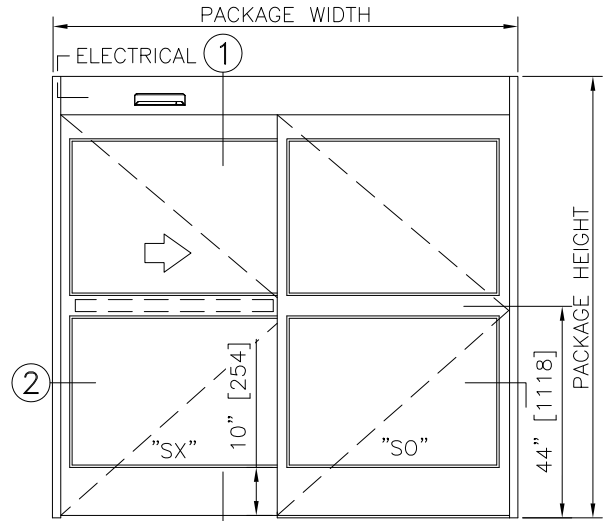


ELEVATION

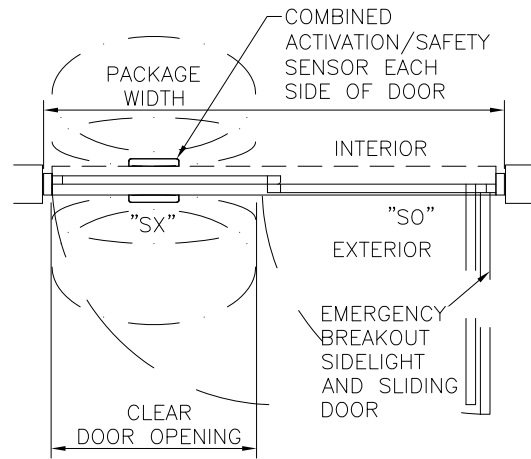

PLAN

NOTES

1. ELECTRICAL REQUIREMENTS: BY ELECTRICAL CONTRACTOR
120 VAC, 5 AMP MIN TO POWER OPERATOR
CONTROL CIRCUIT FROM SECURE ACTIVATION TO OPERATOR
2. ROUGH OPENING SHALL PROVIDE 1/4"[6] SHIM SPACE ON SIDES AND TOP OF PACKAGE.
3. LIMITS OF ACTIVATION AND SAFETY ZONES ARE FOR REFERENCE ONLY; SEE ANSI/BHMA A156.10 FOR DETAILED REQUIREMENTS.
4. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.

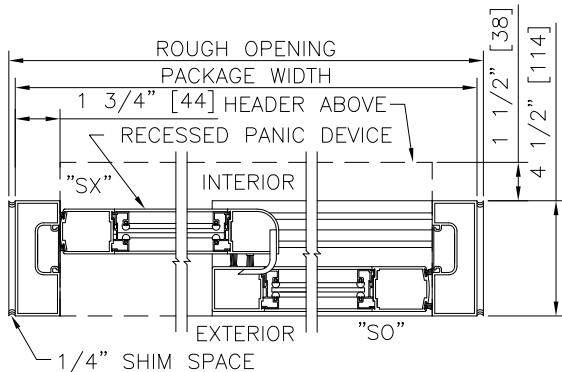

② HORIZONTAL SECTION

| PACKAGE HEIGHT DIMENSIONS | |
|---------------------------|--------------------|
| PACKAGE HEIGHT | CLEAR DOOR OPENING |
| 90.5" | 81.0" |

| PACKAGE DIMENSIONS (NARROW STILE) | | | |
|-----------------------------------|----------------------------|--------------------------|-------------------------------|
| PACKAGE WIDTH | NOMINAL CLEAR DOOR OPENING | DOOR PANEL NOMINAL WIDTH | EMERGENCY BREAKOUT NOM. WIDTH |
| 84.75" | 35.66" | 41.84" | 75.75" |

DURA-GLIDE 5300 SERIES

3-PANEL TELESCOPIC RIGHT HAND WITH TRANSOM & ACCESS CONTROL, RECESSED

PROJECT INFORMATION


PROJECT NAME: MOORPARK AUTOMATIC DOOR REPLACEMENT

LOCATION: MOORPARK, CA

DOOR NUMBER(S): LCM101 & LCM201

DATE: 10/04/024


SHEET: 1 OF 1

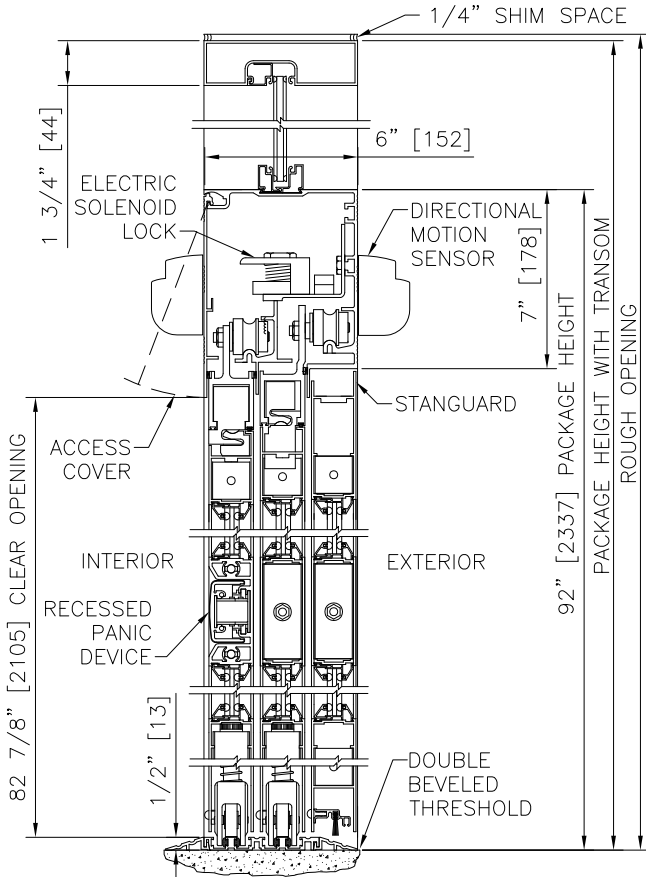


1 VERTICAL SECTION

NOTES


1. ELECTRICAL REQUIREMENTS: BY ELECTRICAL CONTRACTOR
- 120 VAC, 5 AMP MIN TO POWER OPERATOR
- CONTROL CIRCUIT FROM SECURE ACTIVATION TO OPERATOR
2. ROUGH OPENING SHALL PROVIDE 1/4"[6] SHIM SPACE ON SIDES AND TOP OF PACKAGE.
3. LIMITS OF ACTIVATION AND SAFETY ZONES ARE FOR REFERENCE ONLY; SEE ANSI/BHMA A156.10 FOR DETAILED REQUIREMENTS.
4. SEE SPECIFICATIONS FOR ADDITIONAL INFORMATION.

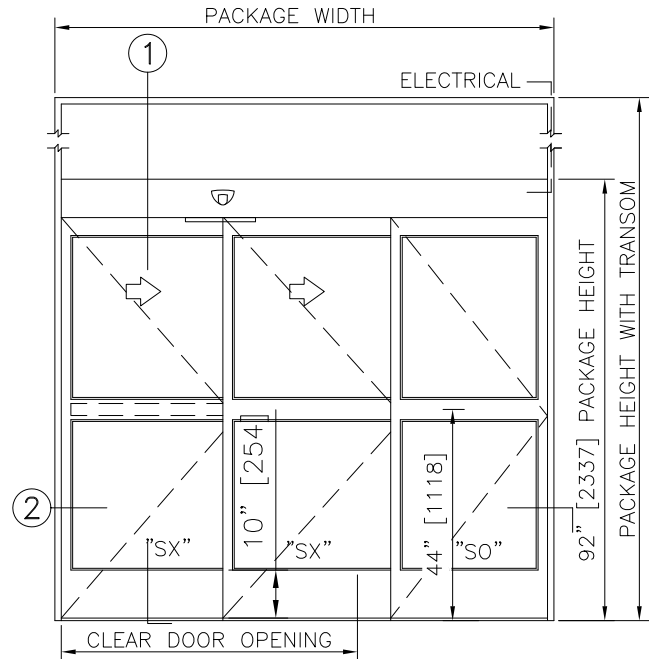

ELEVATION

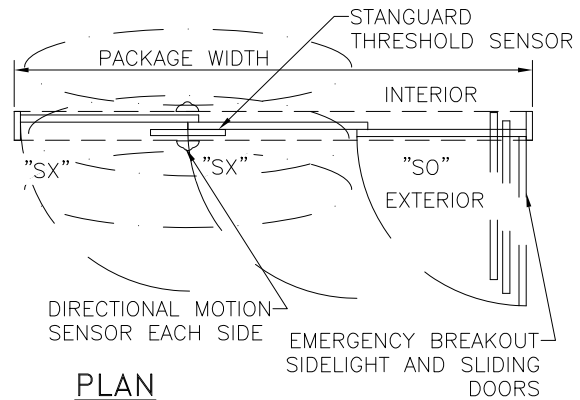

PLAN

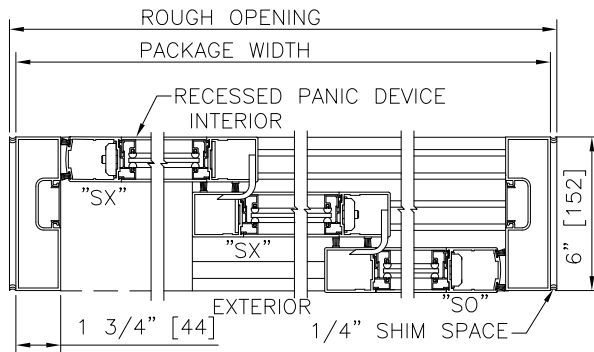

2 HORIZONTAL SECTION

| PACKAGE HEIGHT DIMENSION | |
|--------------------------|----------------|
| DOOR NO. | TRANSOM HEIGHT |
| LCM201 | 107" |
| LCM101 | 102.75" |

| PACKAGE DIMENSIONS (NARROW STILE) | | | | |
|-----------------------------------|---------------|----------------------------|----------------------------------|-------------------------------|
| DOOR NO. | PACKAGE WIDTH | NOMINAL CLEAR DOOR OPENING | SLIDING DOOR PANEL NOMINAL WIDTH | EMERGENCY BREAKOUT NOM. WIDTH |
| LCM201 | 107" | 59.90" | 36.21" / 36.08" / 36.21" | 97.75" |
| LCM101 | 102.75" | 57.06" | 36.79" / 34.67" / 34.79" | 93.5" |

SECTION 08 8000

GLAZING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Glass and glazing as indicated.

B. Related Requirements:

1. Division 01 - General Requirements.
4. Section 08 4229 – Automatic Sliding Entrances.

1.02 SUBMITTALS

A. Product Data: Submit manufacturer's descriptive literature and installation recommendations for glass, glazing, and accessories.

B. Material Samples: Submit 6-inch square units of each type of glass specified.

1.03 QUALITY ASSURANCE

A. Labeling: Label each piece of glass and glazing and mirrors with manufacturer's name, and the grade or quality of the material. Labels shall be intact before and after installation. Fire-protection-rated glazing shall bear a label or other identification in accordance to CBC 716.

B. Comply with the following as a minimum requirement:

1. ASTM C864 - Standard Specification for Dense Elastomeric Compression Seal Gaskets, Setting Blocks, and Spacers.
2. ASTM C1036 - Standard Specification for Flat Glass.
3. ASTM C1048 - Standard Specification For Heat-Treated Flat Glass —Kind HS, Kind FT Coated and Uncoated Glass.
4. CPSC 16 CFR 1201 - Safety Standards for Architectural Glazing Materials issued by the Consumer Products Safety Commission.
5. GANA - Glazing Manual.

C. Qualifications of Installer: Minimum five years experience installing glass in projects of similar scope and complexity.

1.04 DELIVERY, STORAGE AND HANDLING

- A. Deliver glass and glazing materials with manufacturer's labels intact.
- B. Do not remove labels until glass has been installed and inspected by the Project Inspector.
- C. Protect glass from staining, marking, and damage.
- D. Putty and glazing compound shall be delivered to the Project site in manufacturer's original unbroken containers labeled to identify contents.

1.05 PROJECT CONDITIONS

- A. Perform glazing when ambient temperature is above 40 degrees F.
- B. Perform glazing on clean, dry surfaces only.

1.06 WARRANTY

- A. Manufacturer shall provide a ten year material warranty.
- B. Manufacturer shall provide a twenty year material warranty for coatings and thermally or acoustically rated insulation units against deterioration in acoustic or thermal rating.
- C. Installer shall provide a three year fabrications and installation warranty.

PART 2 - PRODUCTS

2.01 ACCEPTABLE MANUFACTURERS AND FABRICATORS

- A. To maximum extent possible, provide domestically manufactured and fabricated glass, and provide glass from one manufacturer.
- B. Types of glass specified or indicated shall be manufactured or fabricated by one of the following:
 - 1. Pilkington LOF (fire rated glazing).
 - 2. PPG Glass Technology.
 - 3. Visteon Float Glass Operations.
 - 4. Viracon.
 - 5. Southwest Technologies.
 - 6. Equal.

2.02 GLASS MATERIALS

- A. General: Conform to ASTM C1036, ASTM C1048 and to ANSI Z97.1. Label factory cut panes.

- B. Float Glass: Type I, (transparent glass flat), Class 1 (clear), Quality q3, (glazing select), minimum 1/4 inch thickness unless otherwise indicated or required.
- C. Tinted Float Glass: Type I (transparent glass), Class 2 (tinted heat absorbing and light reducing), quality q3 (glazing select), manufactured by PPG or LOF, color as selected by Architect, minimum 1/4 inch thickness unless otherwise indicated or required.
- D. Tempered Glass: Condition A (uncoated surfaces), Type I or II, Class 1, Quality q3 (glazing select), Kind FT (fully tempered glass), match color of clear or tinted glass as applicable; fully thermal tempered, heat strengthening or chemical tempering is not permitted. Perform tempering by horizontal oscillating roller hearth or high speed roller hearth process. Do not permit fabrication processes leaving gripper or tong marks. Handle and size glass according to manufacturer's written instructions.

2.03 GLASS SETTING MATERIALS

- A. Glass setting materials for protected openings shall comply with CBC Chapter 7.
- B. Setting Blocks: ASTM C864, channel shape; having 1/4 inch internal depth, Shore A hardness of 80 to 90 Durometer. Blocks shall be a minimum 2 inch long. Block width shall be approximately 1/16 inch less than the full width of the rabbet. Block thickness shall be at least 3/16 inch, sized for rabbet depth as required.
- C. Spacers: ASTM C864, channel shape, with 1/4 inch internal depth, 3/32 inch flanges, eb, 1/8 inch thick, one to 3 inches long. Spacers shall provide Shore A hardness of 40 to 50 Durometer.
- D. Vinyl Glazing Channels: Profile compatible with framing system and designed to accommodate glass of specified thickness, light gray in color. Provide for dry glazing aluminum frames where indicated or permitted.
- E. Glazing Tape: Poly-isobutylene based sealant tape, conforming to AAMA 804.1, with adhesive one side protected by temporary paper cover, Extru-Seal manufactured by Pecora Corp., No. 303 by Protective Treatments, Inc., or equal.
- F. Spring Steel Spacers: Galvanized steel wire or strip designed to position glazing in channel or rabbet sash with stops.
- G. Glazing Clips: Galvanized steel spring wire designed to hold glass in position in rabbet sash without stops.
- H. Glazing Points (Sprigs): Pure zinc stock, thin, flat, triangular or diamond-shaped pieces, 1/4 inch minimum size.
- I. Glazing Sealants for Metal Sash: GE Silicones Silglaze II 2800, GE Silicones Silpruf, GE Silicones 1200 Silicone, and Dow Corning 999A. Polybutylene, oleoresinous, asphalt, and oil base sealants are not permitted. Provide sealant of same color as structural silicone sealant unless otherwise required.
- J. Glazing Compound for Wood Sash: Provide acrylic latex glazing compound for bedding and sealing glass in wood frames

- K. Glazing Compounds and Sealants for Thermoplastic: Provide silicone, butyl, or polysulfide glazing compound.
- L. Mirror Setting Materials: Manufactured by Palmer Products Corporation, or equal, for installation of mirrors, and as follows:
 - 1. Mirror backing paint: Mirro-Bac Paint, or equal, formulated to protect mirror silvering.
 - 2. Mirror bond coat: Mirro-Mastic Bond, or equal, formulated to isolate deleterious backing materials from mastic and mirror.
 - 3. Mirror mastic: Mirro-Mastic, or equal, formulated for adhering mirrors and glass to substrates.

PART 3 - EXECUTION

3.01 TOLERANCES

- A. Thickness indicated or specified are nominal within standard tolerances. Maximum size of vertical panes shall not exceed the following:

| | | | |
|-------------------------------|----------|-----------|----------|
| Float Thickness: | 1/8 inch | 3/16 inch | 1/4 inch |
| Maximum Areas in Square Feet: | 12 | 16 | 20 |

When exceeding these square foot measurements glass is to be safety glazed.

3.02 INSTALLATION, GENERAL

- A. Glazing tapes or sealants shall be installed wherever glass contacts wood or metal surfaces. Width of strips shall be as required.
- B. Glazing compound shall be neatly and cleanly installed in straight lines, even with inside edge of sash members. Thumb puttying is not permitted.
- C. Glazing Aluminum Sash: Glazing material in aluminum sash shall be installed in compound and secured in place with aluminum glazing beads. In addition, horizontal beads shall be installed with 6-inch by 1 inch, type A, self-tapping, stainless steel, Phillips-head screws, installed into pre-drilled, counter-sunk holes and spaced 2 inches from each end and 9 inches on centers.

3.03 INSTALLATION OF GLASS

- A. Conform to requirements of GANA Glazing Manual.
- B. Provide edge blocking to comply with requirements of referenced glazing standard, except where otherwise required by glass unit manufacturer.
- C. Provide compressible filler rods or equivalent back-up material to prevent sealant from extruding into glass channel weep systems, from adhering to back surface of joints and to control depth of sealant for optimum performance.

- D. Force sealants into glazing channels, in manner to eliminate voids and to ensure complete bond of sealant to glass and channel surfaces.
- E. Tool exposed surfaces of sealants to provide for drainage away from glass. Install pressurized tapes and gaskets to protrude slightly out of channel to eliminate dirt and moisture pockets.
- F. Where dry glazing of aluminum frame is indicated or permitted, provide vinyl glazing channels installed in accordance with frame manufacturers written recommendations. Do not stretch channels. Miter corners.
- G. For tape glazing, furnish tape of thickness to provide approximately 30 percent compression. Cut tape to proper length and install to permanent stops, the entire length of the head and sill first, then to jambs. Butt tape together with no overlap and remove paper backing. Install glass on setting blocks at quarter points and maintain uniform glass edge clearance around entire perimeter of glass. Maintain manufacturer's recommended edge clearance and bite on glass. Install glass firmly into tape with a slight lateral movement to assure proper adhesion. Install tape to removable stop with evenly distributed firmness, smoothing out wrinkles in tape. Secure removable stop in proper position so tape makes contact with glass as stop is installed, forcing contact with glass and completely sealing joint. Remove excess tape from both sides at slight angle over sight line. Do not undercut.
- H. Laminated Glass: Sashes, which are to receive laminated glass, shall be weeped to the outside to permit water in the channel to drain from the frame.

3.04 PROTECTION AND CLEANING

- A. Protect exterior glass from breakage by furnishing crossed streamers attached to framing and away from glass surface. Do not directly install markers to glass surfaces. Remove non-permanent labels and clean surfaces.
- B. Protect glass from contact with contaminating substances resulting from construction operations. If, despite such protection, contaminating substances do come into contact with glass, remove immediately by method recommended by glass manufacturer.
- C. Examine glass surfaces adjacent to or below exterior concrete and other masonry surfaces at frequent intervals during construction, but not less often than once a month, for build-up of dirt, scum, alkali deposits or staining. When examination reveals presence of these forms of residue, remove by method recommended by glass manufacturer. Glazing, which cannot be cleaned to a required condition, shall be deemed defective Work.
- D. Remove and replace glass, which is broken, chipped, cracked, abraded, or damaged during construction.
- E. Remove protective covering from thermoplastic not more than 4 days before Substantial Completion, and immediately before cleaning. Methods of final cleaning and finishing shall be as prescribed by thermoplastic glazing publications referenced above.
- F. Wash glass on both faces not more than four days before Substantial Completion. Wash glass by method recommended by glass manufacturer. Do not furnish harsh cleaning

111001

agents, caustics, abrasives, or acids for cleaning. Polish glass both sides and leave free of soil, streaks, and labels.

3.05 CLEAN UP

- A. Remove rubbish, debris and waste materials and legally dispose of off the Project site.

3.06 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 09 9000
PAINTING AND COATING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Interior and exterior painting.

B. Following items shall not be painted:

1. Brass valves, chromium or nickel-plated piping and fittings.
2. Boiler control panels and control systems.
3. Fabric connections to fans.
4. Flexible conduit connections to equipment, miscellaneous name plates, stamping, and instruction labels and manufacturer's data.
5. Mechanical and electrical utility lines, piping and heating and ventilation ductwork in tunnels, under-floor excavated areas or crawl spaces, attic spaces and enclosed utility spaces.
6. Flag, floodlight, parking light poles and loudspeaker poles, metal stairs, handrails and chain-link fence with a galvanized finish, unless otherwise noted.
7. Structural and miscellaneous steel, open web steel joists and metal floor decking, which will not be exposed in final construction, shall have no finish other than one coat of shop primer.
8. Hardboard covering on tops and backs of counters and benches.
9. Brass, bronze, aluminum, lead, stainless steel and chrome or nickel-plated surfaces.
10. Non-metallic walking surfaces unless specifically shown or specified to be painted.

1.02 REGULATORY REQUIREMENTS

- A. Paint materials shall comply with the Food and Drug Administration's (F.D.A.) Lead Law and the current rules and regulations of local, state and federal agencies governing the use of paint materials.

1.03 SUBMITTALS

- A. List of Materials: Before submittal of samples, submit a complete list of proposed paint materials, identifying each material by distributor's name, manufacturer's name, product name and number, including primers, thinners, and coloring agents, together with manufacturers' catalog data fully describing each material as to contents, recommended installation, and preparation methods. Identify surfaces to receive various paint materials.
- B. Material Samples: Submit manufacturer's standard colors samples for each type of paint specified. Once colors have been selected, submit Samples of each color selected for each type of paint accordingly:
 - 1. Samples of Paint and Enamel must be submitted on standard 8 ½" x 11" Leneta Opacity-Display Charts. Each display chart shall have the color in full coverage. The sample shall be prepared from the material to be installed on the Work. Identify the school on which the paint is to be installed, the batch number, the color number, the type of material, and the name of the manufacturer.
 - 2. Elastomeric shall be submitted in duplicate samples of the texture coating. Samples will be not less than 2 ½ by 3 ½ in size and installed upon backing. Finished Work will match the reviewed Sample in texture.
 - 3. Materials and color samples shall be reviewed before starting any painting.

1.04 QUALITY ASSURANCE

- A. Certification of Materials: With every delivery of paint materials, the manufacturer shall provide written certification the materials comply with the requirements of this section.
- B. Coats: The number of coats specified is the minimum number. If full coverage is not obtained with the specified number of coats, install additional coats as required to provide the required finish.
- C. Install coats and undercoats for finishes in strict accordance with the recommendations of the paint manufacturer as reviewed by the Architect.
- D. Paint materials shall comply with the following as a minimum requirement:
 - 1. Materials shall be delivered to Project site in original unbroken containers bearing manufacturer's name, brand number and batch number.
 - 2. Open and mix ingredients on premises in presence of the Project Inspector.

1.05 DELIVERY, STORAGE AND HANDLING

- A. Storage and Mixing of Materials: Store materials and mix only in spaces suitable for such purposes. Maintain spaces clean and provide necessary precautions to prevent fire. Store paint containers so the manufacturer's labels are clearly displayed.

1.06 SITE CONDITIONS

- A. Temperature: Do not install exterior paint in damp, rainy weather or until surface has thoroughly dried from effects of such weather. Do not install paint, interior, or exterior, when temperature is below 50 degrees F, or above 90 degrees F, or dust conditions are unfavorable for installation.

1.07 WARRANTY

- A. Manufacturer shall provide a three year material warranty.
 B. Installer shall provide a three year application warranty.

1.08 MAINTENANCE

- A. Provide at least one gallon of each type, color and sheen of paint coating installed. Label containers with color designation indicated on Drawings.

PART 2 - PRODUCTS

2.01 PAINT MATERIALS

- A. Furnish the products of only one paint manufacturer unless otherwise specified or required. Primers, intermediate and finish coats of each painting system must all be the products of the same manufacturer, including thinners and coloring agents, except for materials furnished with shop prime coat by other trades.
 B. Factory mix paint materials to correct color, gloss, and consistency for installation to the maximum extent feasible.
 C. Paint materials to be minimum "Architectural Grade".
 D. Gloss degree standards shall be as follows:

| | | | |
|------------|--------------|----------|----------|
| HIGH GLOSS | 70 and above | EGGSHELL | 30 to 47 |
| SEMI-GLOSS | 48 to 69 | SATIN | 15 to 29 |

2.02 MANUFACTURERS

- A. Acceptable manufacturers, unless otherwise noted:
1. Dunn-Edwards Corporation Paints
 2. Vista Paints
 3. Sherwin Williams
 4. ICI Paints
 5. Equal.
- B. Exterior steel:

1. Carboline
2. Equal.

PART 3 - EXECUTION

3.01 PREPARATION

- A. Examine surfaces to receive paint finish. Surfaces which are not properly prepared and cleaned or which are not in condition to receive the finish specified shall be corrected before prime coat is installed.
- D. Metal surfaces to be painted shall be thoroughly cleaned of rust, corrosion, oil, foreign materials, blisters, and loose paint.
- E. Do not install painting materials to wet, damp, dusty, dirty, finger marked, rough, unfinished or defective surfaces.
- F. Concrete surfaces shall be dry, cleaned of dirt and foreign materials and in proper condition to receive paint. Neutralize spots demonstrating effects of alkali.
- G. Mask off areas where necessary.

3.02 APPLICATION

- A. Backpainting: Immediately upon delivery to the Project site, finish lumber and millwork shall be backpainted on surfaces that will be concealed after installation. Items to be painted shall be backpainted with priming coat specified under "Priming".
- B. Priming: New wood and metal surfaces specified to receive paint finish shall be primed. Surfaces of miscellaneous metal and steel not embedded in concrete, and surfaces of unprimed plain sheet metal Work shall be primed immediately upon delivery to the Project site. Galvanized metal Work and interior and exterior woodwork shall be primed immediately after installation. Priming of surfaces and priming coat shall be as follows:
 1. Knots, Pitch and Sap Pockets: Shellac before priming.
 2. Exterior Woodwork and Wood Doors: Prime with one coat of exterior waterborne emulsion wood primer.
 3. Interior Woodwork: Where indicated to be painted, prime with one coat of waterborne wood primer.
 4. Stain: Woodwork indicated to receive a stain and varnish finish shall be stained to an even color with water borne stain. On open-grained hardwood, mix stain with paste filler and completely fill pores in wood.
 5. Galvanized Metal Work: Remove all soluble and insoluble contaminants and corrosion. Remove any storage stains per Section 6.2 of ASTM D6386.

Chemically treat with Krud Kutter ME or Great Lakes Laboratories Clean & Etch or Equal, in accordance with manufacturer's written instructions. Ensure that all surfaces have been effectively and uniformly treated per the manufacturer's recommendation. Follow manufacturer's instructions for drying time, and then prime with one coat of Cycloaliphatic Amine Epoxy.

6. Unprimed Iron, Steel, and Other Uncoated Metals: Where specified to be painted, prime with one coat of metal primer.
 7. Shop Primed Metal Items: Touch up bare and abraded areas with metal primer before installation of second and third coats.
 8. Coats shall be installed evenly and with full coverage. Finished surfaces shall be free of sags, runs and other imperfections.
- C. Allow at least 24 hours between coats of paint.
- D. Rollers shall not be used on wood surfaces.
- E. Each coat of painted woodwork and metal, except last coat, shall be sandpapered smooth when dry. Texture-coated gypsum board shall be sanded lightly to remove surface imperfections after first coat of paint has been installed.
- F. Each coat of paint or enamel shall be a slightly different tint as required. Each coat of paint, enamel, stain, shellac, and varnish will be inspected by the IOR before next coat is applied. Notify the Project Inspector that such Work is ready for inspection.
1. Tinting Guideline: The first coat, primer/undercoat(s) to be untinted or tinted up to 50 percent lighter or darker (at the discretion of the installer) than the finish coat. The second coat (or third coat if a seal coat and undercoat have been specified) is to be factory tinted in the range of 10 percent to 15 percent lighter or darker (at the discretion of the installer) than the finish coat. The final coat is to be factory tinted to the required color selected. These tinting guidelines shall be provided on all surfaces receiving paint.
- G. Do not "paint-out" UL labels, fusible links and identification stamps.
- H. Paint Roller, brush and spray.
1. Only Paint rollers shall be used on interior plaster, drywall, masonry/plaster and plywood surfaces, nap shall not exceed one half inch in length.
 2. First coat on wood overhang and ceilings shall have material applied by roller and then brushed out in a professional manner to leave surface free of imperfections. Finish coat may be sprayed.
 3. Other surfaces shall have all coatings applied with brushes of proper size.
 4. Spray work is permitted only on radiators, acoustic plaster, masonry and plaster.
- I. Where ceilings are specified to be painted, beams, cornices, coves, ornamental features, plaster grilles, etc. shall be included.

3.03 CLEANING

- A. Remove rubbish, waste, and surplus material and clean woodwork, hardware, floors, and other adjacent Work.
- B. Remove paint, varnish and brush marks from glazing material and, upon completion of painting Work, wash and polish glazing material both sides. Glazing material, which is damaged, shall be removed and replaced with new material.
- C. Clean hardware and other unpainted metal surfaces with recommended cleaner. Do not furnish abrasives or edged tools.

3.04 SCHEDULE

A. Interior:

- 1. Woodwork, Painted: 3 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Interior enamel, semi-gloss or gloss as indicated.
- 2. Woodwork, Stained and Varnished: 4 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second, Third and Fourth Coats: Varnish, semi-gloss.
- 3. Wood Corridor doors: 4 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second, Third, and Fourth Coats: Varnish, gloss.
- 4. Other Wood Doors: 4 coats.
 - a. Varnished or painted as indicated.
 - b. If varnished, same finish system as painted woodwork, with semi-gloss or gloss finish to match adjacent wall.
- 5. Miscellaneous Woodwork: 4 coats. Wood items including, but not limited to: stair treads and risers, handrails, rolling ladders, wood base and shoe, chair rails, counter tops and locker room benches.
 - a. First Coat: As specified in this section under Priming.
 - b. Second, Third and Fourth: Exterior varnish, gloss.
- 6. Casework: Interior surfaces of casework (except plastic laminate-faced casework) including top, edges and underside of shelving, poles, surfaces of

drawers (except fronts), interior surfaces of mailbox pigeonholes, and particle board.

- a. First Coat: Waterborne stain.
 - b. Second and Third Coats: Satin varnish.
7. Plaster: 4 coats.
 - a. First Coats: Pigmented wall sealer.
 - b. Second coat: Enamel under coater.
 - c. Third and Fourth Coats – Interior enamel, semi-gloss or gloss as indicated.
 8. Gypsum Board: 4 coats.
 - a. First Coat: Drywall sealer.
 - b. Second Coat: Enamel under coater.
 - c. Third and Fourth Coats: Interior enamel, semi-gloss or gloss as indicated.
 9. Concrete: 3 coats.
 - a. First: Concrete sealer.
 - b. Second and Third: Interior enamel, semi-gloss or gloss as indicated.
 10. Concrete Block: 3 coats.
 - a. First: Concrete block filler.
 - b. Second and Third: Interior enamel, semi-gloss or gloss as indicated.
 11. Metal: Shall be cleaned, pre-treated and painted with 3 coats. Items to be painted include, but are not limited to: exposed structural and miscellaneous steel, railings and handrails, metal doors and frames, ladders, table and bench legs.
 - a. First Coat: Cycloaliphatic Amine Epoxy.
 - b. Second and Third Coats: Aliphatic Acrylic-Polyester Polyurethane.
- B. Exterior:
1. Woodwork: 3 coats.
 - a. First Coat: As specified in this section under Priming.

- b. Second and Third Coats: Exterior house and trim enamel.
- 2. Wood Doors: 3 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Exterior gloss enamel.
- 3. Plaster and Stucco: 3 coats. Flat 100 percent acrylic.
 - a. Prime Coat: Alkali resistant primer/sealer.
 - b. Exterior 100 percent acrylic.
- 4. Concrete: 3 coats. Flat 100 percent acrylic.
 - a. First Coat: Concrete sealer.
 - b. Second and Third Coats: Exterior 100 percent acrylic.
- 5. Metal: 3 coats. Shall be cleaned and pre-treated. Items to be painted include, but are not limited to: steel columns and miscellaneous steel items, railings and handrails gravel stops, metal doors and frames, hoods and flashings.
 - a. First Coat: Cycloaliphatic Amine Epoxy.
 - b. Second and Third Coats: Aliphatic Acrylic-Polyester Polyurethane.

C. Mechanical and Electrical Work:

- 1. Except where interior mechanical and electrical Work to be painted is specified to receive another paint finish, Work occurring in finished rooms and spaces shall be cleaned, pre-treated, and painted with 3 coats. Items to be painted include, but are not limited to: steel and copper piping, pipes, vents, fittings, ducts, plenums, miscellaneous supports and hangers, electrical conduit, fittings, pull boxes, outlet boxes, unfinished surfaces of plumbing fixtures, miscellaneous metal cabinets, panels, and access doors and panels.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Interior enamel, semi-gloss or gloss to match adjacent wall or ceiling finish.
- 2. Insulation and Taping on Pipes and Ducts: 3 coats.
 - a. Finished Rooms:
 - 1) First Coat: Interior waterborne primer.
 - 2) Second and Third Coats: Interior semi-gloss or gloss enamel to match adjoining wall or ceiling finish.

b. Building Exterior:

- 1) First Coat: Exterior waterborne primer.
 - 2) Second and Third Coats: Exterior gloss enamel.
3. Inside surfaces of ducts, vents, dampers and louvers as far back as visible from room in which they open shall be painted with 2 coats of flat black paint.

D. Miscellaneous:

1. Outside Storage Units (wood or metal): 3 coats.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Exterior gloss enamel.
2. Exterior and interior surfaces of storage bins, and potting tables shall have 3 coats of acrylic stain.
3. Wood compost bins shall be finished with 3 coats of acrylic stain.

3.05 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.06 CLEANUP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION