


TECHNICAL SPECIFICATIONS

FOR

**MOORPARK COLLEGE EATM LION ENCLOSURE
VENTURA COUNTY COMMUNITY COLLEGE DISTRICT
BID No. 585**

FOR

**MOORPARK COLLEGE
7075 CAMPUS ROAD
MOORPARK, CA 93021**



**William J Amador AIA, ARCHITECT
AMADOR WHITTLE ARCHITECTS, INC**

**TECHNICAL SPECIFICATIONS
FOR
MOORPARK COLLEGE EATM LION ENCLOSURE**

DIVISION 00 – PROCUREMENT AND CONTRACTING REQUIREMENTS

00000	Title Page	01
00100	Table of Contents.....	02

DIVISION 1 – GENERAL REQUIREMENTS

01 1100	Summary of Work.....	04
01 2613	Request for Clarification.....	01
01 3113	Project Coordination.....	02
01 3300	Submittal Procedures.....	09
01 4523	Testing and Inspection.....	11
01 5000	Construction Facilities and Temporary Controls.....	11
01 7329	Cutting and Patching	07
01 7419	Construction and Demolition Waste Management.....	04

DIVISION 2 - DEMOLITION

02 4116	Demolition	04
---------	------------------	----

DIVISION 3 - CONCRETE

03 1000	Concrete Forming and Accessories.....	05
03 2000	Concrete Reinforcing.....	05
03 3000	Cast-In-Place Concrete	18

DIVISION 4 - MASONRY

04 2200	Concrete Unit Masonry	10
---------	-----------------------------	----

DIVISION 5 - METALS

05 0513	Hot-Dip Galvanizing	06
05 1200	Structural Steel Framing.....	15
05 3000	Metal Decking.....	06
05 5000	Metal Fabrications	06
05 5910	Stainless Steel Hand-Woven Netting.....	06

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

07 9200	Joint Sealants.....	06
---------	---------------------	----

DIVISION 9 - FINISHES

09 9000	Painting and Coating.....	05
---------	---------------------------	----

DIVISION 22 – PLUMBING

22 0500	Common Work Results for Plumbing.....	07
22 0513	Basic Plumbing Materials and Methods	09
22 1000	Plumbing.....	09

DIVISION 26 – ELECTRICAL

26 0000	General Provisions	12
26 0050	Basic Electrical Materials & Methods.....	05
26 0060	Minor Electrical Demolition for Remodeling	03
26 0111	Conduits	04
26 0120	Conductors	04
26 0130	Electrical Boxes	04
26 0140	Wiring Devices.....	08
26 0142	Nameplates and Warning Signs	02
26 0164	Branch Circuit Panel Boards.....	02
26 0170	Disconnects	02
26 0190	Support Devices	02
26 2450	Grounding.....	06
26 2510	Lighting Fixtures.....	03

DIVISION 31 – EARTHWORK

31 1000	Site Clearing	02
31 2200	Grading.....	04
31 2313	Excavation and Fill	08
31 2326	Base Course	02
31 2705	Stabilized Decomposed Granite Paving.....	02

DIVISION 32 – EXTERIOR IMPROVEMENTS

32 3113	Chain Link Fences and Gates	09
---------	-----------------------------------	----

END OF TABLE OF CONTENTS

SECTION 01 1100
SUMMARY OF WORK

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. The furnishing of all labor, materials, equipment, services, and incidentals necessary for Work of the EATM Lion Enclosure Project at Moorpark College located at 7075 Campus Road, Moorpark, California 93021, as set forth in the Construction Documents which include, but are not limited to, the Drawings, Addenda and Specifications.

1.02 RELATED REQUIREMENTS:

1. Section 01 3113: Project Coordination.

PART 2 - PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 USE OF PREMISES

- A. CONTRACTOR shall coordinate Work of all trades, Subcontractors, utility service providers, with OWNER and/or Separate Work Contract. CONTRACTOR shall sequence, coordinate, and perform the Work to impose minimum hardship on the operation and use of the existing facilities and/or Project site. CONTRACTOR shall install all necessary protection for existing improvements, Project site, property, and new Work against dust, dirt, weather, damage, vandalism, and maintain and relocate all protection to accommodate progression of the Work.
- B. CONTRACTOR shall confine entrance and exiting to the Project site and/or facilities to routes designated by the OWNER.
- C. Within existing facilities, OWNER will remove portable equipment, furniture, and supplies from Work areas prior to the start of Work. CONTRACTOR shall cover and protect remaining items in areas of the Work.
- D. CONTRACTOR is advised school may be in session during performance of the Work. CONTRACTOR shall utilize all available means to prevent generation of unnecessary noise and maintain noise levels to a minimum. When required by the OWNER, CONTRACTOR shall immediately discontinue noise-generating activities and/or provide alternative methods to minimize noise generation. CONTRACTOR shall install and maintain air compressors, tractors, cranes, hoists, vehicles, and other internal

combustion engine equipment with mufflers, including unloading cycle of compressors. CONTRACTOR shall discontinue operation of equipment producing objectionable noise as required by the OWNER.

- E. CONTRACTOR shall furnish, install, and maintain adequate supports, shoring, and bracing to preserve structural integrity and prevent collapse of existing improvements and/or Work modified and/or altered as part of the Work.
- F. CONTRACTOR shall secure building entrances, exits, and Work areas with locking devices as required by the OWNER.
- G. CONTRACTOR assumes custody and control of OWNER property, both fixed and portable, remaining in existing facilities vacated during the Work.
- H. CONTRACTOR shall cover and protect surfaces of rooms and spaces in existing facilities turned over for the Work, including OWNER property remaining within as required to prevent soiling or damage from dust, dirt, water, and/or fumes. CONTRACTOR shall protect areas adjacent to the Work in a similar manner. Prior to OWNER occupancy, CONTRACTOR shall clean all surfaces including OWNER property.
- I. CONTRACTOR shall not use or allow anyone other than OWNER employees to use facility telephones and/or other equipment, except in an emergency. CONTRACTOR shall reimburse OWNER for telephone toll charges originating from the facility except those arising from emergencies or use by OWNER employees.
- J. CONTRACTOR shall protect all surfaces, coverings, materials, and finished Work from damage. Mobile equipment shall be provided with pneumatic tires.
- K. CONTRACTOR is advised OWNER may award Separate Work Contracts at this Project site.
- L. CONTRACTOR shall not permit the use of portable and/or fixed radio's or other types of sound producing devices including walkmans and similar devices.
- M. Refer to the attached "America's Teaching Zoo – Guidelines for Working In and Around America's Teaching Zoo.

END OF SECTION



America's Teaching Zoo
Moorpark College
7075 Campus Drive
Moorpark, CA 93021
Phone #: (805) 378-1441
Fax #: (805) 378-1569

Date: 6/20/19
To: Contractors and construction workers
From: Michlyn Hines, Zoo Operations Supervisor
Subject: Guidelines for working in and around America's Teaching Zoo.

Due to the unique nature of this working environment it is important to make you aware of guidelines that must be adhered to while working on Zoo grounds and around the perimeter of America's Teaching Zoo.

We will do our best to work with you to accommodate your needs, but please understand that this environment will present challenges that you most likely have not encountered on any other construction site. Excellent communication between the construction crew and ATZ staff is the key to our ability to help you keep the project on track. The sooner we know about an accommodation you will need, the better we will be able to respond.

The contractor for this project is responsible for insuring that the sub contractors and their employees are aware of, and adhere to, the following guidelines;

1) The zoo is open during the following times:

Weekday

7:00 am to 5 pm (May 21-Aug. 16, 2019)

6:30 am to 5 pm (Aug. 19 - Dec. 18 2019)

Weekends

8 am to 5 pm (11:00-5:00 open to public)

If construction workers need to be in the Zoo, or working outside the Zoo in close proximity to the Zoo perimeter fence during times other than those listed above, arrangements must be made with Zoo staff at least 48 hours in advance.

2) Weekdays Animal Shows/Tours

Wildlife Theater just inside the zoo from 10:00-11:30, and large school groups of children touring the zoo between 9:30-12:30. Dates of scheduled shows will be provided every few weeks to help you minimize disruption to the shows.

3) If working on zoo grounds someone from the construction crew must use the intercom at the zoo vehicle gate (instructions are on the intercom), or intercom next to the front gate/public

entrance to notify zoo staff that you are here so we can open the gate for you. Each day when work has ended you will need to notify staff so that we can open the gate for you.

4) Speed limit for driving in the Zoo is 5 mph. It is imperative that all construction vehicles adhere to the speed limit at all times for the safety of everyone. In addition, it is important to stop and check around blind corners before proceeding.

5) Should a meeting occur between a construction worker and student with an animal, the student with the animal has the right of way. If a student working with an animal tells you to do something, do it immediately and without question. Otherwise you may compromise the safety of the student, animal, yourself, or anyone else around. Usually, you will only be delayed a few minutes at most.

6) No interaction with the animals unless approved by Zoo staff.

7) No smoking on Zoo grounds.

8) No food allowed past the picnic area at the front of the zoo. It is imperative that all food wrappings and trash be disposed of properly in a trash receptacle. This is to eliminate the possibility of trash blowing into an animal enclosure. Animals will eat these items, which can result in serious medical complications resulting in expensive medical treatment.

9) Coordination between a Zoo staff member and Project engineer is necessary for construction worker entry into any animal area outside the public access area. Public access is limited to the Zoo's asphalt road on the campus side. The road along the back of the zoo on Collins Rd. side is outside the public access area.

10) The Zoo's perimeter fence must be intact and secure at the end of every day. USDA regulations require that the bottom of the fence is no more than 3 inches above the ground and that there are no gaps or holes in the fence larger than 3 inches.

11) Parking spaces on the NE (Collins side) are available for Construction workers if parking outside the zoo.

We appreciate your help in keeping our students, animals and staff safe while this construction project is in progress and will do our best to make accommodations needed to help you keep to the timeline for project.



Ventura County Community College District

Moorpark College - Facilities, Maintenance & Operations

REQUEST FOR CLARIFICATION (RFC)

School Name: Moorpark College RFC Number: _____
Project Name: EATM Lion Enclosure Date: _____
Project Description: Construction of Lion Habitat Project No.: 19-MPC-030
Issued To: (AOR) Amador-Whittle Architects Contract No.: Bid # 585
(Architect)

Drawing Number Detail

Specification Section

Sub-Contractor RFC No.

Request:

Request Issued by:

Contractor's Name

Signature

Date

Response:

Response Issued by:

Architect's Signature

Name (Printed)

Date

This Form Cannot Modify Contract Amount or Milestones and/or Contract Time.

cc:

SECTION 01 4523
TESTING AND INSPECTION

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Testing and inspection services to meet requirements of the California Building Code (CBC) and the Division of the State Architect (DSA).
- B. Related Requirements:
 - 1. Section 03 2000 – Concrete Reinforcing.
 - 2. Section 03 3000 – Cast-in-Place Concrete.

1.02 REFERENCES

- A. American Concrete Institute (ACI):
 - 1. ACI 318 – Building Code Requirements for Structural Concrete and Commentary.
- B. American Institute of Steel Construction (AISC):
 - 1. AISC 360 – Specification for Structural Steel Buildings.
 - 2. AISC 341 – Seismic Provisions for Structural Steel Buildings.
- C. ASTM International (ASTM):
 - 1. ASTM A108 – Standard Specification for Steel Bar, Carbon and Alloy, Cold-Finished.
 - 2. ASTM A370 – Standard Test Methods and Definitions for Mechanical Testing of Steel Products.
 - 3. ASTM A706 – Standard Specification for Deformed and Plain Low-Alloy Steel Bars for Concrete Reinforcement.
 - 4. ASTM C31 - Standard Practice for Making and Curing Concrete Test Specimens in the Field.
 - 5. ASTM C172 - Standard Practice for Sampling Freshly Mixed Concrete.

6. ASTM C780 - Standard Test Method for Preconstruction and Construction Evaluation of Mortars for Plain and Reinforced Unit Masonry.
 7. ASTM C1140 - Standard Practice for Preparing and Testing Specimens from Shotcrete Test Panels.
 8. ASTM C1314 - Standard Test Method for Compressive Strength of Masonry Prisms.
 9. ASTM C1604 - Standard Test Method for Obtaining and Testing Drilled Cores of Shotcrete.
 10. ASTM E164 - Standard Practice for Contact Ultrasonic Testing of Weldments.
 11. ASTM E488 - Standard Test Methods for Strength of Anchors in Concrete Elements.
 12. ASTM E543 - Standard Specification for Agencies Performing Nondestructive Testing.
 13. ASTM E605 - Standard Test Methods for Thickness and Density of Sprayed Fire-Resistive Material (SFRM) Applied to Structural Members.
 14. ASTM E1444 - Standard Practice for Magnetic Particle Testing.
 15. ASTM F606 - Standard Test Methods for Determining the Mechanical Properties of Externally and Internally Threaded Fasteners, Washers, Direct Tension Indicators, and Rivets.
- D. Association of the Wall and Ceiling Industry (AWCI):
1. AWCI Technical Manual 12-B - Standard Practice for the Testing and Inspection of Field Applied Thin Film Intumescent Fire-Resistive Materials; an Annotated Guide.
- E. American Welding Society (AWS):
1. AWS D1.1 – Structural Welding Code.
 2. AWS D1.4 – Structural Welding Code – Reinforcing Steel.
 3. AWS D1.8 – Structural Welding Code – Seismic Supplement.

- F. Division of the State Architect (DSA) Interpretation Regulations (IR):
1. DSA IR 17-2 – Nondestructive Testing (N.D.T.) of Welds.
 2. DSA IR 17-3 – Structural Welding Inspection.
 3. DSA IR 17-8 – Sampling and Testing of High Strength Bolts, Nuts and Washers.
 4. DSA IR 17-9 – High Strength Bolting Inspection.
 5. DSA IR 17-10 – Sampling, Testing and Tagging of Reinforcing Bars.
 6. DSA IR 17-11 – Identification, Sampling and Testing of Threaded Steel Anchor Bolts and Anchor Rods.
 7. DSA IR 22-3 – Open Web Steel Joists and Joist Girders.

1.03 REGULATORY REQUIREMENTS

- A. Laboratories performing testing shall have DSA's Laboratory Evaluation and Acceptance Program approval prior to providing material testing or special inspection services.
- B. Tests of materials and inspections shall be in accordance to Section 4-213 through 4-219 of the California Building Standards Commission's, California Administrative Code.
- C. Required material testing, inspections and special inspections are indicated on the DSA approved DSA-103, Listing of Structural Tests & Special Inspections (T&I List). OWNER will provide CONTRACTOR copy of DSA-103.

1.04 TESTS

- A. OWNER will contract with a DSA approved testing laboratory to perform the testing indicated on the Contract Documents, including the Tests and Special Inspections (T&I) list.
- B. Selection of material to be tested shall be by the Testing Laboratory and not by CONTRACTOR.
- C. Any material shipped from the source of supply prior to having satisfactorily passed such testing and inspection, or prior to the receipt of notice from Project Inspector such testing and inspection is not required, shall not be incorporated into the Work.

- D. OWNER will select, and directly reimburse, the Testing Laboratory for costs of all DSA required tests and inspections; however, the Testing Laboratory may be reimbursed by CONTRACTOR for such costs as specified or noted in related sections of the Contract Documents.
- E. The Testing Laboratory is not authorized to release, revoke, alter, or enlarge requirements of the Contract Documents or approve or accept any portion of the Work.
- F. The Testing Laboratory shall not perform any duties of CONTRACTOR.
- G. CONTRACTOR shall provide an insulated curing box with the capacity for twenty concrete cylinders and will relocate said box and cylinders as rapidly as required in order to provide for progress of the Work.

1.05 TEST REPORTS

- A. Test reports shall include all tests performed, regardless of whether such tests indicate the material is satisfactory or unsatisfactory. Samples taken but not tested shall also be reported. Records of special sampling operations, when and as required, shall also be reported. Reports shall indicate the material (or materials) was sampled and tested in accordance with requirements of CBC, Title 24, Parts 1 and 2, as indicated on the Contract Documents. Test reports shall indicate specified design strength and specifically state whether or not the material (or materials) tested comply with the specified requirements.

1.06 VERIFICATION OF TEST REPORTS

- A. Each Testing Laboratory shall submit to the Division of the State Architect, in duplicate, a verified report covering all tests required to be performed by that agency during the progress of the Work. Such report, covering all required tests, shall be furnished prior to Substantial Completion and/or, when construction on the Work is suspended, covering all tests up to the time of Work suspension.

1.07 INSPECTION BY OWNER

- A. OWNER, and its representatives, shall have access, for purposes of inspection, at all times to all parts of the Work and to all shops wherein the Work is in preparation. CONTRACTOR shall, at all times, maintain proper facilities and provide safe access for such inspection.
- B. OWNER shall have the right to reject materials and/or workmanship deemed defective Work and to require correction. Defective workmanship shall be corrected in a satisfactory manner and defective materials shall be removed from

the premises and legally disposed of without charge to OWNER. If CONTRACTOR does not correct such defective Work within a reasonable time, fixed by written notice and in accordance with the terms and conditions of the Contract Documents, OWNER may correct such defective Work and proceed in accordance with related Articles of the Contract Documents.

- C. CONTRACTOR is responsible for compliance to all applicable local, state, and federal regulations regarding codes, regulations, ordinances, restrictions, and requirements.

1.08 PROJECT INSPECTOR

- A. A Project Inspector will be employed by OWNER in accordance with requirements of Title 24 of the California Code of Regulations with their duties specifically defined therein. Additional DSA Special Inspectors may be employed and assigned to the Work by OWNER in accordance with the requirements of the CBC and DSA.
- B. Inspection of Work shall not relieve CONTRACTOR from any obligation to fulfill all terms and conditions of the Contract Documents.
- C. CONTRACTOR shall be responsible for scheduling times of inspection, tests, sample taking, and similar activities of the Work.

1.09 STRUCTURAL TESTS AND SPECIAL INSPECTIONS

- A. Soils:
 1. General: Periodic inspection by Geotechnical Engineer for verification of the following construction activities in conformance to CBC Table 1705A.6:
 - a. Site has been prepared properly prior to placement of controlled fill and/or excavations for foundations.
 - b. Foundation excavations are extended to proper depth and have reached proper material.
 - c. Materials below footings are adequate to achieve the design bearing capacity.
 2. Compacted Fills: Testing and inspections shall be in conformance to Table 1705A.6:

- a. Geotechnical Engineer will continuously verify the use of proper materials and inspect lift thicknesses, placement, and compaction during placement of fill.
- b. Testing Laboratory under the supervision of the Geotechnical Engineer will:
 - 1) Perform qualification testing of fill materials.
 - 2) Test the compaction of fill.

B. Concrete:

1. Cast in Place Concrete: Inspection and testing in conformance to CBC Table 1705A.3:
 - a. Inspection of reinforcement, including prestressing tendons and verification of placement, per ACI 318, sections 25.2, 25.2, 25.5.1 through 26.5.3.
 - b. Reinforcing bar welding: Inspect per AWS D1.4, ACI 318 26.5.4.
 - 1) Verification of weldability of reinforcing bars other than ASTM A706.
 - 2) Inspect single-pass fillet welds, maximum 5/16”.
 - 3) Inspect all other welds.
 - c. Inspect anchors cast in concrete per ACI 318, section 17.8.2.
 - d. Inspect anchors post-installed in hardened concrete members:
 - 1) Continuous inspection of adhesive anchors installed in horizontally or upwardly inclined orientations to resist sustained tension loads, per ACI 318, section 17.8.2.4.
 - 2) Mechanical anchors and adhesive anchors, not defined in previous paragraph, per ACI 318, section 17.8.2.
 - e. Design Mix:
 - 1) Verify use of required mix, per ACI 318, chapter 19 and sections 26.4.3 and 26.4.4.
 - 2) Batch Plant Inspection: The quality and quantity of materials used in transit-mixed concrete and in batched

aggregates shall be continuously inspected as required by CBC section 1705A.3.2. If approved by DSA, batch plant inspection may be reduced to periodic if plant complies with CBC section 1705A3.3.1, item 1, and requires first batch inspection, weightmaster, and batch tickets.

- f. Prior to concrete placement, fabricate specimens for strength tests, perform slump and air content tests, and determine the temperature of the concrete, per ASTM C172, ASTM C31, ACI 318, sections 26.4.5 and 26.12.
- g. Verify maintenance of specified curing temperature and techniques per ACI 318 sections 26.4.7 through 26.4.9 and CBC section 1908.9.
- h. Sampling and testing of reinforcing steel per ASTM A370, DSA IR 17-10 and CBC section 1910A.2. CONTRACTOR shall submit mill certificate indicating compliance with requirements for reinforcement, anchors, ties, and metal accessories.

2. Post-installed Anchors:

- a. Special Inspector will inspect installation of post-installed anchors in hardened concrete members as required by CBC table 1705A.3, item 4.
 - 1) Adhesive anchors installed in horizontally or upwardly inclined orientations to resist sustained tension loads, per ACI 318, section 17.8.2.4.
 - 2) Mechanical anchors and adhesive anchors not defined above, per ACI 318, section 17.8.2.
- b. Testing Laboratory will test post-installed anchors in conformance to CBC section 1905A and ASTM E488.

C. Structural Masonry:

1. Material Verification and Testing:

- a. Sampling and testing of reinforcing steel per ASTM A370, DSA IR 17-10 and CBC section 1910A.2. CONTRACTOR shall submit mill certificate indicating compliance with requirements for reinforcement, anchors, ties, and metal accessories.

- b. Submit manufacturer's certificate of compliance for masonry units, mortar and grout materials. Test masonry units, mortar and grout (unit strength method).
- c. Testing Laboratory will test masonry prisms in conformance with ASTM C1314.
- d. Special Inspector will verify proportions of site-prepared, premixed or preblended mortar and grout, per ASTM C780.
- e. Testing Laboratory will test core-drilled samples in conformance with CBC 2114.6.2.

2. Inspection:

- a. Special Inspector will continuously inspect preparation of prisms per ASTM C1314.
- b. Special inspector will verify size, location and condition of dowels and construction supporting masonry.
- c. Special inspector will verify size specified size, grade and type of reinforcement.
- d. Special inspector will verify weldability of reinforcing bars other than ASTM A706. Special inspector to inspect reinforcing bar welding: Inspection to be in conformance with AWS D1.4, ACI 318 26.5.4.
- e. Special inspector will inspect placement of reinforcement, connectors, masonry units and construction of mortar joints.
- f. Special inspector will verify protection of masonry during cold weather temperature (temperature below 40° F) or hot weather (temperature above 90° F).
- g. Special inspector will inspect type, size and location of anchors and all other items to be embedded in masonry, including other details of anchorage of masonry to structural members, frames and other construction.
- h. Special inspector will inspect grout space prior to grouting and placement of grout.

3. Post-installed Anchors in Masonry:

- a. Special inspector will inspect anchors cast in concrete per ACI 318, section 17.8.2.
- b. Special inspector will inspect anchors post-installed in hardened concrete members:
 - 1) Continuous inspection of adhesive anchors installed in horizontally or upwardly inclined orientations to resist sustained tension loads, per ACI 318, section 17.8.2.4.
 - 2) Mechanical anchors and adhesive anchors, not defined in previous paragraph, per ACI 318, section 17.8.2.
- c. Testing Laboratory will test post-installed anchors in conformance to CBC section 1905A and ASTM E488.

D. Structural Steel:

1. Special inspector will verify that all materials are properly marked in conformance with AISC 360, Section 3.3 and applicable ASTM standards.
 - a. Mill certificates indicating material properties that comply with requirements.
 - b. Materials, sizes, types and grades complying with requirements.
2. Testing Laboratory will test unidentified materials in conformance with ASTM A370.
3. Special inspector will examine seam welds of HSS shapes in conformance with DSA IR-17-3.
4. Special inspections and non-destructive testing of structural steel elements shall be in conformance to CBC section 1705A.2.1.

E. High Strength Bolts:

1. Special inspector will verify identification markings and manufacturer's certificates of compliance conform to ASTM standards specified in the Contract Documents, per DSA IR 17-9.
2. Testing Laboratory will test high-strength bolts, nuts and washers in conformance with ASTM F606, ASTM A370 and DSA IR 17-8.

3. Special inspector will inspect bearing-type (“snug tight”) bolt connections in conformance with AISC 360, section M2.5 and DSA IR 17-9.
4. Special inspector will inspect slip-critical bolt connections in conformance with AISC 360, section M2.5.

F. Welding:

1. Verification of Materials, Equipment and Welders:
 - a. Special inspector will verify weld filler material identification markings per AWS designation listed on the Contract Documents and the WPS.
 - b. Special inspector will verify material manufacturer’s certificate of compliance.
 - c. Special inspector will verify WPS, welder qualifications and equipment in conformance to DSA IR 17-3.
2. Shop Welding: Special inspector will inspect the following, per CBC 1705A.2.1, AISC 360 (and AISC 341, as applicable) and DSA IR 17-3:
 - a. Groove, multi-pass fillet welds larger than 5/16”, plug and slot welds.
 - b. Single-pass fillet welds equal or less than 5/16”.
 - c. Inspect welding of stairs and railing systems.
 - d. Verification of reinforcing steel weldability.
 - e. Welding of reinforcing steel, per AWS D1.4.
3. Field Welding: Special inspector will inspect the following, per CBC 1705A.2.1, AISC 360 (and AISC 341, as applicable) and DSA IR 17-3:
 - a. Groove, multi-pass fillet welds larger than 5/16”, plug and slot welds.
 - b. Single-pass fillet welds equal or less than 5/16”.
 - c. End welded studs (ASTM A108) installation, including bend test.
 - d. Floor and roof deck welds.
 - e. Welding of structural cold-formed steel.

- f. Welding of stairs and railing systems.
 - g. Verification of reinforcing steel weldability.
 - h. Inspect welding of reinforcing steel.
4. Non-Destructive Testing: Testing Laboratory will test perform ultrasonic and magnetic particle testing in conformance to AISC 360 section N5.5, AISC 341 appendix Q5.2, AWS D1.1, AWS D1.8, ASTM E543, ASTM E1444, ASTM E164 and DSA IR 17-2.
- G. Anchor Bolts, Anchor Rods and Other Steel:
- 1. Testing Laboratory will sample and test not readily identifiable anchor bolts and anchor rods in accordance with DSA IR 17-11.
 - 2. Testing Laboratory will sample and test not readily identifiable threaded rod not used for foundation anchorage per procedures noted in DSA IR 17-11.

END OF SECTION

SECTION 01 2613
REQUEST FOR CLARIFICATION

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Procedure for requesting clarification of the intent of the Contract Documents.

1.02 RELATED REQUIREMENTS

- A. Section 01 1100: Summary of Work.
- B. Section 01 3113: Project Coordination.

PART 2 - PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 PROCEDURE

- A. CONTRACTOR shall prepare a Request for Clarification on the form provided at the end of this section. CONTRACTOR shall transmit the Request for Clarification to ARCHITECT with a concurrent copy to the OWNER.
- B. ARCHITECT response is a clarification of the intent of the Contract Documents and does not authorize changes in the Contract Amount, Milestones and/or Contract Time.
- C. A Request for Clarification may be returned with a stamp or notation "Not Reviewed," if:
 - 1. The requested clarification is ambiguous or unclear.
 - 2. CONTRACTOR has not reviewed the Request for Clarification prior to submittal.
- D. Allow a minimum of five days for review and response time, after receipt by ARCHITECT and OWNER. CONTRACTOR shall verify and is responsible in verifying ARCHITECT and OWNER receipt of a Request for Clarification.
- E. Changes or alterations to the approved drawings or specifications shall be made by means of addenda or change orders as per section 4-338 of the California Building Standards Commission's, California Administrative Code.

END OF SECTION

SECTION 01 3113

PROJECT COORDINATION

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section specifies administrative and procedural requirements necessary for coordinating Work operations including, but not limited to, the following:
 - 1. General coordination procedures.
 - 2. Coordination drawings.

1.02. RELATED REQUIREMENTS

- A. Section 01 4523: Testing and Inspection.

PART 2 - PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 COORDINATION

- A. CONTRACTOR shall coordinate operations included in various sections of Contract Documents to assure efficient and orderly installation of each part of Work. Coordinate Work operations included under related sections of Contract Documents that depend on each other for proper installation, connection, and operation of Work, including but not limited to:
 - 1. Schedule construction operations in sequence required where installation of one part of Work depends on installation of other components, before or after its own installation.
 - 2. Coordinate installation of different components to assure maximum accessibility for required maintenance, service, and repair.
 - 3. Provide provisions to accommodate items scheduled for later installation.
 - 4. Prepare and administer provisions for coordination drawings.

- B. Where necessary, prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required in notices, reports, attendance at meetings, and:
 - 1. Prepare similar memoranda for OWNER and Separate Work Contract where coordination of their Work is required.

- C. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities to avoid conflicts and assure orderly progress of Work. Such administrative activities include, but are not limited to, following:
 - 1. Preparation of schedules.
 - 2. Installation, relocation, and removal of temporary facilities.
 - 3. Delivery and processing of submittals.
 - 4. Progress meetings.
 - 5. Project closeout activities.

- D. Conservation: Coordinate Work operations to assure operations are carried out with consideration given to conservation of energy, water, materials, and:
 - 1. Salvage materials and equipment involved in performance of, but not actually incorporated into Work.

END OF SECTION

SECTION 01 3300

SUBMITTAL PROCEDURES

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Administrative and procedural requirements for submittals required for the Work, including but not limited to; Shop Drawings, Product Data, Samples, material lists, and quality control items.
- B. Throughout the Contract Documents, the minimum acceptable quality of materials, fabrication, and execution have been defined by the name and catalog number of a manufacturer and by reference of recognized industry standards.
- C. To ensure that specified products are furnished and installed in accordance with the design intent, procedures have been established for submittal of design data and for its review by ARCHITECT, OWNER and others.

1.02 RELATED REQUIREMENTS

- A. Section 01 3113: Project Coordination
- B. Section 01 4523: Testing and Inspection.
- C. Section 01 7329: Cutting and Patching.

PART 2 – PRODUCTS (Not used)

PART 3 - EXECUTION

3.01 PROCEDURES

- A. CONTRACTOR is required to review and approve every submittal and shop drawing prior to transmittal and delivery to ARCHITECT. Should CONTRACTOR determine a submittal contains errors, or does not meet the requirements of the contract, CONTRACTOR shall immediately return the submittals and shop drawings to the producer and expedite the corrections prior to transmitting the submittal to ARCHITECT. Submittals shall not be used by CONTRACTOR to request clarifications or submit questions. CONTRACTOR will affix stamp to each submittal certifying CONTRACTOR has performed, at minimum, the following:

1. Verified the submittal is complete in all respects and follows the requirements of the Contract Documents without variance.
 2. Confirmed that no substitutions have been included. If substitutions are included, CONTRACTOR shall eliminate them from the submittal and process them in accordance with the Contract Documents.
 3. Identified any variances from the requirements of the Contract Documents and confirmed that the identified variance meets, but does not exceed the allowable limitations or tolerances as defined in these specifications.
 4. Verified that all submitted materials, dimensions and tolerances are compatible with existing or planned conditions of the Work in order to erect, fabricate, or install the submitted assembly in conformance with the requirements of the Contract Documents.
 5. Coordinated and verified that the dimensions match CONTRACTOR measured field or installation conditions.
 6. Coordinated and verified that the products of separate manufacturers required within any field produced assembly are compatible in all respects for such assembly.
 7. Packaged together all related submittals or shop drawings where such is necessary for a comprehensive ARCHITECT review.
- B. CONTRACTOR shall package each submittal appropriately for transmittal and handling. Transmittal format shall be as required by OWNER. CONTRACTOR shall transmit and deliver six sets of each submittal or re-submittal to ARCHITECT, two of which shall be returned to CONTRACTOR. Some specifications may require additional copies be provided. CONTRACTOR shall provide the OWNER additional copies as specified or as requested by OAR. ARCHITECT will not accept submittals received from sources other than from CONTRACTOR.
- C. After ARCHITECT'S review, ARCHITECT will transmit submittals to OAR and OAR shall further distribute to CONTRACTOR, INSPECTOR and others as required. Work shall not commence, unless otherwise approved by OAR, until approved submittals are transmitted to CONTRACTOR.

- D. CONTRACTOR shall clearly identify any deviations from the Contract Documents on each submittal. Any deviation not so noted even though stamped reviewed is not acceptable.
- E. CONTRACTOR shall coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities requiring sequential activity.
- F. Timing of Submittals:
1. In accordance with General Conditions, CONTRACTOR shall submit to ARCHITECT, with copy of transmittal to the OWNER, those Shop Drawings, Product Data, diagrams, materials lists, Samples and other submittals required by the Contract Documents.
 2. The scheduling of submittals shall be sequenced to support the progress of the Work, and shall be:
 - a. Submitted sufficiently in advance of construction, fabrication or installation in order to allow time for transmittal, review, modification, correction, (and resubmission and re-review when required.)
 - b. Phased with adequate time between submittals in order to allow for proper review by the ARCHITECT without negative impact to the Milestones Schedule.
 3. CONTRACTOR shall coordinate submittal of related items and ARCHITECT reserves the right to withhold action on a submittal requiring coordination with other submittals until all related submittals are received by ARCHITECT.
 4. CONTRACTOR shall revise, update and submit submittal schedule to ARCHITECT and OWNER on the first of each month, or as required by OAR.
 5. CONTRACTOR shall allow in the Construction Schedule, at least sixteen days for ARCHITECT review following ARCHITECT receipt of submittal. For mechanical, plumbing, electrical, low voltage, fire sprinklers, door and hardware, and other submittals requiring joint review with OWNER, CONTRACTOR shall allow a minimum of eighteen days following ARCHITECT receipt of submittal.
 6. No adjustments to the Contract Time or Milestones will be authorized because of a failure to transmit submittals to ARCHITECT sufficiently in advance of the Work to permit review and processing or where

CONTRACTOR fails to provide ARCHITECT submittals on related items.

7. In case of product substitution, Shop Drawing preparation shall not commence until such time as OWNER accepts or rejects the proposed substitution in accordance with the procedures described in the General Conditions.
- G. If required, resubmit submittals in a timely manner. Resubmit as specified for initial submittal but identify as such. Review times for re-submitted items shall be as per the time frames for initial submittal review.
- H. Shop Drawing preparation shall not commence until such time as CONTRACTOR receives Product Data acceptance.
- I. ARCHITECT will stamp each submittal with a uniform, action stamp. ARCHITECT will mark the stamp appropriately to indicate the action taken, as follows:
1. Final Unrestricted Release: When ARCHITECT marks a submittal “Reviewed” or “Approved” the Work covered by the submittal may proceed provided it complies with requirements of the Contract Documents. Final payment depends on that compliance.
 2. Final-But-Restricted Release: When ARCHITECT, or authorized agent, marks a submittal “Reviewed as Noted” or “Furnish as Corrected”, the Work covered by the submittal may proceed provided it complies with notations or corrections on the submittal and requirements of the Contract Documents. Final payment depends on that compliance.
 3. Returned for Re-submittal: When ARCHITECT, or authorized agent, marks a submittal “Rejected” or “Revise and Resubmit,” do not proceed with Work covered by the submittal, including purchasing, fabrication, delivery, or other activity. Revise or prepare a new submittal according to the notations; resubmit without delay. Repeat as necessary to obtain different action mark. In case of multiple submittals covering same items of Work, CONTRACTOR is responsible for any time delays, schedule disruptions, out of sequence Work, or additional costs due to multiple submissions of the same submittal item. Do not use, or allow others to use, submittals marked “Rejected” or “Revise and Resubmit” at the Project site or elsewhere where Work is in progress.
 4. Other Action: Where a submittal is for information or record purposes or special processing or other activity, ARCHITECT, or authorized agent, will return the submittal marked “Action Not Required “.

3.02 SHOP DRAWINGS

- A. Shop Drawings are original drawings prepared by CONTRACTOR, Sub-contractor, supplier, or distributor illustrating some portion of Work by showing fabrication, layout, setting, or erection and shall not be based on reproduced Contract Documents or copied standard information.
- B. Produce Shop Drawings to an accurate scale that is large enough to indicate all pertinent features and methods. Except for templates, patterns, and similar full-size drawings, submit Shop Drawings on sheets at least 8-1/2 by 11 inches but no larger than 24 by 36 inches.
- C. Shop Drawings shall include fabrication and installation drawings, setting diagrams, schedules, patterns, templates, and similar drawings. Include the following information:
 - 1. Dimensions.
 - 2. Identification of products and materials included by sheet and detail number.
 - 3. Compliance with specified standards.
 - 4. Notation of coordination requirements.
 - 5. Notation of dimensions established by field measurement.
- D. Provide a space of approximately 4 by 5 inches on the label or beside the title block on Shop Drawings to record CONTRACTOR and ARCHITECT review, and the action taken. Include the following information on the label for processing and recording action taken:
 - 1. Project name.
 - 2. Date.
 - 3. Name and address of ARCHITECT.
 - 4. Name and address of CONTRACTOR.
 - 5. Name and address of Subcontractor.

6. Name and address of supplier.
 7. Name and address of manufacturer.
 8. Name and title of appropriate Specification section.
 9. Drawing number and detail references, as appropriate.
- E. Unless otherwise agreed to or indicated in individual Specification sections, submit a sufficient number of sets to allow for adequate distribution to CONTRACTOR, Sub-Contractor, supplier, manufacturer and fabricators plus four (4) sets (two sets to be retained by ARCHITECT, one set to the INSPECTOR and one set to OWNER). Electronic submittals are preferred except for material samples.

3.03 PRODUCT DATA

- A. Collect Product Data into a single submittal for each element of Work or system. Product Data includes printed information, such as manufacturer's installation instructions, catalog cuts, standard color charts, roughing-in diagrams and templates, wiring diagrams, schedules, illustrations, or performance curves.
1. Mark each copy to show or delineate pertinent materials, products, models, applicable choices, or options. Where Product Data includes information on several products that are not required, clearly mark copies to indicate the applicable information. Include the following information:
 - a. Manufacturer's printed recommendations.
 - b. Compliance with trade association standards.
 - c. Compliance with recognized testing agency standards.
 - d. Application of testing agency labels and seals.
 - e. Notation of dimensions verified by field measurement.
 - f. Notation of coordination requirements.
 - g. Notation of dimensions and required clearances.

h. Indicate performance characteristics and capacities.

i. Indicate wiring diagrams and controls.

2. Do not submit Product Data until compliance with requirements of the Contract Documents has been confirmed by CONTRACTOR.

C. Required Copies and Distribution: Same as denoted in Article 3.02.E.

3.04 SAMPLES

A. Procedure:

1. Submit Samples of sufficient size, quantity, cured and finished and physically identical to the proposed product or material. Samples include partial or full sections or range of manufactured or fabricated components, cuts or containers of materials, color range sets, and swatches denoting color, texture, and/or pattern.

a. Mount or display Samples in the manner to facilitate review of qualities indicated. Include the following:

1) Specification section number and reference.

2) Generic description of the Sample.

3) Sampling source.

4) Product name or name of manufacturer.

5) Compliance with recognized standards.

6) Availability and delivery time.

2. Submit Samples for review of size, kind, color, pattern, and texture. Submit Samples for a final check of these characteristics with other elements and a comparison of these characteristics between the final submittal and the actual component as delivered and installed.

a. Where variations in color, pattern, texture, or other characteristic is inherent in the material or product represented, submit at least three (3) multiple units that show the approximate limits of the variations.

- b. Refer to other Specification sections for requirements for Samples that illustrate materials, fabrication techniques, assembly details, connections, operation, and similar construction characteristics.
 - c. Refer to other sections for Samples to be returned to CONTRACTOR for incorporation into the Work. Such Samples must be undamaged at time of installation. On the transmittal indicate special requests regarding disposition of Sample submittals.
 - d. Samples not incorporated into the Work, or otherwise not designated as Owner property, remain the property of CONTRACTOR and shall be removed from the Project site prior to Substantial Completion.
- 3. Color and Pattern: Whenever a choice of color or pattern is available in a specified product, submit accurate color chips and pattern charts to OWNER for review and selection.
 - 4. Number Required: Submit six, minimum, of each. Two will be returned to CONTRACTOR.
- B. When specified, erect field Samples and mock-ups at the Project site to illustrate products, materials, fabrications, or execution and to establish standards by which completed Work shall be judged.
 - C. Maintain sets of Samples, as returned, at the Project site, for quality comparisons throughout the course of the Work. Sample sets may be used to obtain final acceptance of the Work associated with each set.

3.05 QUALITY CONTROL SUBMITTALS

- A. Submit quality control submittals, including design data, certifications, manufacturer's field reports, and other quality control submittals as required under other sections of the Contract Documents.
- B. When other sections of the Contract Documents require manufacturer's certification of a product, material, or installation complies with specified requirements, submit a notarized certification from the manufacturer certifying compliance with specified requirements.
- C. Certification shall be signed by an officer of the manufacturer or other individual authorized to sign documents on behalf of the represented company.
- D. Requirements for submittal of inspection and test reports are specified in other sections of the Contract Documents.

END OF SECTION

SECTION 01 5000

CONSTRUCTION FACILITIES AND TEMPORARY CONTROLS

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Temporary utilities, construction facilities and temporary controls to be provided, maintained, relocated, and removed by CONTRACTOR.
- B. Temporary office furnishings and office equipment.
- C. Project signage.

1.02 QUALITY ASSURANCE

- A. CONTRACTOR shall comply with applicable laws and regulations of authorities having jurisdiction including, but not limited to, the following:
 - 1. Building Code requirements.
 - 2. Health and safety regulations.
 - 3. Utility company regulations.
 - 4. Police, fire department and rescue squad requirements.
 - 5. Environmental protection regulations.
- B. CONTRACTOR shall arrange for the inspection and testing of each temporary utility prior to use. Obtain required certifications and permits and transmit to OWNER.

1.03 SUBMITTALS

- A. Temporary Utilities: Submit to OWNER reports of tests, inspections, meter readings, certifications, permits and similar procedures performed on temporary utilities.
- B. Project Signage / Banner: Submit to OWNER for review and approval.
 - 1. Shop Drawings: Elevation showing the text, OWNER sign and color of project signage, jointing, fittings and location of grommets.

2. Certification: Submit certification attesting fabric is certified as flame retardant, in accordance to NFPA 701, Standard Methods of Fire Tests for Flame Propagation of Textiles and Films.

1.04 PROJECT IDENTIFICATION SIGNAGE / BANNER

- A. CONTRACTOR shall furnish and install two Project Signs / Banners on the Project site at a location established by OWNER. OWNER will provide the information to be posted on the sign. A draft of the proposed sign shall be submitted to OWNER for review before fabrication.
 1. Sign Size: eight feet wide by four feet high, tie wire grommets to fence / barricade.
 2. The following shall be listed on the sign:
 - a. OWNER: Ventura County Community College District.
 - b. Name of School and project
 - c. Name of District Chancellor.
 - d. Alphabetical listing of other Board Members.
 - e. Name of the Architect/Engineer.
 - f. Name of CONTRACTOR.
- B. Products of the following manufacturers form the basis for design and quality intended: 3M, MACtac North America, or equal, and shall meet the following requirements:
 1. Flame retardant, heavy duty durable vinyl material, super smooth, minimum 16 ounces per layer.
 2. Banners shall be cut with accurate angles and straight edges. Edges of banner shall be heat welded on four sides without causing fabric separation or otherwise damaging the work.
 3. Banners shall have on both sides a clear, permanent, anti-graffiti coating that shall be durable and last a minimum of two years. Cleaning or removal of graffiti shall not cause damage to the anti-graffiti coating or image, or cause it to flake, yellow, bubble, peel or fade.
 4. Ink used in the printing process shall be of the highest quality OEM inks, and have integral UV protective components.

5. Banners shall be provided with ½ inch diameter grommets along the top and the bottom edges, spaced not more than 30 inches on center. Grommets shall be 4 inches, minimum, from the edges of the banner.
- C. No other signs shall be displayed without approval of OWNER. At CONTRACTOR'S expense and without limitation remove and/or relocate Project signage and related facilities as rapidly as required in order to provide for progress of the Work.
 - D. CONTRACTOR shall remove Project Signage / Banner at Substantial Completion of the Work.

1.05 TEMPORARY UTILITIES

- A. CONTRACTOR shall coordinate with college to install temporary services. CONTRACTOR shall provide and install required materials and equipment.
- B. Upon Substantial Completion of the Work, remove temporary systems, devices and appurtenances.

1.06 TEMPORARY OFFICES – NOT USED

1.07 TEMPORARY SANITARY FACILITIES

- A. CONTRACTOR shall provide portable chemical toilet facilities. Quantity of portable chemical toilet facilities shall be based on total number of workers and shall be in accordance with CAL/OSHA standards.
- B. CONTRACTOR employees shall not use school toilet facilities.
- C. At CONTRACTOR'S expense and without limitation remove and/or relocate portable chemical toilet facilities as rapidly as required in order to provide for progress of the Work.
- D. CONTRACTOR will contain their breaks and lunch periods to the areas designated by OWNER or any public area outside the Project site. CONTRACTOR shall provide a suitable container within the break/lunch area for the placement of trash. Areas used for break/lunch must be maintained clean and orderly. Once finish flooring has been installed in a particular area, no food or beverages will be permitted in that area.

1.08 TEMPORARY SECURITY FENCE / BARRICADE

- A. CONTRACTOR shall install temporary Project site security barricade(s) indicated on Drawings or as required for safety and as specified herein. New or used

material may be furnished. Security of Project site and contents is a continuous obligation of CONTRACTOR.

- B. Unless otherwise indicated or specified, security fence shall be constructed of 8-foot high chain link fencing with an 8-foot high windscreen. Space posts not to exceed ten feet on centers. Posts shall be of following nominal pipe dimensions: terminal, corner, and gatepost 2 ½-inch, line posts 2-inch. Chain link fence shall be not less than #13 gauge, 2-inch mesh, and in one width. Posts, fence and accessories shall be galvanized and as follows:
1. Shall have galvanized steel pipe bases with rounded corners and anchored with snadbags or other weights to keep them securely in place, unless required otherwise in writing by OWNER.
 2. Fence fabric shall be attached to posts with #14 gauge tie wire at 16 inches on center. A #6 gauge steel tension wire with turnbuckles shall be installed at top and bottom of barricade fencing. Wire tie fabric to tension wires at 18" centers.
 3. Windscreen shall be attached to fence fabric and steel tension wires at 18-inch centers with a minimum of #14 gauge tie wire. Windscreen shall be maintained and all rips, tears, missing sections shall be corrected upon notification by OWNER.
 4. Chain link fencing shall be free from barbs, icicles or other projections resulting from galvanizing process. Fence having such defects will be replaced even if it has been installed.
 5. Gates shall be fabricated of steel pipe with welded corners, and bracing as required. Fence and fabric to be attached to frame at 12-inch centers. Provide all gate hardware of a strength and quality to perform satisfactorily until barricade is removed upon Substantial Completion of the Work. Each gate shall have a chain and padlock. Provide two gate keys to OWNER. At Substantial Completion of the Work, remove barricade from Project site, backfill and compact fence footing holes. Existing surface paving that is cut into or removed shall be patched and sealed to match surrounding areas.
 6. At CONTRACTOR'S expense and without limitation remove or relocate fencing, fabric and barricades or other security and protection facilities as rapidly as required in order to provide for progress of the Work.

1.09 OTHER TEMPORARY ENCLOSURES AND BARRICADES

- A. Provide lockable, temporary weather-tight enclosures at openings in exterior walls to create acceptable working conditions, to allow for temporary heating and for security.

- B. Provide protective barriers around trees, plants and other improvements designated to remain.
- C. Temporary partitions shall be installed at all openings where additions connect to existing buildings, and where to protect areas, spaces, property, personnel, students and faculty and to separate and control dust, debris, noise, access, sight, fire areas, safety and security. Temporary partitions shall be as designated on the Drawings or as specified by ARCHITECT. At CONTRACTOR'S expense and without limitation remove and/or relocate enclosures, barriers and temporary partitions as rapidly as required in order to provide for progress of the Work.
- D. Since the Work of this Project may be immediately adjacent to existing occupied structures and vehicular and pedestrian right of ways, CONTRACTOR shall, in his sole judgment and in accordance with applicable safety standards, provide temporary facilities, additional barricades, protection and care to protect existing structures, occupants, property, pedestrians and vehicular traffic. CONTRACTOR is responsible for any damage, which may occur to the property and occupants of the property of OWNER or adjacent private or public properties which in any way results from the acts or neglect of CONTRACTOR.
- E. CONTRACTOR shall be responsible for cleaning up all areas adjacent to the construction site which have been affected by the construction; and for restoring them to at least their original condition- including landscaping; planting of trees, sod, and shrubs damaged by construction; and raking and disposal of debris such as roofing shingles, paper, nails, glass sheet metal, bricks, and waste concrete. Construction debris shall be removed and properly disposed of. Culverts and drainage ditches with sediment from the construction area shall be cleared routinely to maintain proper drainage and re-cleaned prior to completion of the contract.
- F. CONTRACTOR shall ensure sediment does not block storm drains. CONTRACTOR shall be responsible for cleaning storm drains blocked due to erosion or sediment from the work area.

1.10 TEMPORARY STORAGE YARDS

- A. CONTRACTOR shall fence and maintain storage yards in an orderly manner.
- B. Provide storage units for materials that cannot be stored outside.
- C. At CONTRACTOR'S expense and without limitation remove and/or relocate storage yards and units as rapidly as required in order to provide for progress of the Work.

1.11 TEMPORARY DE-WATERING FACILITIES AND DRAINAGE

- A. For temporary drainage and de-watering facilities and operations not directly associated with construction activities included under individual sections, comply with de-watering requirements of applicable Division 01 sections. CONTRACTOR shall maintain the Work, Project site and related areas free of water.
- B. For temporary drainage and de-watering facilities and operations directly associated with new buildings, additions or other construction activities, comply with Divisions 01 and 33 Sections. CONTRACTOR shall be responsible for, but not limited to, de-watering of excavations, trenches and below grade areas of buildings, structures, the Project site and related areas.

1.12 TEMPORARY PROTECTION FACILITIES INSTALLATION

- A. CONTRACTOR shall not change over from using temporary facilities and controls to permanent facilities until Substantial Completion, except as permitted by OWNER.
- B. Until permanent fire protection needs are supplied and approved by authorities having jurisdiction, CONTRACTOR shall provide, install and maintain temporary fire protection facilities of the types needed in order to adequately protect against fire loss. CONTRACTOR shall adequately supervise welding operations, combustion type temporary heating and similar sources of fire ignition.
- C. CONTRACTOR shall provide, install and maintain substantial temporary enclosures of partially completed areas of construction. Provide locking entrances to prevent unauthorized entrance, vandalism, theft and similar violations of security. Where materials, tools and equipment are stored within the Work area, CONTRACTOR shall provide secure lock up to protect against vandalism, theft and similar violations of security. OWNER accepts no financial responsibility for loss, damage, vandalism or theft.
- D. CONTRACTOR operations shall not block, hinder, impede or otherwise inhibit the use of required exits and/or emergency exits to the public way, except as approved by OWNER. CONTRACTOR shall maintain unobstructed access to fire extinguishers, fire hydrants, temporary fire protection facilities, stairways and other access routes for firefighting equipment and/or personnel.
- E. With approval of OWNER and at the earliest feasible date in each area of the Work, complete installation of the permanent fire protection facilities including connected services and place into operation and use. Instruct OWNER personnel in use of permanent fire protection facilities.
- F. In the event of an emergency drill or an actual emergency, designated by the sounding of the fire alarm and/or other sounding device, all construction activities must cease. CONTRACTOR shall evacuate the Work area and remain outside the Work area until permitted to return. No Work shall be conducted during the evacuation of a building or during an emergency.

1.13 TEMPORARY SECURITY AND SAFETY MEASURES

- A. During performance of the Work in existing facilities and/or on a Project Site occupied by students, CONTRACTOR shall provide, install and maintain substantial temporary barriers and/or partitions separating all Work areas from areas occupied by students, faculty and/or administrative staff.
- B. During performance of the Work in existing facilities or on a Project site occupied by students and where temporary barriers or partitions are not physically feasible, CONTRACTOR shall provide an employee meeting the requirements of Education Code Section 45125.2.(2) to continually supervise and monitor all employees of CONTRACTOR and Subcontractor. For the purposes of this Section, CONTRACTOR employee shall be someone whom the Department of Justice has ascertained has not been convicted of a violent or serious felony as listed in Penal Code Section 667.5(c) and/or Penal Code Section 1192.7(c). To comply with this Section, CONTRACTOR shall have his employee submit his or her fingerprints to the Department of Justice pursuant to Education Code Section 45125.1(a).
- C. Penal Code Sections 290 and 290.4 commonly known as “Megan’s Law”, require, among other things, individuals convicted of sexually oriented crimes, to register with the chief of police where the convicted individual resides or with a county sheriff or other law enforcement officials. CONTRACTOR shall check its own employees and require each Subcontractor to check its employees and report to CONTRACTOR if any such employees are registered sex offenders. CONTRACTOR shall check monthly during the life of the Contract to ascertain this information and report same to OWNER. Before starting the Work, and monthly thereafter during the life of Contract, CONTRACTOR shall notify OWNER in writing if any of its employees and/or if any Subcontractor’s employees is a registered sex offender. If so, CONTRACTOR shall proceed in accordance with paragraph B above.
- D. CONTRACTOR shall employ and maintain sufficient security and safety measures to effectively prevent vandalism, vagrancy, theft, arson, and all other such negative impacts to the Work. Any impacts to the progress of the Work of CONTRACTOR, OWNER, or OWNER’S forces, due to loss from inadequate security, will be the responsibility of CONTRACTOR.
- E. Until Substantial Completion of the Work, CONTRACTOR shall employ appropriate means to remove all graffiti from buildings, equipment, fences and all other temporary and/or permanent improvements on the Project site within twenty-four (24) hours from the date of report or forty-eight (48) hours of each occurrence.

1.14 TEMPORARY ACCESS ROADS AND STAGING AREAS

- A. Due to the limited amount of on and off Project site space for the parking of staff and school visitor's vehicles there will be no parking of CONTRACTOR vehicles in areas designated for school use only. CONTRACTOR shall provide legal access to and maintain CONTRACTOR designated areas for the legal parking, loading, off-loading and delivery of all vehicles associated with the Work. CONTRACTOR shall be solely responsible for providing and maintaining these requirements whether on or off the Project site. CONTRACTOR shall provide and maintain ample on-site parking spaces designated for the exclusive use of OWNER. CONTRACTOR shall erect signs as required by OWNER each of these spaces and prevent all unauthorized vehicles from parking in the OWNER-reserved spaces.
- B. Temporary access roads are to be installed and maintained by CONTRACTOR to all areas of the Project site.
- C. CONTRACTOR will be permitted to utilize existing facility campus roads as designated by OWNER. CONTRACTOR shall only utilize those entrances and exits as designated by OWNER and CONTRACTOR shall observe all traffic regulations of OWNER.
- D. CONTRACTOR shall maintain roads and walkways in a clean condition including removal of debris and/or other deleterious material on a daily basis.

1.15 TRENCHES

- A. Open trenches for installation of utility lines (water, gas, electrical and similar utilities) and open pits outside barricaded working areas shall be barricaded at all times in a legal manner determined by CONTRACTOR. Trenches shall be backfilled and patch-paved within twenty-four (24) hours after approval of installation by authorities having jurisdiction or shall have "trench plates" installed. Required access to buildings shall be provided and maintained. CONTRACTOR shall comply with all applicable statutes, codes and regulations regarding trenching and trenching operations. Open trenches deeper than 3'-6", and not located within a public street access, shall be enclosed within an 8'-0" high chain-link fence.

1.16 DUST CONTROL

- A. CONTRACTOR is responsible for dust control on and off the Project site. When Work operations produce dust the Project site and/or streets shall be sprinkled with water to minimize the generation of dust. CONTRACTOR shall clean all soils and debris from construction vehicles and cover both earth and debris loads prior to leaving the Project site. CONTRACTOR shall, on a daily basis, clean all streets and/or public improvements within the right of way of any and all debris, dirt, mud and/or other materials attributable to operations of CONTRACTOR.

1.17 WASH OUT

- A. CONTRACTOR shall provide and maintain a minimum of four (4) wash out boxes of sufficient size and strength to provide for concrete mixer wash out. CONTRACTOR shall locate and relocate both the wash out boxes and wash out areas in order to accommodate the progression of the Work. The wash out area shall be located as to minimize the amount of potential run off onto adjacent private and/or public property. CONTRACTOR shall legally dispose of the contents of the wash out boxes and area on an as needed basis or as required by OAR.

1.18 WASTE DISPOSAL

- A. CONTRACTOR shall provide and maintain trash bins on the Project site. Trash bins shall be serviced on an as needed basis and CONTRACTOR is responsible for the transportation of and the legal disposal of all contents.

1.19 ADVERSE WEATHER CONDITIONS

- A. Should warnings of adverse weather conditions such as heavy rain and/or high winds be forecasted, CONTRACTOR shall provide every practical precaution to prevent damage to the Work, Project site and adjacent property. CONTRACTOR precautions shall include, but not be limited to, enclosing all openings, removing and/or securing loose materials, tools, equipment and scaffolding.
- B. CONTRACTOR shall provide and maintain drainage away from buildings and structures.
- C. CONTRACTOR shall implement all required storm water mitigation measures as required under related Division 01 Sections.

1.20 DAILY AND MONTHLY REPORTS

- A. CONTRACTOR shall provide and maintain in the Project site office of CONTRACTOR, a daily sign in sheet for use by all employees of CONTRACTOR and all Subcontractors at whatever tier. At the beginning of each work day, the foreman, project manager, superintendent of CONTRACTOR and/or Subcontractors shall visit the site office of CONTRACTOR and shall enter onto the daily sign in sheet: all employee names; trade classification; and represented company. The completed sign in sheet shall serve as the basis of and shall be submitted with the daily construction report as set forth in Paragraph B below.
- B. By the end of each workday, CONTRACTOR shall submit to OWNER and INSPECTOR a daily construction report denoting the daily manpower counts and a brief description/location of the workday activities. Manpower shall be broken down by trade classification such as foreman, journeyman or apprentice. The report shall also note the date, day of the week, weather conditions, deliveries, equipment on the Project site whether active and/or idle, visitors, inspections,

accidents and unusual events, meetings, stoppages, losses, delays, shortages, strikes, orders and requests of governing agencies, Construction Directive and/or Change Orders received and implemented, services disconnected and/or connected, equipment start up or tests and partial use and/or occupancies. CONTRACTOR shall also include on the daily construction report the above information for all Subcontractors at whatever tier.

- C. CONTRACTOR shall submit on a monthly basis the forms found in Sections 01 3239 and 01 7416 certifying CEQA Mitigations and Storm Water Pollution Prevention (SWPP) compliances.

PART 2 – PRODUCTS – Not Used

PART 3 – EXUTION – Not Used

END OF SECTION

SECTION 01 7329
CUTTING AND PATCHING

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. This Section specifies procedural requirements for cutting and patching.

1.02 RELATED REQUIREMENTS

- A. Section 02 4116 - Demolition.

1.03 SUBMITTALS

- A. The word “cutting” as used in the Contract Documents includes, but is not limited to, cutting, drilling, chopping, and other similar operations and the word “patching” includes, but is not limited to, patching, rebuilding, reinforcing, repairing, refurbishing, restoring, replacing, or other similar operations.
- B. Cutting and Patching Proposal: CONTRACTOR shall submit a proposal describing procedures well in advance of the time cutting and patching will be performed if the Contract Documents requires approval of these procedures before proceeding. Include the following information, as applicable, in the proposal:
1. Describe the extent of cutting and patching required. Denote how it will be performed and indicate why it cannot be avoided.
 2. Describe anticipated results in terms of changes to existing construction. Include changes to structural elements and operating components as well as changes in the building’s appearance or other significant visual elements.
 3. List products to be used and firms or entities that will perform this Work.
 4. Indicate dates when cutting and patching will be performed.
 5. Utilities: List utilities that cutting and patching operations will disturb or affect. List utilities to be relocated and those that will be temporarily out-of-service. Indicate how long service will be disrupted.

6. Where cutting and patching involves adding reinforcement to structural elements, submit details and engineering calculations showing integration of reinforcement with the original structure.
7. Review by ARCHITECT prior to proceeding with cutting and patching does not waive ARCHITECT right to later require complete removal and replacement of defective Work.

1.04 QUALITY ASSURANCE

- A. Requirements for structural Work: Do not cut and patch structural elements in a manner that would change their load-carrying capacity or load-deflection ratio.
 1. Obtain approval from ARCHITECT of the cutting and patching proposal before cutting and patching the following structural elements:
 - a. Foundation construction.
 - b. Bearing and retaining walls.
 - c. Structural concrete.
 - d. Structural steel.
 - e. Lintels.
 - f. Timber and primary wood framing.
 - g. Structural decking.
 - h. Stair systems.
 - i. Miscellaneous structural metals.
 - j. Exterior curtain-wall construction.
 - k. Equipment supports.
 - l. Piping, ductwork, vessels, and equipment.
 - m. Structural systems of special construction in Division 13 Sections.
- B. Operational Limitations: Do not cut and patch operating elements or related components in a manner that would result in reducing their capacity to perform as intended. Do not cut and patch operating elements or related components in a

manner that would result in increased maintenance or decreased operational life or safety.

1. Obtain review of the cutting and patching proposal before cutting and patching the following operating elements or safety related systems:
 - a. Primary operational systems and equipment.
 - b. Air or smoke barriers.
 - c. Water, moisture, or vapor barriers.
 - d. Membranes and flashings.
 - e. Fire protection systems.
 - f. Noise and vibration control elements and systems.
 - g. Control systems.
 - h. Communication and/or data systems.
 - i. Conveying systems.
 - j. Electrical wiring systems.
 - k. Operating systems of special construction in Division 13 Sections.

C. Visual Requirements: Do not cut and patch construction exposed on the exterior or in occupied spaces in a manner that would, in the opinion of ARCHITECT, reduce the building's aesthetic qualities. Do not cut and patch construction in a manner that would result in visual evidence of cutting and patching. Remove and replace Work cut and patched in a visually unsatisfactory manner.

1. If possible, retain the original installer or fabricator to cut and patch the exposed Work listed below. If it is impossible to engage the original installer or fabricator, engage another recognized experienced and specialized firm.
 - a. Firestopping.
 - b. Acoustical ceilings.
 - c. Acoustical panels.
 - d. Finished wood flooring.
 - e. Synthetic sports flooring.

- f. Carpeting.
- g. HVAC enclosures, cabinets, or covers.
- h. Ceramic and quarry tile.
- i. Gypsum board.
- j. Masonry (exterior and interior where exposed).
- k. Tack boards.
- l. Casework.
- m. Finish carpentry.

1.05 WARRANTY

- A. Existing Warranties: Replace, patch, and repair material and surfaces cut or damaged by methods and with materials in such a manner as not to void any warranties required or existing.

PART 2 - PRODUCTS (Not applicable)

PART 3 - EXECUTION

3.01 INSPECTION

- A. Examine surfaces to be cut and patched and conditions under which cutting and patching is to be performed before cutting. If unsafe or unsatisfactory conditions are encountered, take corrective action before proceeding.
 - 1. Before proceeding, meet at the Project site with parties involved in cutting and patching, including mechanical and electrical trades. Review areas of potential interference and conflict. Coordinate procedures and resolve potential conflicts before proceeding.

3.02 PREPARATION

- A. Temporary support: Provide adequate temporary support of existing improvements or Work to be cut.
- B. Protection: Protect existing improvements and Work during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of existing improvements or Work that might be exposed during cutting and patching operations.

- C. Avoid interference with use of adjoining areas or interruption of free passage to adjoining areas.
- D. Where the Work requires sandblasting of existing surfaces in order to receive new materials secured by cementitious, adhesive or chemical bond, completely remove existing finishes, stains, oil, grease, bitumen, mastic and adhesives or other substances deleterious to the new bonding or fastening of new Work. Utilize wet sand blasting for interior surfaces and for exterior surfaces where necessary to prevent objectionable production of dust.

3.03 PERFORMANCE

- A. General: Employ skilled workmen to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time and complete without delay. Carefully remove existing Work to be salvaged and/or reinstalled. Protect and store for reuse into the Work. Verify compatibility and suitability of existing substrates before starting the Work.
- B. Cutting: Cut existing construction using methods least likely to damage elements retained or adjoining Work. Where possible, review proposed procedures with the original installer; comply with the original installer's recommendations.
 1. In general, where cutting, use hand or small power tools designed for sawing or grinding, not hammering and chopping. Cut holes and slots as small as possible, neatly to size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.
 2. To avoid marring existing finished surfaces, cut or drill from the exposed or finished side into concealed surfaces.
 3. Cut through concrete and masonry using a cutting machine, such as a carborundum saw or a diamond-core drill. Saw cut reinforcing bars and paint ends with bituminous paint except where bonded into new concrete or masonry.
 4. Comply with requirements of applicable Sections of Divisions 31, 32, and 33 where cutting and patching requires excavating, backfill, and recompaction.
 5. Woodwork: Cut and or remove to a panel or joint line.
 6. Sheet Metal: Remove back to joint, lap, or connection. Secure loose or unfastened ends or edges and seal watertight.
 7. Glass: Remove cracked, broken, or damaged glass and clean rebates and stops of setting materials.

8. Plaster: Cut back to sound plaster on straight lines, and back bevel edges of remaining plaster. Trim existing lath and prepare for new lath.
 9. Gypsum Wallboard: Cut back on straight lines to undamaged surfaces with at least two opposite cut edges centered on supports.
 10. Acoustical ceilings: Remove hanger wires and related appurtenances where ceilings are not scheduled to be installed.
 11. Tile: Cut back to sound tile and backing on joint lines.
 12. Flooring: Completely remove flooring and clean backing of prior adhesive. Carefully remove wood flooring for patching and repairing of existing wood flooring scheduled to remain.
- C. Patching: Patch with durable seams that are as invisible as possible. Comply with required tolerances.
1. Where feasible, inspect and test patched areas to demonstrate integrity of the installation. Verify conditions of existing substrates prior to executing Work.
 2. Restore exposed finishes of patched areas and extend finish restoration into retaining adjoining construction in a manner that will eliminate all evidence of patching and refinishing.
 3. Concrete: Maintain cut edges in a moist condition for twenty four hours prior to the placement of new concrete. In lieu of this an epoxy adhesive may be provided. Finish placed concrete to match existing unless noted otherwise. Concrete shall have a compressive strength of 3,000 psi where installed to repair and match existing improvements, unless noted otherwise.
 4. Metal Fabrications: Items to remain exposed shall have their edges cut and ground smooth and rounded.
 5. Sheet Metal: Replace removed or damaged sheet metal items for new Work.
 6. Glass: Install matching glass and re-seal exterior window assemblies.
 7. Lath and Plaster: Install new lath materials to match existing and fasten to supports at 6-inch centers. Provide a 6-inch lap where new lath to adjoins existing lath. Fasten new lath as required for new Work. Restore paper backings as required. Apply a bonding agent on cut edges of existing plaster. Apply three coat plaster of the type, thickness, finish, texture, and color to match existing.

8. Gypsum Wallboard: Fasten cut edges of wallboard. Install patches with at least two opposite edges centered on supports and secure at 6-inch centers. Tape and finish joints and fastener heads. Patching shall be non-apparent when painted or finished.
9. Acoustical Ceilings: Comply with the requirements for new Work specified in related sections of the Contract Documents.
10. Resilient Flooring: Completely remove flooring and prepare substrate for new material.
11. Painting: Prepare areas to be patched, patch and paint as specified under related sections of the Contract Documents.

3.04 CLEANING

- A. Clean areas and spaces where cutting and patching are performed. Completely remove paint, mortar, oils, putty, and similar items. Thoroughly clean piping, conduit, and similar features before applying paint or other finishing materials. Restore damaged coverings to their original condition.

END OF SECTION

SECTION 01 7419

CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes: Preparation and implementation, including reporting and documentation, of a Waste Management Plan for reusing, recycling, salvage or disposal of non-hazardous waste materials generated during demolition and new construction (Construction and Demolition (C&D) Waste), to foster material recovery and re-use and to minimize disposal in land fills.
- B. Related Requirements
 - 1. Section 01 3300 - Submittal Procedures.

1.02 REFERENCES

- A. California Integrated Waste Management Act of 1989 (AB 939).
- B. California Code of Regulations Title 14, Section 18700 et seq.
- C. California Green Building Standards Code.

1.03 SYSTEM DESCRIPTION

- A. Collection and separation of all C&D waste materials generated on-site, reuse or recycling on-site, transportation to approved recyclers or reuse organizations, or transportation to legally designated landfills, for the purpose of recycling salvaging and reusing a minimum of 75 percent of the C&D waste generated.

1.04 SUBMITTALS

- A. C&D Waste Management Plan (Exhibit 1): Within 10 calendar days after the Notice to Proceed and prior to any waste removal, submit the following to the OWNER for review and approval. Update quarterly. Include:
 - 1. Materials to be recycled, reused, or salvaged, either onsite or offsite.
 - 2. Estimates of C&D waste quantity (in tons) by type of material. (If waste is measured by volume, give factors for conversion to weight in tons.)
 - 3. Procedures for recycling and reuse program.
 - 4. Permit or license and location of Project waste-disposal areas.
 - 5. Site plan for placement of waste containers.

- B. C&D Waste Management Monthly Progress Report (Exhibit 2): Summary of waste generated by Project, monthly with Application for Payment. Include:
1. Firms accepting the recovered or waste materials.
 2. Type and location of accepting facilities (landfill, recovery facility, used materials yard, etcetera). If materials are reused or recycled on the Project site, location should be designated as “on-site reuse and recycling”.
 3. Type of materials and net weight (tons) of each.
 4. Value of the materials or disposal fee paid.
 5. Attach weigh bills and other documentation confirming amount and disposal location of waste materials.
- C. C&D Waste Management Final Compliance Report: Final update of Waste Management Plan to provide summary of total waste generated by Project.

PART 2 – PRODUCTS (Not Used)

PART 3 – EXECUTION

3.01 IMPLEMENTATION

- A. Implement approved Waste Management Plan including collecting, segregating, storing, transporting and documenting each type of waste material generated, recycled or reused, or disposed in landfills.
- B. Designate an on-site person to be responsible for instructing workers and overseeing the sorting and recording of waste/ recyclable materials.
- C. Include waste management and recycling in worker orientation and as an agenda item for regular Project meetings.
- D. Recyclable and waste bin areas shall be limited to areas approved on the Waste Management Plan. Keep recycling and waste bins neat and clearly marked to avoid contamination of materials.

3.02 ATTACHMENTS

- A. Exhibit 1: Waste Management Plan
- B. Exhibit 2: Waste Management Monthly Progress Report.

EXHIBIT 1

**WASTE MANAGEMENT PLAN
CONSTRUCTION/ MAINTENANCE/ALTERATION & DEMOLITION PROJECTS**

PROJECT NAME: «PROJECTTITLE» «CONTRACTTITLE»
 PROJECT NO: «Project Number»
 NAME OF COMPANY: _____
 CONTACT PERSON: _____
 TELEPHONE: _____
 PROJECT SITE LOCATION: _____
 PROJECT TYPE: NEW CONSTRUCTION DEMOLITION
 MAINTENANCE/ALTERATION PROJECTS
 PROJECT SIZE (SQ. FT.): _____
 DATE & ESTIMATED PERIOD _____

(1) Material Type	(2) Tons Estimated Recycle	(3) Tons Estimated Reuse	(4) Tons Estimated Salvage	(5) Tons Estimated Landfill	(6) Proposed Disposal or Recycling Facility (e.g., Onsite, Name of Facility)
Total					
Diversion Rate: Columns [(2)+(3)+(4)] / [(2)+(3)+(4)+(5)]					=

Signature	Title	Date
-----------	-------	------

- Column 1 "Material Types" – Enter type of materials targeted for recycling, reuse, and/or salvage, either on- or off-site, and include a category for waste materials requiring disposal.
- Columns 2 thru 4 "Estimated Generation" - Enter estimated quantities (tons) of recyclable, reusable, or salvageable waste materials anticipated to be generated and state number of salvageable items.
- Column 5 "Estimated Landfill" - Enter quantities (tons) of materials to be disposed in landfill.
- Column 4 "Disposal Location" - Enter end-destination of recycled, salvaged, and disposed materials.
- General : (1) Attach proposed Recycling and Waste Bin Location Plan.
 (2) Attach name and contact data for each recycling or disposal destination to be used.

EXHIBIT 2

WASTE MANAGEMENT PROGRESS REPORT
CONSTRUCTION/ MAINTENANCE/ALTERATION & DEMOLITION PROJECTS

PROJECT NAME: «PROJECTTITLE» «CONTRACTTITLE»
 PROJECT NO: «Project Number»
 NAME OF COMPANY: _____
 CONTACT PERSON: _____
 TELEPHONE: _____
 PROJECT SITE LOCATION: _____
 PROJECT TYPE: NEW CONSTRUCTION DEMOLITION
 MAINTENANCE/ALTERATION PROJECTS
 PROJECT SIZE (SQ. FT.): _____
 PERIOD _____ to _____

(1) Material Type	(2) Tons Actual Recycle	(3) Tons Actual Reuse	(4) Tons Actual Salvage	(5) Tons Actual Landfill	(6) Disposal or Recycling Facility (e.g., Onsite, Name of Facility)
Total					
Diversion Rate: Columns [(2)+(3)+(4)] / [(2)+(3)+(4)+(5)]					=

Signature	Title	Date
-----------	-------	------

- Column 1 "Material Types" – Enter type of materials targeted for recycling, reuse, and/or salvage, either on- or off-site, and include a category for waste materials requiring disposal.
- Columns 2 thru 4 "Estimated Generation" - Enter estimated quantities (tons) of recyclable, reusable, or salvageable waste materials anticipated to be generated and state number of salvageable items.
- Column 5 "Estimated Landfill" - Enter quantities (tons) of materials disposed.
- Column 4 "Disposal Location" - Enter end-destination of recycled, salvaged, and disposed materials.
- General : (1) Attach proposed Recycling and Waste Bin Location Plan.
 (2) Attach name and contact data for each recycling or disposal destination to be used.

END OF SECTION.

SECTION 02 4116

DEMOLITION

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes: Furnishing labor, materials and equipment necessary for demolition, dismantling, cutting and alterations as indicated, specified, or required for completion of the Work. Includes items such as the following:
1. Protection of existing improvements to remain.
 2. Cleaning existing improvements to remain.
 3. Disconnecting and capping utilities.
 4. Removing debris, waste materials, and equipment.
 5. Removal of items for performance of the Work.
 6. Salvageable items to be retained by the Owner.
- B. Related Requirements:
1. Division 01 - General Requirements.
 2. Section 01 1100 - Summary of Work.
 3. Section 01 5000 – Construction Facilities and Temporary Controls.
 3. Section 01 7419 - Construction and Demolition Waste Management.
 4. Division 26 -- Electrical.

1.02 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating the extent of items and systems to be removed. Indicate items to be salvaged or items to be protected during demolition. Indicate locations of utility terminations and the extent of abandoned lines to be removed. Include details indicating methods and location of utility terminations.

1.03 QUALITY ASSURANCE

- A. Perform the Work of this section by workers skilled in the demolition of buildings and structures. Perform the Work of this section under direct superintendence at all times.
- B. Prior to commencement of Work, schedule a walkthrough with the OWNER, to confirm Owner property items have been removed from scheduled Work areas. Identify and mark remaining property items and schedule their removal.
- C. Coordinate demolition for the correct sequence, limits, and methods. Schedule demolition Work to create least possible inconvenience to the public and facility operations.
- D. Related Standards:
 - 1. ANSI/ASSE A10.6.
 - 2. CBC Chapter 33.
 - 3. CFC Chapters 11 and 33.
 - 4. NFPA 241

1.04 PROJECT CONDITIONS

- A. Drawings may not indicate in detail all demolition Work to be performed. Examine existing conditions to determine the full extent of required demolition.
- B. Repair damage to existing improvements or damage due to excessive demolition.
- C. Provide all measures to avoid excessive damage from inadequate or improper means and methods, improper shoring, bracing or support.
- D. If conditions are encountered that varies from those indicated, promptly notify the Architect for clarification before proceeding.

PART 2 - PRODUCTS

2.01 HANDLING OF MATERIALS

- A. Items scheduled for salvage by the Owner shall be delivered to a location designated by the OWNER. Items shall be cleaned, packaged and labeled for storage.
- B. Items scheduled for reuse shall be stored on the Project site and protected from damage, theft and other deleterious conditions.

PART 3 - EXECUTION

3.01 GENERAL

- A. Protection:

1. Do not commence demolition until safety partitions, barricades, warning signs and other forms of protection are installed. Refer to Section 01 5000 - Construction Facilities and Temporary Controls.
 2. Provide safeguards, including warning signs, lights and barricades, for protection of workers, occupants, and the public.
- B. If safety of existing construction appears to be endangered, take immediate measures to correct such conditions; cease operations and immediately notify the OWNER.

3.02 DEMOLITION

- A. Do not throw or drop materials. Furnish ramps or chutes as required by the Work.
- B. Remove existing construction only to extent necessary for proper installation of Work and interfacing with existing construction. Cut back finished surfaces to straight, plumb or level lines as required for a smooth transition.
- C. Where openings are cut oversize or in improper locations, replace or repair to required condition.

3.03 CUTTING EXISTING CONCRETE

- A. Cutting of existing concrete shall be performed by skilled workers familiar with the requirements and space necessary for placing concrete. Perform concrete cutting with concrete cutting wheels and hand chisels. Do not damage concrete intended to remain.
- B. Extent of cutting of structural concrete shall be as indicated on Drawings. Cutting of non-structural concrete shall be as indicated on Drawings or as reviewed by the Architect or structural engineer. Replace concrete demolished in excess of amounts indicated.
- C. Prior to cutting or coring concrete, determine locations of hidden utilities or other existing improvements and provide necessary measures to protect them from damage.

3.04 REMOVAL OF EXISTING PLUMBING AND ELECTRICAL EQUIPMENT AND SERVICES

- A. Remove existing plumbing and electrical equipment fixtures and services not indicated for reuse and not necessary for completion of the Work. Remove abandoned lines and cap unused portions of existing lines.

3.05 REMOVAL OF OTHER MATERIALS

- A. Masonry: Cut back to joint lines and remove mortar without damaging units to remain. Allow space for repairs to backing where applicable.
- B. Woodwork: Cut or remove to a joint or panel line.
- C. Roofing: Remove as required, including accessory components such as insulation and flashings. At penetrations through existing roofing, trim cut edges back to sound roofing with openings restricted to the minimum size necessary to receive Work.

- D. Sheet Metal: Remove back to joint, lap, or connection. Secure loose and unfastened ends or edges and provide a watertight condition. Re-seal as required.
- E. Glass: Remove broken or damaged glass and clean rebates and stops of glazing channels.
- F. Modular materials such as acoustical ceiling panels, resilient tile, or ceramic tile: Remove to a natural joint without leaving damaged or defective Work where joining new Work. After flooring removal, clean substrates to remove setting materials and adhesives.
- G. Gypsum Board: Remove to a panel joint line on a stud or support line.
- H. Plaster: Saw cut plaster on straight lines, leaving a minimum 2-inch width of firmly attached metal lath for installing new lath and plaster.
- I. Remove existing improvements not specifically indicated or required but necessary to perform Work. Cut to clean lines, allowing for installation of Work.

3.06 PATCHING

- A. Patch or repair materials to remain when damaged by the performance of the Work of this section. Finish material and appearance of patch and/or repair Work shall match existing.

3.07 CLEANING

- A. Clean existing materials to remain with appropriate tools and equipment.
- B. Protect existing improvements during cleaning operations.
- C. Debris shall be dampened by fog water spray prior to transporting by truck.
- D. Debris pick-up area shall be kept broom-clean and shall be washed daily with clean water.
- E. Remove waste and debris, other than items to be salvaged. Turn over salvaged items to Owner, or store and protect for reuse where required. Continuously clean up and remove items as demolition Work progresses.
- F. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 03 1000

CONCRETE FORMING AND ACCESSORIES

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Formwork for cast-in-place concrete as indicated.
2. Installation of items to be embedded in concrete, such as anchor bolts, inserts, embeds, and sleeves.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 03 2000: Concrete Reinforcing.
3. Section 03 3000: Cast-In-Place Concrete.

1.02 REFERENCES

A. American Concrete Institute (ACI) Publication:

1. ACI 318 – Building Code Requirements for Structural Concrete, Chapter 6, Formwork, Embedded Pipes, and Construction Joints.
2. ACI 347 – Guide to Formwork for Concrete.

B. American Plywood Association (APA):

1. Form No. V345 - Concrete Forming Design/Construction Guide.

C. National Institute of Standards and Technology (NIST):

1. NIST Voluntary Product Standard PS 1.

1.03 SUBMITTALS

- A. Submit detailed structural calculations and drawings approved and signed by a California registered Civil Engineer where the height of the falsework or vertical shoring, as measured from the top of the sills to the soffit of the superstructure exceeds 14 feet, or where individual horizontal span lengths exceed 16 feet, or where provision for vehicular traffic through falsework or shoring occurs. For all other falsework and shoring submit layout signed by California registered Civil Engineer, manufacturer's authorized representative or a licensed contractor experienced in the usage and erection

of falsework and vertical shoring. A copy of the plans and calculation shall be available at the jobsite at all times.

- B. Shop Drawings: Submit Shop Drawings indicating locations of forms, construction and expansion joints, embedded items, and accessories.
- C. Product Data: Submit manufacturer's Product Data for form materials and accessories.

1.04 REGULATORY REQUIREMENTS

- A. California Building Code (CBC), Chapter 19A.
- B. California Code of Regulations, Title 8, Division 1, Chapter 4, Subchapter 4, Construction Safety Orders, Article 6, Excavations, Sections 1713 and 1717.

1.05 DELIVERY, STORAGE AND HANDLING

- A. Storage shall prevent damage and permit access to materials for inspection and identification.

PART 2 - PRODUCTS

2.01 GENERAL

- A. Form materials may be reused during progress of the Work provided they are completely cleaned and reconditioned, recoated for each use, capable of producing formwork of required quality, and are structurally sound.
- B. Form Lumber: WCLIB Construction Grade or Better, WWPA No. 1 or Better.
- C. Plywood: NIST Voluntary Product Standard PS 1, Group 1, Exterior Grade B-B Plyform or better, minimum 5-ply and 3/4 inch thick for exposed locations and at least 5/8 inch thick for unexposed locations, grade marked, not mill oiled. Furnished plywood with medium or high density overlay is permitted.
- D. Coated Form Plywood: For exposed painted concrete, plastic overlaid plywood of grade specified above, factory coated with a form coating and release agent Nox-crete", or equal.
- E. Tube Forms: Sonoco "Seamless Sonotubes," Ceme-Tube, Quik-Tube, or equal, of the type leaving no marks in concrete, one-piece lengths for required heights.
- F. Joist Forms: Code recognized steel or molded plastic types as required.
- G. Special Forms: For exposed integrally-colored concrete, plywood as above with high density overlay, plywood with integral structural hardboard facing or fibrous glass reinforced plastic facing, providing specified finish.
- H. For Exposed Concrete Finish:

1. Plywood: New, waterproof, synthetic resin bonded, exterior type Douglas fir or Southern pine plywood manufactured especially for concrete formwork and conforming to NIST Voluntary Product Standard PS 1, Grade B-B grade, Class I.
 2. Glass-Fiber-Fabric Reinforced Plastic Forms: Matched, tight fitting, stiffened to support weight of concrete without deflection detrimental to structural tolerances and appearance of finished concrete surfaces.
 3. Steel: Minimum 16 gage sheet, well matched, tight fitting, stiffened to support weight of concrete, without deflection detrimental to tolerances and appearances of finished concrete surfaces.
 4. Plywood: "Finland Form,," "Combi Form" by North American Plywood Corporation, "Plyform" by Roy O. Martin, "ProForm" by Pacific Wood Laminates, or equal. The material shall be furnished with hard smooth birch face veneers with phenolic resin thermally fused onto panel sides. Edges shall be factory sealed.
- I. Form Ties: Prefabricated rod, flat band, wire, internally threaded disconnecting type, not leaving metal within 1 1/2-inch of concrete surface.
 - J. Form Coating: Non-staining clear coating free from oil, silicone, wax, not grain-raising, "Formshield" by A.C. Horn, Inc., "Release" by Edoco/Dayton Superior, "Cast-Off" by Sonneborn/BASF Building Systems or equal. Where form liners are furnished, provide form coatings recommended by form liner manufacturer.
 - K. Form Liner: Rigid or resilient type by L.M. Scofield, Symons, Greenstreak, or equal.
 - L. Void Forms: Manufactured by SureVoid Products, Inc., Sonotube, Void Form International, or equal. Forms shall be "WallVoid" for temporary support of concrete walls and grade beams spanning between supports, and "SlabVoid" for creating gaps between concrete slabs or steps and underlying soils. Void forms shall be fabricated of corrugated paper with moisture resistant exterior, and shall be capable of withstanding working load of 1,500 psf. Provide accessories as required.

PART 3 - EXECUTION

3.01 GENERAL

- A. Forms shall be constructed so as to shape final concrete structure conforming to shape, lines and dimensions of members required by Drawings and Specifications, and shall be sufficiently tight to prevent leakage of mortar. They shall be properly braced or tied together to maintain position and shape. Forms and their supports shall be designed so that previously placed structures will not be damaged.
- B. Use form coating at all surfaces in contact with concrete.

3.02 TOLERANCES

- A. Permitted abrupt or gradual irregularities in formed surfaces as measured within a 5 feet length with a straightedge shall per ACI 347, Table 3.1:

Class of Surface			
A	B	C	D
1/8 inch	1/4 inch	1/2 inch	1 inch

1. Class A: Use for concrete surfaces prominently exposed to public view.
2. Class B: Use for coarse-textured concrete-formed surfaces intended to receive plaster, stucco or wainscoting.
3. Class C: Use as a general standard for permanently exposed surfaces where other finishes are not specified.
4. Class D: Use for surfaces where roughness is not objectionable and will be permanently concealed.

3.03 ERECTION

- A. Plywood shall be installed with horizontal joints level, vertical joints plumb and with joints tight. Back joints by studs or solid blocking, and fill where necessary for smoothness. Reused plywood shall be thoroughly cleaned, damaged edges or surfaces repaired and both sides and edges oiled with colorless form oil. Nail plywood along edges, and to intermediate supports, with common wire nails spaced as necessary to maintain alignment and prevent warping.
- B. Openings for Cleaning: Provide temporary openings at points in formwork to facilitate cleaning and inspection. At base of walls and wide piers, bottom form board on one face for entire length shall be omitted until form has been cleaned and inspected.
- C. Chamfers: Provide 3/4 inch by 3/4 inch chamfer strips for all exposed concrete corners and edges unless otherwise indicated.
- D. Reglets and Rebates: As specified in Section 03 3000: Cast-In-Place Concrete.

3.04 REMOVAL OF FORMS

- A. Forms shall not be removed until concrete has sufficiently hydrated to maintain its integrity and not be damaged by form removal operations. Unless noted otherwise and/or permitted by the Architect, columns and wall forms shall not be removed in less than five days, floor slabs in less than seven days, beams and girders in less than 15 days, pan forms for joists may be removed after three days, but joist centering shall not be removed until after 15 days, and ramp, landing, steps and floor slabs shall not be removed in less than seven days. Shoring shall not be removed until member has

acquired sufficient strength to support its weight, load upon it, and added load of construction.

- B. Compressive strength of in-place concrete shall be determined by testing field-cured specimens representative of concrete location or members, as specified in Section 03 3000: Cast-In-Place Concrete.

3.05 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.06 CLEAN UP

- A. Remove rubbish, debris and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 03 2000

CONCRETE REINFORCING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Concrete steel reinforcement.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 01 4523: Testing and Inspection.
3. Section 03 1000: Concrete Forming.
4. Section 03 3000: Cast-In-Place Concrete.
5. Section 04 2100: Clay Unit Masonry.
6. Section 04 2200: Concrete Unit Masonry.

1.02 REGULATORY REQUIREMENTS

- A. Fabrication and placement of reinforcing shall be in accordance with requirements of CBC, Chapter 19A.

1.03 REFERENCES

A. American Society for Testing and Materials (ASTM):

1. ASTM A82 - Standard Specification for Steel Wire, Plain, for Concrete Reinforcement.
2. ASTM A184 - Standard Specification for Fabricated Deformed Steel Bar Mats for Concrete Reinforcement.
3. ASTM A185 - Standard Specification for Steel Welded Wire Reinforcement, Plain, for Concrete.
4. ASTM A496 - Standard Specification for Steel Wire, Deformed, for Concrete Reinforcement.

5. ASTM A497 - Standard Specification for Steel Welded Wire Reinforcement, Deformed, for Concrete.
6. ASTM A615 - Standard Specification for Deformed and Plain Carbon-Steel Bars for Concrete Reinforcement.
7. ASTM A706 - Standard Specification for Low-Alloy Steel Deformed and Plain Bars for Concrete Reinforcement.

B. American Concrete Institute (ACI) Publication:

1. ACI SP-66 – ACI Detailing Manual.
2. ACI 318 – Building Code Requirements for Structural Concrete, as modified by CBC.

C. American Welding Society (AWS):

1. AWS D1.4 – Structural Welding Code – Reinforcing Steel.

1.04 SUBMITTALS

- A. Shop Drawings: Submit steel reinforcement Shop Drawings in accordance with ACI 315. Include assembly diagrams, bending charts and slab plans. Indicate lengths and location of splices, size and lengths of reinforcing steel.
- B. Closeout Submittals: Record exact locations of reinforcing that vary from Shop Drawings.

1.05 QUALITY ASSURANCE

- A. Comply with the following as a minimum requirement:
 1. Concrete Reinforcing Steel Institute (CRSI) Manual of Standard Practice.
 2. American Welding Society (AWS).
 3. American Concrete Institute (ACI).
 4. CBC, Chapter 19A, Concrete.
- B. Source Quality Control: Refer to Division 01 Sections for general requirements and to the following paragraphs for specific procedures. Testing laboratory retained by the OWNER shall select test Samples of bars, ties, and stirrups from the material at the Project Site or from the place of distribution, with each Sample consisting of not less

than two 18 inch long pieces, and perform the following tests according to ASTM A615, or ASTM A706, as applicable:

1. Identified Bars: If Samples are obtained from bundles as delivered from the mill, identified as to heat number, accompanied by mill analyses and mill test reports, and properly tagged with the identification certificate so as to be readily identified, perform one tensile and one bend test for each 10 tons or fraction thereof of each size of bars. Submit mill reports when Samples are selected.
 2. Unidentified Bars: When positive identification of reinforcing bars cannot be performed and when random Samples are obtained; perform tests for each 2.5 tons or fraction thereof, one tensile and one bend test from each size of bars.
- C. Certification of Welders: Shop and Project site welding shall be performed by welding operators certified by AWS.

1.06 DELIVERY, STORAGE AND HANDLING

- A. Avoid exposure to dirt, moisture or conditions harmful to reinforcing.
- B. Reinforcing steel bars, wire, and wire fabric shall be stored on the Project site to permit easy access for examination and identification of each shipment. Material of each shipment shall be separated for size and shape.

PART 2 - PRODUCTS

2.01 GENERAL

- A. Provide reinforcing of sizes, gages and lengths indicated, bent to indicated shapes.

2.02 MATERIALS

- A. Steel Reinforcing Bars: ASTM A615, or ASTM A706 deformed grade 60 billet steel unless otherwise specified or indicated.
- B. Bars or Rod Mats: ASTM A184.
- C. Welded Wire Fabric for Reinforcement: ASTM A185.
- D. Tie Wire: ASTM A82, fully annealed, copper-bearing steel wire, 16 gage minimum.
- E. Chairs, Spacers, Supports, and Other Accessories: Standard manufacture conforming to ACI 315 fabricated from steel wire of required types and sizes. For reinforcement supported from grade, provide properly sized dense precast blocks of concrete.

2.03 FABRICATION OF REINFORCING BARS

- A. Comply with CRSI Manual of Standard Practice for Reinforced Concrete Construction for fabrication of reinforcing steel.
- B. Bending and Forming: Fabricate bars of the indicated sizes and bend and form to required shapes and lengths by methods not injurious to materials. Do not heat reinforcement for bending. Bend bars No. 6 size and larger in the shop only. Bars with unscheduled kinks or bends are not permitted. Provide only tested and permitted bar materials.
- C. Welding: Provide only ASTM A706 steel where welding is indicated. Perform welding by the direct electric arc process in accordance with AWS D1.4 and specified low-hydrogen electrodes. Preheat 6 inches each side of joint. Protect joints from drafts during the cooling process; accelerated cooling is not permitted. Do not tack weld bars. Clean metal surfaces to be welded of loose scale and foreign material. Clean welds each time electrode is changed and chip burned edges before placing welds. When wire brushed, the completed welds must exhibit uniform section, smooth welded metal, feather edges without undercuts or overlays, freedom from porosity and clinkers, and good fusion and penetration into the base metal. Cut out welds or parts of welds deemed defective, using chisel, and replace with proper welding. Prequalification of welds shall be in accordance with CBC requirements.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. Bars shall be bent cold. Bars partially embedded in concrete shall not be field bent except as indicated on reviewed Shop Drawings.
- B. Before installation and just prior to placing concrete, clean reinforcing of loose scale, rust, oil, dirt and any coating that could reduce bond.
- C. Accurately position, install, and secure reinforcing to prevent displacement during the placement of concrete.
- D. Provide metal chairs to hold reinforcement the required distance above form bottoms. In beams and slab construction, provide chairs under top slab reinforcement as well as under bottom reinforcement. Space chairs so that reinforcement will not be displaced during installation. Provide metal spacers to secure proper spacing. Stirrups shall be accurately and securely wired to bars at both top and bottom. At slabs, footings, and beams in contact with earth, provide concrete blocks to support reinforcement at required distance above grade.
- E. Install and secure reinforcement to maintain required clearance between parallel bars and between bars and forms. Lapped splices shall be installed wherever possible in a

manner to provide required clearance between sets of bars. Stagger lapped splices. Dowels and bars extending through construction joints shall be secured in position against displacement before concrete is installed and subsequently cleaned of concrete encrustations while they are still soft.

- F. Do not install reinforcing in supported slabs and beams until walls and columns have been installed to underside of slabs and beams or until construction joints have been thoroughly cleaned. Reinforcing shall be inspected before placement of concrete and cleaned as required.
- G. Use deformed bars unless otherwise indicated, except for spiral reinforcement.

3.02 CLEAN UP

- A. Remove rubbish, debris and waste materials and legally dispose of off the Project site.

3.03 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 03 3000

CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Cast-in-place normal weight and lightweight concrete, placement and finishing.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 03 1000: Concrete Forming and Accessories.
3. Section 03 2000: Concrete Reinforcing.
4. Section 07 2600: Vapor Barriers.
5. Section 32 1313: Site Concrete Work.

1.02 REFERENCES

A. American Concrete Institute (ACI) Publication:

1. ACI 117 – Specifications for Tolerances for Concrete Construction and Materials.
2. ACI 301 – Specifications for Structural Concrete.
3. ACI 302.1R – Guide for Concrete Floor and Slab Construction.
4. ACI 305R - Specification for Hot Weather Concreting.
5. ACI 306.1 – Standard Specification for Cold Weather Concreting.
6. ACI 308R – Guide to External Curing of Concrete.
7. ACI 318 - Building Code Requirements for Structural Concrete, as modified by CBC Sections 1903A and 1905A.

B. American Society for Testing and Materials (ASTM) Standards:

1. ASTM C31 – Standard Specification for Making and Curing Concrete Test Specimens in the Field.

2. ASTM C33 - Standard Specification for Concrete Aggregates.
3. ASTM C39 - Standard Test Method for Compressive Strength of Cylindrical Concrete Specimens.
4. ASTM C42 - Standard Test Method for Obtaining and Testing Drilled Cores and Sawed Beams of Concrete.
5. ASTM C88 - Standard Test Method for Soundness of Aggregates by use of Sodium Sulphate or Magnesium Sulphate.
6. ASTM C94 - Standard Specification for Ready-Mixed Concrete.
7. ASTM C143 - Standard Test Method for Slump of Hydraulic Cement Concrete.
8. ASTM C150 - Standard Specification for Portland Cement.
9. ASTM C156 – Standard Test Method for Water Loss (from a Mortar Specimen) Through Liquid membrane-Forming Curing Compounds for Concrete.
10. ASTM C171 - Standard Specification for Sheet Materials for Curing Concrete.
11. ASTM C172 – Standard Practice for Sampling Freshly Mixed Concrete.
12. ASTM C173 – Standard Test Method for Air Content of Freshly Mixed Concrete by the Volumetric Method.
13. ASTM C260 – Standard Specification for Air-Entraining Admixtures for Concrete.
14. ASTM C289 - Standard Test Method for Potential Alkali-Silica Reactivity of Aggregates (Chemical Method).
15. ASTM C309 - Standard Specification for Liquid Membrane-Forming Compounds for Curing Concrete.
16. ASTM C330 - Standard Specification for Lightweight Aggregates for Structural Concrete.
17. ASTM C494 - Standard Specification for Chemical Admixtures for Concrete.
18. ASTM C567 - Standard Test Method for Determining Density of Structural Lightweight Concrete.
19. ASTM C618 - Standard Specification for Coal Fly Ash and Raw or Calcined Natural Pozzolan for Use in Concrete.
20. ASTM C845 - Standard Specification for Expansive Hydraulic Cement

21. ASTM C989 - Standard Specification for Ground Granulated Blast-Furnace Slag for Use in Concrete and Mortars.
22. ASTM C1107 - Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Nonshrink).
23. ASTM C1064 - Standard Test Method for Temperature of Freshly Mixed Hydraulic-Cement Concrete.
24. ASTM C1240 - Standard Specification for Silica Fume Used in Cementitious Mixtures.
25. ASTM C1315 – Standard Specification for Liquid Membrane-Forming Compounds Having Special Properties for Curing and Sealing Concrete.
26. ASTM D1308 – Standard Test Method for Effect of Household Chemicals on Clear and Pigmented Organic Finishes.
27. ASTM C1567 - Standard Test Method for Determining the Potential Alkali-Silica Reactivity of Combinations of Cementitious Materials and Aggregate (Accelerated Mortar-Bar Method).
28. ASTM D1751 - Standard Test Method for Preformed Expansion Joint Filler for Concrete Paving and Structural Construction (Non-extruding and Resilient Bituminous Types).
29. ASTM D7234 – Standard Test Method for Pull-Off Adhesion Strength of Coatings on Concrete Using Portable Pull-Off Adhesion Testers.
30. ASTM E96 - Standard Test Methods for Water Vapor Transmission of Materials.
31. ASTM E1155 - Standard Test Method for Determining F_F Floor Flatness and F_L Floor Levelness Numbers.
32. ASTM E1643 - Standard Practice for Selection, Design, Installation, and Inspection of Water Vapor Retarders Used in Contact with Earth or Granular Fill under Concrete Slabs.
33. ASTM E1745 - Standard Specification for Water Vapor Retarders Used in Contact with Soil or Granular Fill under Concrete Slabs.
34. ASTM F710 – Standard Practice for Preparing Concrete Floors to Receive Resilient Flooring.
35. ASTM F1869 – Standard Test Method for Measuring Moisture Vapor Emission Rate of Concrete Subfloor Using Anhydrous Calcium Chloride.

36. ASTM F2170 – Standard Test Method for Determining Relative Humidity in Concrete Floor Slabs Using In Situ Probes.
37. ASTM F3010 – Standard Practice for Two-Component Resin Based Membrane-Forming Moisture Mitigation Systems for Use under Resilient Floor Coverings.

1.03 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating locations of cast-in-place concrete Work and accessory items such as vapor barriers. Include details and locations of reinforcing, embedded items, and interfacing with other Work.
- B. Mix Design Data: Submit concrete mix designs as specified herein and in Article 2.02.
 1. Submit name, address and telephone number of the concrete production facility which the contractor intends to engage to design the concrete mixes. Submit name and qualifications of the proposed concrete technologist.
 2. Mix Design: Submit a concrete mix design for each strength and type of concrete indicated in the drawings or specified. Include water/cement ratio, source, size and amount of coarse aggregate and admixtures. Predict minimum compressive strength, maximum slump and air content percentage. Clearly indicate locations where each mix design will be used.
 - a. Water/cement ration for concrete slabs on grade shall be 0.50 maximum.
 3. Test Reports: Submit copies of test reports showing that the proposed mixes produce concrete with the strengths and properties specified. Include tests for cement, aggregates and admixtures. Provide gradation analysis.
- C. Material Samples: Submit Samples illustrating concrete finishes and hardeners, minimum 12-inch by 12-inch.
- D. Certificates: Submit certification that each of the following conforms to the standards indicated:
 1. Portland cement: ASTM C150.
 2. Normal weight concrete aggregates: ASTM C33.
 3. Lightweight concrete aggregates: ASTM C330.
 4. Aggregates: Submit evidence that the aggregate is not reactive in the presence of cement alkalis. In the absence of evidence, aggregate shall be tested by one of the methods in ASTM C33 Appendix XI, Methods for Evaluating Potential for Deleterious Expansion Due to Alkali Reactivity of an Aggregate. Aggregates deemed to be deleterious or potentially deleterious may be used with the addition of

a material that has been shown to prevent harmful expansion in accordance with Appendix XI of ASTM C33, when approved by the building official, in accordance to CBC Section 1903A5A.

5. Curing materials: ASTM C171.

E. Admixtures: Submit product data for proposed concrete admixtures.

1.04 QUALITY ASSURANCE

A. Continuous inspection shall be provided at the batch plant and for transit-mixed concrete to run check sieve analysis of aggregate, check moisture content of fine aggregate, check design of mix, check cement being used with test reports, check loading of mixer trucks, and certify to quantities of materials placed in each mixer truck.

B. Inspection shall be performed by a representative of a testing laboratory selected by the OWNER. OWNER will pay for inspection costs. Notify the laboratory 24 hours in advance of time concrete is to be mixed. Notify the laboratory of postponement or cancellation of mixing within at least 24 hours of scheduling time.

C. CONTRACTOR shall assist the testing laboratory in obtaining and handling samples at the project site and at the source of materials.

D. Continuous batch plant inspection requirement may be waived in accordance with CBC Section 1705A.3.3.1. Waiver shall be in writing. When batch plant inspection is waived by DSA, the following requirements shall be met:

1. Approved inspector of the testing laboratory shall check the first batching at the start of work and furnish mix proportions to the licensed weightmaster.

2. Licensed weightmaster shall positively identify materials as to quantity and certify to each load by a ticket.

3. Tickets shall be transmitted to the Inspector by a truck driver with load identified thereon. The Inspector will not accept the load without a load ticket identifying the mix and will keep a daily record of placements, identifying each truck, its load and time of receipt and approximate location of deposit in the structure.

E. Special Inspections and Tests shall be in accordance with CBC Chapter 17A, Reinforcement and Anchor testing per CBC Section 1910A and Specification Section 01 4523.

1.05 DELIVERY, STORAGE AND HANDLING

A. Store cement and aggregate materials so as to prevent their deterioration or intrusion by foreign matter. Deteriorated or contaminated materials shall not be furnished.

- B. Packaged materials shall bear the manufacturers and brand name label, and shall be stored in their original unbroken package in a weather tight place until ready for use in the work.

1.06 PROJECT CONDITIONS

- A. Cold Weather Requirements: Batching, mixing, delivering and placing of concrete in cold weather shall comply with the applicable requirements of ACI 306.1.
- B. Hot Weather Requirements: Batching, mixing, delivering and placing of concrete in hot weather shall comply with the applicable requirements of ACI 305R.
- C. Concrete temperature of freshly mixed concrete shall be determined per ASTM C1064.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Cement: ASTM C150. Portland Cement.
- B. Aggregates: Conform to the following standards:
 - 1. Normal weight concrete: ASTM C33.
 - 2. Lightweight concrete: ASTM C330, with fine aggregates per ASTM C33.
 - 3. Aggregate shall be tested for Potential Alkali Reactivity of Cement-Aggregate Combinations per ASTM C289.
 - 4. Nominal maximum size of coarse aggregate shall be no larger than:
 - a. 1/5 the narrowest dimension between sides of forms, nor
 - b. 1/3 the depth of slabs, nor
 - c. 3/4 the clear spacing between individual reinforcing bars or wires, bundles of bars, individual tendons, or ducts.
 - d. CONTRACTOR may request the ARCHITECT and DSA waiver of the above limitations reported per ACI 318, provided that the workability and methods of consolidation are such that the concrete can be placed without honeycombs or voids.
- C. Water: Water for concrete mixes, curing and cleaning shall be potable and free from deleterious matter.

- D. Admixtures: Shall be shown capable of maintaining essentially the same composition and performance throughout the work as the product used in establishing concrete proportions in accordance with ACI 318, Section 3.6.
1. Admixtures containing chlorides or sulfides are not permitted.
 2. Air-entraining admixtures shall comply with ASTM C260. Air-entrained admixtures shall not be used for floor slabs to receive steel trowel finish.
 3. Admixtures for water reduction and setting time modification shall conform to ASTM C494.
 4. Admixtures for producing flowing concrete shall conform to ASTM C1017.
 5. Fly ash, pozzolan and ground granulated blast-furnace slag: Modify ACI 318 Sections 3.6.6 and 3.6.7 as follows:
 - a. Fly ash or other pozzolan used as a partial substitution for ASTM C150 Portland cement shall meet the following requirements:
 - 1) Shall conform to ASTM C618 for Class N or F materials (Class C is not permitted).
 - 2) 15 to 20 percent by weight of fly ash or other pozzolans shall substitute for ASTM C150 Portland cement provided the mix design is proportioned per ACI 318, Section 318 5.3.
 6. Admixtures containing ASTM C845 expansive cements shall be compatible with the cement and produce no deleterious effects.
 7. Silica fumes used as an admixture shall conform to ASTM C1240.
- E. Reinforcement Fibers: Chop strands of alkali-resistant polypropylene or nylon fibers added to the concrete mix for protection against shrinkage cracks.
- F. Expansion Joint Fillers: Preformed strips, non-extruding and resilient bituminous type, of thickness indicated, conforming to ASTM D1751.
- G. Curing:
1. Curing Paper: Shall conform to ASTM C171 and consist of two sheets of kraft paper cemented together with a bituminous material in which are embedded cords or strands of fiber running in both directions. The paper shall be light in color, shall be free of visible defects, with uniform appearance.
 2. Elevated slabs and slabs on grade may be cured at CONTRACTOR's option with curing and proactive water vapor emission and alkalinity control system. Products shall be approved by OWNER.

- a. VaporSeal 309, by Floor Seal Technology, Inc., or equal.
 - 1) ASTM C156: 0.39 kg/m².
 - 2) ASTM C309: Exceeds requirements.
 - 3) ASTM C1315: Exceeds requirements.
 - 4) ACI 308R-01 Compliant.
 - b. Remedial Treatment: Water vapor emission and alkalinity control treatment, MES 100 by Floor Seal Technology, Inc. or equal.
 - 1) ASTM E96: <0.1 Perms.
 - 2) ASTM D1308: 14pH Resistant.
 - 3) ASTM D7234: 500+psi 100% concrete failure.
 - 4) ASTM F2170: 100%RH resistant.
 - 5) VOC Content: <100 g/L, meets SCAQMD Rule #1113.
 - 6) ASTM F3010: Meets Requirements.
 - c. Self-leveling Compounds: Ardex Engineered Cements, K15, or V1200, Schonox ZM Rapid, US Self Leveler Armstrong, S-194, or equal.
- H. Floor Hardener: Water soluble, inorganic, silicate-based curing, hardening, sealing and dustproofing compound. Aquaseal W20 by Monopole Inc., Kure-N-Harden by BASF, Chem Hard by L&M, Liqui-Hard by W. R. Meadows, or equal.
- I. Underlayment: Two component latex underlayment for filling low spots in concrete for both interior and exterior applications, from featheredge to a maximum of 3/8 inch in thickness. Underlayment shall be non-shrink and suitable for repairing exposed concrete surfaces and for underlayment of carpet, resilient, tile and quarry floor coverings. La-O-Tex by TexRite, Underlay C, RS by Mer-Krete Systems, Underlayment 962 by C-Cure, or equal.
- J. Vapor Barrier: Refer to Section 07 2600, Vapor Barriers.
- K. Stair Treads and Nosings: Two part stair tread and nosing with ribbed abrasive bars. Fabricated from 6063-T5 or 6063-T6 extruded aluminum, mill finish. Anti-slip abrasive filler consisting of aluminum oxide, silicon carbide, or a combination of both, in an epoxy-resin binder. Color shall extend uniformly throughout filler.
- 1. American Safety Tread: TP-311R.
 - 2. Balco Inc.: DST-330.

3. Nystrom: STTB-P3.375E.
 4. Wooster Products Inc.: WP-RN3SG.
 5. Equal.
- L. Grout: ASTM C1107, non-shrink type, pre-mixed compound consisting of non-metallic aggregate, cement, water reducing and plasticizing additives, capable of developing a minimum compressive strength of 7,000 psi at 7 days; of consistency suitable for application and a 30 minute working time.

2.02 CONCRETE MIX

- A. Mix shall be signed and sealed by a Civil or Structural Engineer currently registered in the State of California.
- B. Strength of Concrete: Strengths and types of concretes shall be as indicated in the Drawings. Unless otherwise indicated or specified, concrete shall be provided with minimum 28-day strength of 3000 psi (f'c).
- C. Concrete mix shall meet the durability requirements of ACI 318, Chapter 4.
- D. Concrete proportioning shall be determined on the basis of field experience and/or trial mixtures shall in accordance with ACI 318, Section 5.3. Proportions of materials shall provide workability and consistency to permit concrete to be placed readily into forms and around reinforcement under conditions of placement to be employed, without segregation or excessive bleeding.
- E. Ready-Mixed Concrete: Mix and deliver in accordance with requirements of ASTM C94.

PART 3 - EXECUTION

3.01 GENERAL

- A. Surfaces to receive concrete shall be free of debris, standing water, and any other deleterious substances before start of concrete placing.
- B. Time of Placing: Do not place concrete until reinforcement, conduits, outlet boxes, anchors, hangers, sleeves, bolts, and other embedded materials are securely fastened in place. Contact the Inspector at least 24 hours before placing concrete; do not place concrete until inspected by the Project Inspector.
- C. Pouring Record: A record shall be kept on the Project site of time and date of placing concrete in each portion of structure. Such record shall be maintained on the Project site until Substantial Completion and shall be available for examination by the ARCHITECT and DSA.

3.02 TOLERANCES

- A. Concrete construction tolerances shall be as specified in ACI 117 and as modified herein.
- B. Floor Flatness (F_F) and Floor Levelness (F_L) shall be as indicated below:

	Specified Overall Value		Minimum Local Value	
	F_F	F_L	F_F	F_L
Slabs on ground: mechanical and electrical rooms, parking structures and mortar bed set tile and quarry flooring.	20	15	15	10
Slab on ground: carpet.	25	20	17	15
Slab on ground: thinset tile and resilient flooring.	35	25	24	17
Suspended slabs: mechanical and electrical rooms, parking structures and mortar bed set tile and quarry flooring.	20	15	N/A	N/A
Suspended slabs: carpet.	25	20	N/A	N/A
Suspended slabs: thinset tile and resilient flooring.	35	20	N/A	N/A

- C. Refer to ACI 302.1R, Tables 8.1 and 8.2 Slab on Ground and Suspended Flatness/Levelness Construction Guide, for recommended concrete placing and finishing methods.
- D. Floor Flatness and Floor Levelness shall be tested in accordance to ASTM E1155. Floor measurements shall be made within 48 hours after slab installation, and shall precede removal of shores and forms.

3.03 PREPARATION

- A. For installation of vapor barrier refer to Section 07 2600, Vapor Barriers.
- B. Reglets and Rebates:
 - 1. Form reglets and rebates in concrete to receive flashing, frames and other equipment as detailed and required. Coordinate dimensions and locations required with other related Work.

2. If concrete slabs on grade adjoin a wall or other perpendicular concrete surface, form a reglet in wall to receive and carry horizontal concrete Work. Reglet shall be full thickness of the slab and shall be 3/4 inch wide, unless otherwise indicated. Requirement does not apply to exterior walks, unless specifically indicated.

- C. Screeds: Install screeds accurately and maintain at required grade or slab elevations after steel reinforcement has been installed, but before starting to place concrete. Install screeds adjacent to walls and in parallel rows not to exceed 8 feet on centers.

3.04 INSTALLATION

A. Conveying and Placing:

1. Concrete shall be placed only under direct observation of the Project Inspector. Do not place concrete outside of regular working hours, unless the Inspector has been notified at least 48 hours in advance.
2. Concrete shall be conveyed from mixer to location of final placement by methods that will prevent separation or loss of materials.
3. Concrete shall be placed as nearly as practicable to its final position to avoid segregation due to re-handling or flowing. No concrete that has partially hydrated or has been contaminated by foreign materials shall be placed, nor shall re-tempered concrete or concrete which has been remixed after initial set be placed.
4. In placing concrete in columns, walls or thin sections, provide openings in forms, elephant trunks, tremies or other recognized devices, to prevent segregation and accumulation of partially hydrated concrete on forms or metal reinforcement above level of concrete being placed. Such devices shall be installed so that concrete will be dropped vertically. Unconfined vertical drop of concrete from end of such devices to final placement surface shall not exceed 6 feet.
5. Concrete shall be placed as a continuous operation until placing of panel or section is completed. Top surfaces of vertically formed lifts shall be level.
6. Concrete shall be thoroughly consolidated by suitable means during placement, and shall be thoroughly worked around reinforcement and embedded fixtures and into corners of forms.
7. Where conditions make consolidation difficult or where reinforcement is congested, batches of mortar containing same proportions of cement, sand, and water as provided in the concrete, shall first be deposited in the forms to a depth of at least one inch.

B. Cold Weather:

1. Provide adequate equipment for heating concrete materials and protecting concrete during freezing or near-freezing weather. All ground with which

concrete is to come in contact shall be free from frost. No frozen materials or materials containing ice shall be used.

2. The temperature of concrete at the time of placement shall not be below the minimum temperatures given in Table 3.1 of ACI 306.1.
3. Concrete shall be maintained at a temperature of at least 50° F. for not less than 72 hours after placing or until it has thoroughly hardened. Cover concrete and provide sufficient heat as required. When necessary, aggregates shall be heated before mixing. Special precautions shall be taken for protection of transit-mixed concrete.

C. Hot Weather:

1. Concrete to be placed during hot weather shall comply with the requirements of ACI 318, Section 5.13.
2. Maintain concrete temperatures indicated in Table 2.1.5 of ACI 305R to prevent the evaporation rate from exceeding 0.2 pound of water per square feet of exposed concrete per hour.
3. Cool concrete using methods indicated in ACI 305R Appendix B.
4. Place and cure concrete as specified in ACI 305R Chapter 4.

D. Compaction and Screeding:

1. Tamp freshly placed concrete with a heavy tamper until at least 3/8 inch of mortar is brought to surface. Concrete shall then be tamped with a light tamper and screeded with a heavy straightedge until depressions and irregularities are eliminated, and surface is true to finish grades or elevations. Remove excess water and debris.
2. Where slabs are to receive separate cement finish or mortar setting bed, continued tamping to raise mortar to surface is not performed. Laitance shall be removed by brushing with a stiff brush or by light sandblasting to expose clean top surface of coarse aggregate.

E. Floating and Troweling:

1. When concrete has hydrated sufficiently, it shall be floated to a compact and smooth surface. After floating, wait until concrete has reached proper consistency before troweling. Top surfaces shall receive at least 2 troweling operations with steel hand trowel. Prior to and during final troweling, apply a fine mist of water frequently with an atomizing type fog sprayer. Omit troweling for slabs to receive a separate cement finish.
2. For interior finish slabs, final troweling shall provide a hard, impervious, and non-slip surfaces, free from defects and blemishes. Finished surface shall be within

tolerances indicated in Article 3.02. Avoid burnishing. Do not add cement or sand to absorb excess moisture.

- a. Floor of Walk-In Refrigerator: Finish as specified above, to a smooth finish.
 - b. Floor of Gymnasium Locker Rooms: After floating, and while the surface is still plastic, provide a fine textured finish by drawing a fine fiber bristle broom uniformly over the surface in one direction only. Floors sloped for drainage should be brushed in the direction of flow.
3. Vertical concrete surfaces shall be finished smooth and free from marks or other surface defects.

3.05 CURING

- A. Length of time, temperature and moisture conditions for curing concrete shall be in accordance with ACI 318, Section 5.11.
- B. Forms containing concrete, top of concrete between forms, and exposed concrete surfaces after removal of forms shall be maintained in a thoroughly wet condition for at least 7 consecutive days after placing.
- C. If weather is hot or surface has dried out, spray surface of concrete slabs and paving with fine mist of water, starting not later than 2 hours after final troweling and continuing until sunset. Surface of finish shall be kept continuously wet until curing medium has been installed.
- D. Immediately after finishing, monolithic floor slabs shall be covered with curing paper. Paper shall be lapped 4 inches at joints and sealed with waterproof sealer. Edges shall be cemented to finish. Repair or replace paper damaged during construction operations.
- E. When curing slabs with proactive water vapor emission and alkalinity control system:
 1. Coordinate and schedule application of curing compound with concrete pour schedule, while conforming to manufacturer's application instructions.
 2. When the surface of the concrete has hardened sufficiently to sustain foot traffic pre-cure slabs with liquefied product application following manufacturer's written instructions. Application shall be by trained applicators.
 3. Monitor Environmental Conditions: Set up weather station 20 to 30 inches above freshly placed concrete. Record temperature, humidity and wind velocity measurements at 15 minute maximum intervals.
 4. Calculate Evaporation Rate: Use recorded weather information in combination with nomograph per ACI 308R, Figure 4.1, Guide to Curing Concrete, to evaluate relevant evaporation rate.

5. When the bleed water rate of the concrete is approximately equal to the surface water evaporation rate, spray curing compound material throughout surface of slabs and decks, following manufacturer's written instructions. Application shall be by trained applicators.
6. Perform the following tests at least 28 days after placement of concrete and prior to floor covering installation. Submit to OWNER test results indicating locations that do not comply with scheduled flooring installation requirements.
 - a. Calcium chloride testing per ASTM F1869.
 - b. Relative humidity testing per ASTM F2170.
 - c. Alkalinity testing per ASTM F710.
 - d. Perform concrete bond layer humidity meter testing to determine substrate surface acceptability.
7. Areas emitting moisture and alkalinity at rates exceeding floor covering manufacturer's published ASTM F1869 limits, shall receive a corrective coating, at no cost to the OWNER, as follows:
 - a) Mask and protect adjacent walls and floor surfaces from effects of scarification and application of remedial treatment.
 - b) Scarify slab surface in area of application by shot blasting or other method acceptable to corrective coating manufacturer.
 - c) Prepare and fill cracks, control joints and cold joints.
 - d) Apply two-component modified epoxy penetrant and coating with roller and squeegee over required treatment area; saturate surfaces to ensure a through mechanical bond.
 - e) Clean and fill divots, chips, voids and other surface irregularities with one hundred percent Portland cement based patching compound or cementitious fill.
 - f) Apply cementitious surfacing over coating in areas to receive resilient and wood floor coverings to facilitate adhesion; apply to a thickness of 1/8 inch.

3.06 FILLING, LEVELING AND PATCHING

- A. Concrete slabs exhibiting high or low spots and indicated to receive resilient floor covering or soft floor covering, shall have surfaces repaired. High spots shall be honed, or ground with power-driven machines to required tolerances. Low spots shall be filled with latex underlayment, installed in strict accordance with manufacturer's written recommendations.

- B. Holes resulting from form ties or sleeve nuts shall be solidly packed, through exterior walls, by pressure grouting with cement grout, as specified. Grouted holes on exposed surfaces shall be screeded flush and finished to match adjoining surfaces.
- C. Cement Base: Cement base shall be of the height, thickness, and shape detailed. Base shall be reinforced with one inch mesh, 18 gage, zinc-coated wire fabric. Base finish mixture shall be one part Portland cement, 2 parts of fine aggregate and one part pea gravel. Colored cement base shall include a chemically inert mineral oxide pigment in the mix.

3.07 FINISHING

- A. Soda and Acid Wash: Concrete surfaces to receive plaster, paint or other finish, and which have been formed by oil coated forms, shall be scrubbed with a solution of 1-1/2 pounds of caustic soda to one gallon of water. Surfaces where smooth wood or waste molds have been furnished shall be scrubbed with a solution of 20 percent muriatic acid. Wash with clean water after scrubbing.
- B. Sacking: Exposed concrete curbs, walls, and other surfaces shall be sacked by an application of Portland cement grout, floated, and rubbed. Sacking shall not be performed until patching and filling of holes has been completed. Entire sacking operation for any continuous area shall be started and completed within the same day.
 - 1. Mix one part Portland cement and 1-1/2 parts fine sand with sufficient water to produce a grout having consistency of thick paint. Wet surface of concrete sufficiently to prevent absorption of water from grout. Apply grout uniformly with a brush or spray gun, then immediately float surface with a cork or other suitable float, scouring wall vigorously.
 - 2. While grout is still plastic, finish surface with a sponge-rubber float, removing excess grout. Allow surface to dry thoroughly, then rub vigorously with dry burlap to completely remove dried grout. No visible film or grout shall remain after rubbing with burlap.
- C. Sandblasting: Exterior concrete surfaces to receive stucco dash coat finish, where plywood or other smooth forms have been furnished, shall be uniformly sand-blasted with sharp quartz sand under sufficient air pressure to remove dirt, form oil and other foreign materials, and roughen surface to provide a proper bond. Such surfaces shall be thoroughly washed with clean water after sandblasting.
- D. Abrasive: Concrete stair treads, landings, ramps and steps on interior and exterior of buildings, and interior exposed concrete floors in shop buildings shall receive an abrasive finish.
- E. Floor Hardener: Exposed interior concrete floors throughout shall be treated with floor hardener.

1. Protect adjacent surfaces. Clean surfaces to receive treatment in accordance with manufacturer's instructions, ensuring that all stains, oil, grease, form release agents, laitance, dust and dirt are removed prior to application.
 2. Apply hardener in accordance with manufacturer's instructions as soon as concrete is firm enough to work on after final troweling.
- F. Cement Grout and Dry-Pack Concrete: Cement grout shall be mixed at the Project site and shall be composed of one volume of Portland cement and 2-1/2 volumes of fine aggregate. Materials shall be mixed dry with sufficient water added to make mixture flow under its own weight. When grout is used as a dry pack concrete, add sufficient water to provide a stiff mixture, which can be molded into a sphere.
- G. Broom Finish: Exterior stair treads and landings shall be provided with a non-slip broom finish in addition to abrasive finish specified.
- H. Abrasive Stair Nosing: Nosing shall be installed according to manufacturers written recommendations.

3.08 EXPANSION AND CONSTRUCTION JOINTS

- A. Construction Joints: Details and proposed location of construction joints shall be as indicated on the Drawings, located to least impair strength of structure, in accordance with the following:
1. Thoroughly clean contact surface by sand blasting entire surface not earlier than 5 days after initial placement.
 2. A mix containing same proportion of sand and cement provided in concrete plus a maximum of 50 percent of coarse aggregate shall be placed to a depth of at least one inch on horizontal joints. Vertical joints shall be wetted and coated with a neat cement grout immediately before placing of new concrete.
 3. Should contact surface become coated with earth, sawdust, or deleterious material of any kind after being cleaned, entire surface shall be re-cleaned before applying mix.
- B. Expansion Joints: Provide expansion joints where indicated in walks and exterior slabs. Space approximately 20 feet apart, unless otherwise indicated. Joints shall extend entirely through slab with joint filler in one piece for width of walk or slab. Joint filler shall be 3/8 inch thick, unless otherwise indicated.
- C. Tooled Joints: Slabs, walks and paving shall be marked into areas as indicated with markings made with a V-grooving tool. Marks shall be round-edged, free from burrs or obstructions, with clean cut angles and shall be straight and true. Walks, if not indicated, shall be marked off into rectangles of not more than 12 square feet and shall have a center marking where more than 5 feet wide.

3.09 TESTING

A. Molded Cylinder Tests:

1. Inspector or testing lab personnel will prepare cylinders and perform slump tests. Samples for concrete strength shall be taken in accordance to ASTM C172. Each cylinder shall be dated, given a number, point in structure from which sample was obtained, mix design number, mix design strength and result of accompanying slump test noted.
2. Separate tests of molded concrete cylinders obtained at same place and time shall be made at age of three days, seven days, and 28 days. A strength test shall be the average of the compressive strength of two cylinders, obtained from the same sample of concrete and tested at 28 days or at test age designated for determination of f_c .
3. Test cylinders shall be prepared at the Project site and stored in testing laboratory in accordance with ASTM C31, and tested in accordance with ASTM C39.

B. Core Test: At request of the ARCHITECT, cores of hardened concrete shall be cut from portions of hydrated structures for testing, in accordance with CBC and ASTM C42.

1. Provide 4 inch diameter cores at representative places throughout the structure as designated by the ARCHITECT.
2. In general, provide sufficient cores to represent concrete placed with at least one core for each 4,000 square feet of building area, and at least 3 cores total for each Project.
3. Where cores have been removed, fill voids with drypack, and patch the finish to match the adjacent existing surfaces.

C. Concrete Consistency: Measure consistency according to ASTM C143. Test twice each day or partial day's run of the mixer.

D. Adjustment of Mix: If the strength of any grade of concrete for any portion of Work, as indicated by molded test cylinders, falls below minimum 28 days compressive strength specified or indicated, adjust mix design for remaining portion of construction so that resulting concrete meets minimum strength requirements.

E. Air Content Testing: Measure in accordance to ASTM C173 or ASTM C231, for each composite sample taken in accordance to ASTM C172.

F. Defective Concrete:

1. Should strength of any grade of concrete, for any portion of Work indicated by tests of molded cylinders and core tests, fall below minimum 28 days strength specified

or indicated, concrete will be deemed defective Work and shall be replaced or adequately strengthened in a manner acceptable to the ARCHITECT and DSA.

2. Concrete Work that is not formed as indicated, is not true within 1/250 of span, not true to intended alignment, not plumb or level where so intended, not true to intended grades and levels, contains sawdust shavings, wood or embedded debris, or does not fully conform to Contract provisions, shall be deemed to be defective Work and shall be removed and replaced.
- G. Concrete for Equipment Pads, Mechanical and Electrical Work: Unless otherwise indicated, strength shall have a minimum $f'c = 3,000$ psi. Exposed concrete shall be provided with a hand trowel finish with radius corners and edges. Form and place concrete where necessary as described in Section 03 1000 Concrete Forming and Accessories, and reinforced as described in Section 03 2000 Concrete Reinforcing. Calcium chloride shall not be furnished in any concrete mix provided for the installation of underground electrical conduits. For concrete encasement of more than one conduit, furnish 3/4 inch maximum aggregate.

3.10 CLEAN UP

- A. Remove rubbish, debris and waste materials and legally dispose of off the Project site.

3.11 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 04 2200

CONCRETE UNIT MASONRY

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Concrete masonry units.
2. Reinforcing steel.
3. Mortar, grout and grouting.
4. Bolts, anchors, hardware, metal frames, and other insert items.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 01 4523 - Testing and Inspection.
3. Section 03 1000 - Concrete Forming and Accessories.
4. Section 03 2000 - Concrete Reinforcing.
5. Section 03 3000 - Cast-In-Place Concrete.
6. Section 05 1000 - Structural Steel Framing.
7. Section 08 1113 - Hollow Metal Doors and Frames.

1.02 REFERENCES

A. American Society for Testing and Materials International (ASTM):

1. ASTM A307 - Standard Specification for Carbon Steel Bolts and Studs, 60 000 PSI Tensile Strength.
2. ASTM C90 - Standard Specification for Load Bearing Concrete Masonry Units.
3. ASTM C94 - Standard Specification for Ready-Mixed Concrete.

4. ASTM C140 - Standard Test Methods for Sampling and Testing Concrete Masonry Units and Related Units.
 5. ASTM C144 - Standard Specification for Aggregate for Masonry Mortar.
 6. ASTM C150 - Standard Specification for Portland Cement.
 7. ASTM C207 - Standard Specification for Hydrated Lime for Masonry Purposes.
 8. ASTM C270 - Standard Specification for Mortar for Unit Masonry.
 9. ASTM C404 - Standard Specification for Aggregates for Masonry Grout.
 10. ASTM C426 - Standard Test Method for Linear Drying Shrinkage of Concrete Masonry Units.
 11. ASTM C476 - Standard Specification for Grout for Masonry.
 12. ASTM C780 - Standard Test Method for Preconstruction and Construction Evaluation of Mortars for Plain and Reinforced Unit Masonry.
 13. ASTM C1019 - Standard Test Method for Sampling and Testing Grout.
 14. ASTM C1314 - Standard Test Method for Compressive Strength of Masonry Prisms.
 15. ASTM C1586 – Standard Guide for Quality Assurance of Mortars.
- B. Masonry Standards Joint Committee (MSJC), the Masonry Society (TMS), American Concrete Institute (ACI) and American Society of Civil Engineers (ASCE).
1. TMS 602/ACI 530.1/ASCE 6 – Specification for Masonry Structures.
 2. TMS 402/ACI 530/ASCE 5 – Building Code Requirements for Masonry Structures.

1.03 SUBMITTALS

- A. Mix Design: Submit grout and mortar mix designs. Mix designs shall be signed and sealed by a Civil or Structural Engineer registered in the State of California.
- B. Product Data: Submit manufacturer's Product Data for assembly components, materials, and accessories. Submit certificates and data assuring that the proposed materials meet the specified ASTM standards.
- C. Samples: Submit Samples for each type of required masonry unit, including reinforcement and accessories.

- D. Shop Drawings: Indicate wall reinforcement, splice locations and bending diagrams.
- E. Admixtures: Additives and admixtures to mortar and grout shall not be used unless approved by the enforcing agency. Submit product data for any proposed admixture.

1.04 REGULATORY REQUIREMENTS

- A. Perform the Work in accordance with CBC, Chapter 21A.
- B. Comply with requirements of TMS 602.

1.05 QUALITY ASSURANCE

- A. Comply with the requirements of Section 01 4523 - Testing and Inspection.
- B. Concrete Masonry Units:
 - 1. Notify the testing laboratory a minimum of 45 days in advance of installing concrete unit masonry, to allow for preconstruction testing of the units.
 - a. Units will be sampled and tested in accordance with ASTM C140 for compressive strength, absorption and moisture content.
 - b. Units will be sampled and tested in accordance with ASTM C426 for linear drying shrinkage.
 - 2. The material testing laboratory shall receive concrete masonry unit specimens for testing from masonry unit manufacturer. Number of specimens shall be as indicated in referenced ASTM standard tests. Testing laboratory will perform and send test results to the ARCHITECT and Project Inspector.
- C. Portland Cement: Submit certification from the cement manufacturer that the cement proposed for use on the project has been manufactured in accordance with ASTM C150. Certification shall include test results made on cement samples during production.
- D. Mortar and Grout Tests: Prior to the beginning of masonry work, mortar and grout will be tested, unless prism tests will be performed as indicated below.
 - 1. Mortar: Shall conform to ASTM C270 Table 2 for Type S mortar.
 - a. Provide qualifications of mortar as meeting ASTM C270 at the beginning of the job and whenever mix design is changed.
 - b. Mortars will be evaluated during preconstruction and tested during construction for proportioning or compressive strength in accordance to ASTM C780.

2. Grout: Shall conform to ASTM C476, and will be tested in accordance with ASTM C1019. Compressive strength shall equal or exceed specified compressive strength ($f'm$) at 28 days, but not less than 2,000 psi.
 - a. Ready-Mix Grout: Grout manufacturer shall furnish batch ticket information in accordance to ASTM C94.
- E. Prism Test: The compressive strength of concrete masonry will be determined by the prism test method prior to the start of construction and during construction.
- F. Masonry Core Testing: Core testing will be performed in accordance with CBC, Section 2105A.4.
- G. Inspection During Installation: A special inspector will continuously observe the installation of reinforced masonry. The Project Inspector shall be responsible for monitoring the work of the special inspector and testing laboratories to ensure that the testing program is satisfactorily completed.
- H. OWNER will be responsible for the costs of original tests and inspection.

1.06 DELIVERY, STORAGE AND HANDLING

- A. Store units above grade on level platforms or pallets, in a dry location.
- B. Store cementitious materials and aggregates in such a manner as to prevent deterioration or intrusion of foreign matter or moisture.
- C. Handle units on pallets or flat bed barrows. Free discharge from conveyor units or transportation in mortar trays is not permitted.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Concrete Unit Masonry: Modular **normal** weight conforming to ASTM C90, hollow load-bearing concrete unit masonry. Masonry units shall meet the minimum compressive strength requirements of ASTM C90, or as indicated on project drawings, whichever is greater.
 1. Concrete masonry unit sizes shall be as indicated on the drawings.
 2. Provide open-end units at walls to be fully grouted.
 3. Provide closed-end units at walls and at openings where ends will be exposed in finish Work; provide bond beam blocks where horizontal reinforcement is indicated.

4. Provide special shapes and accessory units at locations indicated on Drawings.
 5. Provide smooth texture units, color shall be Angelus Block OAK or equal.
 6. Masonry unit shall have been cured for a minimum of 28 days.
 7. Masonry unit shall have maximum liner shrinkage of 0.065 percent from saturated to oven dry.
- B. Portland Cement: ASTM C150, Type II, from one source.
- C. Hydrated Lime: ASTM C207, Type S.
- D. Aggregates: ASTM C144 for mortar and ASTM C404 for grout.
- E. Mortar: ASTM C270, Type S, conforming to the property specifications of CBC Table 2103A.8 (2).
- F. Grout: ASTM C476.
- G. Admixture for Grout: Grout Aid, as manufactured by Sika Chemical Corp., or equal.
- H. Water: Clean, potable, free from substances deleterious to mortar, grout or reinforcement.
- I. Reinforcing Steel: Provide and install reinforcing steel in accordance with Section 03 2000 - Concrete Reinforcing.
- J. Cleaning Materials: Sure Klean No. 600 detergent by ProSoCo.
- K. Miscellaneous Materials: As required to complete the Work.
- L. Anchor Bolts: Shall be hex headed bolts conforming to ASTM A307 Grade A with the dimensions of the hex head conforming to ANSI/ASME B18.2.1.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Discard units with cracks or other defects not complying with requirements of ASTM C 90.

3.02 CONSTRUCTION

- A. Construct per applicable provisions of CBC and TMS 602.
- B. Conform to TMS 602 for hot and cold weather masonry construction.

3.03 MORTAR AND GROUT MIXING

- A. Mortar: Shall provide a minimum strength of 1,800 psi.
- B. Grout: Shall provide a minimum strength of 2,000 psi or as indicated in the drawings, whichever is higher. Grout space requirements for coarse and fine grouts shall be per Table 7 of TMS 602. Add Sika Chemical Corp. Grout Aid per manufacturer's instructions.
- C. Measurements: Measure in calibrated devices that can be checked at any time.
 - 1. Add water for workable consistency.
 - 2. Shovel measurements are not permitted.
- D. Mixing: Mix in accordance to TMS 602.
 - 1. Mortar: Mix cementitious materials and aggregates between three and five minutes in a mechanically operated mixer. Mix dry ingredients with a sufficient amount of water to provide a workable mix. Batches of less than one sack of cement, and fractional sack batches are not permitted.
 - 2. Factory Blended Mortar: Mix in accordance with manufacturer's recommendations.
 - 3. Grout: Add sufficient water for a workable mix that will flow into all voids of the masonry without separation or segregation. Grout slump shall be between 8 and 11 inches.
- E. Re-tempering Time Limit: Use mortar within 2 ½ hours after mixing. Discard any mortar that has been mixed longer or that has begun to set. If necessary re-temper within this time limit, by replacing only water lost due to evaporation and by thoroughly remixing.

3.04 INSTALLATION OF MASONRY UNITS

- A. Workmanship: Install masonry plumb and true to line with straight level joints of uniform thickness. Comply with TMS 602 tolerances. Maintain masonry clean during and after installation.
 - 1. Lay-out and incorporate embedded hardware items.
 - 2. Assist other trades with built-in items, which require cutting and fitting of masonry.
 - 3. Cut block units with a diamond saw or carborundum wheel. Trowel or chisel cutting is not permitted.

4. Keep cavities clear of droppings and debris. Remove droppings prior to grouting.
- B. Reinforcing Steel: Install as indicated on Drawings. Except as otherwise indicated, install reinforcement in accordance with standards of Concrete Reinforcing Steel Institute and to requirements specified in Section 03 2000 - Concrete Reinforcing. Do not splice vertical reinforcement except where indicated on the Drawings.
- C. Shoring: Provide temporary shoring for lintels with sufficient strength to carry load without deflecting. Remove temporary shoring not less than 28 days after masonry has been installed.
- D. Block Installation: Clean dirt and dust from surfaces before installation. Do not wet masonry units.
1. Foundation preparation: Clean top surface of concrete foundation of dirt, projections and laitance before starting masonry construction. Wet saw cutting of units immediately prior to laying is permitted.
 2. Install masonry with mortar to required joint thickness. Install blocks with 3/8-inch mortar bed. Fill head joints solid, install tightly to adjoining units. Provide 3/8-inch joint thickness.
 - a. Hold racking to a minimum.
 - b. No toothing is permitted.
 - c. If it becomes necessary to move a unit after it has been installed, remove the unit, discard the mortar, and install the unit in fresh mortar.
 3. Anchor Bolts: Provide 1/2-inch minimum grout space between bolts and masonry.
 4. Bond: Unless otherwise indicated, install units in common running bond.
 5. Finish Joint Treatment: Unless otherwise indicated, cut both interior and exterior joints flush, and tool slightly concave to a dense, uniform surface.
 6. Grouting: Unless noted otherwise on Drawings, completely fill cells with grout.
- E. Steel Door Frames:
1. Locate door frames accurately, install plumb, Set frames to floor with powder driven or expansion anchors to floor surface and brace in position before start of masonry installation.
 - a. Frames are specified to be furnished with adjustable anchors.

- b. Fill interior of frames solid with mortar or grout as walls are constructed.
2. Provide temporary wood spreaders from jamb to jamb and from head to floor to ensure that jambs do not bow-in, distort from a straight line, or deflect from superimposed loads during construction.

3.05 GROUTING

- A. Prior to grouting all cells shall be cleaned so that all spaces to be filled with grout do not contain mortar projections greater than 1/4 inch, loose mortar or foreign material.
- B. Grout materials and water contents shall be controlled to provide adequate fluidity for placement without segregation of the constituents, and shall be mixed thoroughly. Reinforcement shall be properly positioned and solidly embedded in the grout.
- C. The grouting of any section of wall shall be completed in one day with no interruptions greater than one hour.
- D. Between grout pours, a horizontal control joint shall be formed by stopping all wythes at the same elevation and with the grout stopping at 1 1/2 inches below a mortar joint, except at the top of the wall. Where bond beams occur, the grout pour shall be stopped a minimum of 1/2 inch below the top of the masonry.

3.06 LOW-LIFT GROUTING FOR HOLLOW MASONRY UNITS

- A. Grouting shall meet the requirements of CBC Section 2104A.1.3.
- B. After mortar joints have set, cells are cleaned of mortar and debris, and reinforcement is installed and inspected, grout cells in 4-foot maximum lifts. Horizontal and vertical reinforcement shall be held in place within permitted tolerances by suitable devices.
- C. Grout may be installed by pump, tremie or bucket, using hoppers to avoid spilling on exposed surfaces.
- D. All grout shall be consolidated and reconsolidated with a mechanical vibrator after placing so as to completely fill all voids and to consolidate the grout. Grouted walls shall be solid and without voids.

3.07 HIGH-LIFT GROUTING OPTION FOR HOLLOW MASONRY UNITS

- A. Grouting shall meet the requirements of CBC Section 2104A.1.3 and DSA IR 21-2.
- B. High-lift grouting shall apply only to cell sizes available with 8 inch and wider block units. This method is subject to approval of the Division of the State Architect (DSA).

- C. Provide bond beam units, inverted for start course, and omit alternate blocks or remove entire face shell of every other unit to allow access to all cells on bottom course for cleanouts.
- D. Plug each cleanout by setting a face shell in mortar into opening and securely bracing it in place to prevent displacement. If masonry is not exposed in finish Work, cleanouts may be formed.
- E. Grouting: Grouting shall be done in a continuous pour in lifts not exceeding 5-foot in height. The grouting of any section of a wall between control barriers shall be completed in one day, with no interruptions greater than one hour.
- F. Consolidating: Grout shall be consolidated by mechanical vibration only, and shall be reconsolidated after excess moisture has been absorbed, but before plasticity is lost. Vibrating of reinforcing steel is not permitted.

3.08 CURING

- A. Remove efflorescence, stains, debris, excess grout, and foreign matter.
- B. During curing, or for any other purpose, do not saturate masonry with water.

3.09 PARGE COAT

- A. Apply parge coat to the earth side of surfaces that are to receive waterproofing.
- B. A Portland cement and sand mix (1:3.5 by volume) or Type S mortar may be used for the parge coat.
- C. Parging should be applied to damp (not saturated) concrete masonry in two 1/4 inch thick layers. The first coat should be roughened when partially set, hardened for 24 hours, and then moistened before second coat is applied. The second coat should be trowelled to a smooth, dense surface.
- D. The parge coat should be beveled at the top to form a wash, and thickened at the bottom to form a cove between the base of the wall and the top of footing.

3.10 CLEANING

- A. At completion of masonry Work, remove misplaced mortar, grout or other foreign substances, and clean surfaces which will be exposed in finish Work with specified cleaner, or with clean water and stiff fiber brushes.
- B. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

3.11 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 05 0513
HOT-DIP GALVANIZING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Hot-dip galvanizing of structural steel articles.
2. Hot-dip galvanizing of fabricated steel assemblies.
3. Hot-dip galvanizing of fencing steel assemblies.
4. Preparation of galvanized steel assemblies for painting.

B. Related Sections:

1. Division 01 - General Requirements.
2. Section 05 1200: Structural Steel Framing.
3. Section 05 5000: Metal Fabrications.
4. Section 09 9000: Painting and Coating.

1.02 REFERENCES

A. American Galvanizers Association (AGA):

1. Inspection of Products Hot-dip Galvanized after Fabrication.
2. The Design of Products to be Hot-dip Galvanized after Fabrication.
3. Recommended Details of Galvanized Structures.

B. ASTM International (ASTM):

1. ASTM A123 – Standard Specification for Zinc (Hot-Dipped Galvanized) Coatings on Iron and Steel Products.
2. ASTM A143 – Standard Practice for Safeguarding Against Embrittlement of Hot-Dip Galvanized Structural Steel Products and Procedure for Detecting Embrittlement.

3. ASTM A153 – Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware.
4. ASTM A384 – Standard Practice for Safeguarding Against Warpage and Distortion during Hot-Dip Galvanizing of Steel Assemblies.
5. ASTM A385 – Standard Practice for Providing High-Quality Zinc Coatings (Hot-Dip).
6. ASTM A780 – Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings.
7. ASTM B6 – Standard Specification for Zinc.
8. ASTM D6386 – Standard Practice for Preparation of Zinc (Hot-Dip Galvanized) Coated Iron and Steel Product and Hardware Surfaces for Painting.
9. ASTM D7803 - Standard Practice for Preparation of Zinc (Hot-Dip Galvanized) Coated Iron and Steel Product and Hardware Surfaces for Powder Coating.
10. ASTM E376 - Measuring Coating Thickness by Magnetic-Field or Eddy-Current (Electromagnetic) Test Methods.

C. The Society for Protective Coatings (SSPC):

1. SSPC-SP1 – Solvent Cleaning.
2. SSPC-SP2 – Hand Tool Cleaning.
3. SSPC-SP3 – Power Tool Cleaning.
4. SSPC-SP5 – White Metal Blast Cleaning.
5. SSPC-SP7 – Brush-Off Blast Cleaning.
6. SSPC-SP10 – Near White Blast Cleaning.
7. SSPC-SP11 – Power Tool Cleaning to Bare Metal.
8. SSPC-SP16 - Brush-Off Blast Cleaning of Coated and Uncoated Galvanized Steel, Stainless Steels, and Non-Ferrous Metals.

1.03 COORDINATION WITH STEEL FABRICATOR

- A. Prior to fabrication, steel fabricators shall submit approved fabrication shop drawings to the galvanizer. The Galvanizer shall review fabricator shop drawings for suitability of materials for galvanizing and coatings and coordinate any required fabrication modifications.

- B. Steel Fabricator shall notify the galvanizer of steel fabrications that exceed the ASTM A385 recommended percentages for carbon, phosphorus, manganese and silicon, so special galvanizing processing techniques are used.
- C. Coordinate with steel fabricator appropriate marking and masking materials.

1.04 QUALITY ASSURANCE

- A. Coating Applicator: Company specializing in hot-dip galvanizing after fabrication following the procedures in the Quality Assurance Manual of the American Galvanizers Association.
- B. Galvanizer shall have an in-plant inspection program designed to maintain the coating thickness, finish, and appearance within the requirements of this Section.

1.05 SUBMITTALS

- A. Galvanizing Certificate of Compliance: Provide notarized Certificate of Compliance with ASTM standards and specifications herein listed. The Certificate shall be signed by the galvanizer and contain a detailed description of the material processed. The Certificate shall include information as to the ASTM standard used for the coating.

1.06 DELIVERY, STORAGE AND HANDLING

- A. Package and handle galvanized material in a manner which will avoid damage to the zinc coating.
- B. Store in dry, well-ventilated conditions until shipping.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Steel for Galvanizing: As specified in Sections:
 - 1. Section 05 1200: Structural Steel Framing.
 - 2. Section 05 5000: Metal Fabrications.
- B. Zinc for Galvanizing: Conform to ASTM B6, as specified in ASTM A123.

PART 3 – EXECUTION

3.01 PREPARATION

- A. Remove welding slag, splatter, anti-splatter compounds and burrs remaining in steel articles.

- B. Provide drainage and venting holes in tubular assemblies. In thicker material drill holes in place of punching. Holes shall have a relatively uniform circumference. Punched holes or burned holes with a plasma torch shall be treated with a drill to even the diameter to appropriate size.
- C. Masking installed by steel fabricator shall remain in place through galvanizing process completion.
- D. Provide lifting lugs to allow for handling during galvanizing. Avoid the use of chains or wires directly connected to steel articles.
- E. Safeguard against warpage or distortion of steel members in accordance with ASTM A384.
- F. Pre-clean steel work in accordance with accepted methods to produce an acceptable surface for quality hot-dip galvanizing. Remove surface contaminants and coatings that are not removable by the normal chemical cleaning process in the galvanizing operation by grit-blasting, sand-blasting, or other mechanical means.
- G. Follow the degreasing, pickling and fluxing steps to remove remaining oxides and to deposit a protective layer on the steel to prevent any further oxides from forming on the surface prior to immersion in the molten zinc.

3.02 COATING APPLICATION

- A. Galvanize steel articles, fabrications and assemblies by the hot-dip process in accordance with ASTM A123. The bath chemistry shall be as specified by ASTM B6, and requires at least 98% pure zinc maintained at approximately 840 F.
- B. Galvanize bolts, nuts, washers and iron and steel hardware components in accordance with ASTM A153.
- C. Safeguard products against steel embrittlement in conformance with ASTM A143.
- D. Once the fabricated items' coating growth is complete, withdraw slowly from the galvanizing bath, and remove the excess zinc by draining, vibrating, and/or centrifuging.
- E. Prepare galvanized products for powder coating in accordance to ASTM D7803. Prepare galvanized products for painting in accordance to ASTM D6386.
- F. Handle articles to be galvanized in such a manner as to avoid mechanical damage and to minimize distortion.
- G. Apply a chromate passivation treatment to fabrications that will not be painted after galvanizing to minimize the wet storage staining which may occur on articles unable to be stored in dry, well-ventilated conditions.

3.03 COATING REQUIREMENTS

- A. Conform to paragraph 6.1 of ASTM A123, or Table 1 of ASTM A153, as applicable.

- B. Surface Finish: Continuous, adherent, as smooth and evenly distributed as possible and free from any defect detrimental to the stated end use of the coated article
- C. Adhesion: Withstand normal handling consistent with the nature and thickness of the coating and normal use of the article.

2.04 TESTS

- A. Inspection and testing of hot-dip galvanized coatings shall be done under the guidelines provided in the AGA publication Inspection of Products Hot-dip Galvanized after Fabrication. Tests and inspections shall be performed immediately after the coating is applied and has cooled to ambient temperature, and before it leaves the galvanizing facility.
- B. Include visual examination and test methods in accordance with ASTM A123, or A153, as applicable, to determine the thickness of the zinc coating on the metal surface.
- C. During the visual inspection, if adhesion concerns are suspected, such as peeling or flaking of the galvanized coating, then adhesion testing using the stout knife method shall be conducted. Embrittlement testing is required when there is evidence of embrittlement and shall be conducted per the requirements of ASTM A143.
- D. Upon completion of tests furnish notarized Certificate of Compliance with ASTM standards and specifications herein listed.

3.05 REPAIR OF DAMAGED COATINGS

- A. Smooth out rough surfaces, bumpy or high spots and icicles by hand filing or power sanding the area without removing any more zinc coating than necessary. Repair damaged galvanized surface with a zinc rich coating.
- B. Repair areas damaged during galvanizing process or handling by one of the approved methods in accordance with ASTM A780 whenever damage exceeds 3/16" in width. Minimum thickness requirements for the repair shall be per ASTM A123, Section 6.2.
- C. Remove lifting lugs and repair coating with a zinc rich coating.
- D. Surface preparation for application of zinc rich coating shall be in accordance to ASTM A780.
 - 1. Clean areas in accordance to SSPC-SP2.
 - 2. Prepare surface for zinc spray in accordance to SSPC-SP5, or zinc rich paint repair in accordance to SSPC-SP10.

3.06 PREPARATION FOR TOP COATING

- A. Galvanized fabrications indicated on the drawings to be painted shall be prepared in accordance to ASTM D6836.
 - 1. Surface cleaning prior to surface preparation in accordance to SSPC-SP1.
 - 2. Removal of zinc high spots and cleaning of light deposits of zinc reaction products in accordance to SSPC-SP2 or SSPC-SP3.
 - 3. Profile surface in accordance to SSPC-SP7 or SSPC-SP11.

- B. Galvanized fabrications indicated on the drawings to be powder coated shall be prepared in accordance to ASTM D7803.
 - 1. Surface cleaning and removal of oil and grease in accordance to SSPC-1.
 - 2. Surface smoothing and removal of loose particles in accordance to SSPC-SP-2 or SSPC-SP3.
 - 3. Sweep blasting and surface profiling in accordance to SSPC-SP16.

END OF SECTION

SECTION 05 1200

STRUCTURAL STEEL FRAMING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Structural steel.
2. Architecturally exposed structural steel.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 01 4523 - Testing and Inspection.
3. Section 03 3000 - Cast-In-Place Concrete.
4. Section 04 2200 - Concrete Unit Masonry.
5. Section 05 0513 – Hot-Dip Galvanizing.
6. Section 05 1000 – Metal Stairs and Railings.
7. Section 05 3000 - Metal Decking.
8. Section 05 5000 - Metal Fabrications.
9. Section 07 8116 - Cementitious Fireproofing.
10. Section 09 9000 - Paints and Coatings.

1.02 REFERENCES

A. CBC Chapter 22A.

B. American Institute of Steel Construction (AISC):

1. AISC – Steel Construction Manual:
 - a. AISC 360 Specifications for Structural Steel Buildings.

05/16/2019

- b. AISC Code of Standard Practice for Steel Buildings and Bridges.
 - c. RCSC Specification for Structural Joints Using High Strength Bolts.
- 2. AISC 341 - Seismic Provisions for Structural Steel Buildings.
 - 3. AISC 358 - Prequalified Connections for Special and Intermediate Steel Moment Frames for Seismic Applications.
- C. ASTM International (ASTM):
- 1. ASTM A36 – Standard Specification for Carbon Structural Steel.
 - 2. ASTM A53 – Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless.
 - 3. ASTM A108 – Standard Specification for Steel Bar, Carbon and Alloy, Cold-Finished.
 - 4. ASTM A123 – Standard Specification for Zinc (Hot-Dipped Galvanized) Coatings on Iron and Steel Products.
 - 5. ASTM A153 – Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware.
 - 6. ASTM A307 – Standard Specification for Carbon Steel Bolts and Studs, and Threaded Rod 60000 PSI Tensile Strength.
 - 7. ASTM A435 - Standard Specification for Straight-Beam Ultrasonic Examination of Steel Plates.
 - 8. ASTM A500 – Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Round and Shapes.
 - 9. ASTM A501 - Standard Specification for Hot-Formed Welded and Seamless Carbon Steel Structural Tubing.
 - 10. ASTM A572 – Standard Specification for High-Strength Low-Alloy Columbium-Vanadium Structural Steel.
 - 11. ASTM A653 – Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
 - 12. ASTM A673 - Standard Specification for Sampling Procedure for Impact Testing of Structural Steel.

05/16/2019

13. ASTM A992 – Standard Specification for Structural Steel Shapes.
14. ASTM C1107 – Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Nonshrink).
15. ASTM E23 - Standard Test Methods for Notched Bar Impact Testing of Metallic Materials.
16. ASTM E112 - Standard Test Methods for Determining Average Grain Size.
17. ASTM F3125 - Standard Specification for High Strength Structural Bolts, Steel and Alloy Steel, Heat Treated, 120 ksi (830 MPa) and 150 ksi (1040 MPa) Minimum Tensile Strength, Inch and Metric Dimensions.
18. ASTM F436 – Standard Specification for Hardened Steel Washers Inch and Metric Dimensions.
19. ASTM F959 - Standard Specification for Compressible-Washer-Type Direct Tension Indicators for Use with Structural Fasteners, Inch and Metric Series.
20. ASTM F1554 – Standard Specification for Anchor Bolts, Steel, 36, 55 and 105-Ksi Yield Strength.
21. ASTM F1852 – Standard Specification for Twist Off Type Tension Control Structural Bolt/Nut/Washer Assemblies, Steel, Heat Treated, 120/105 ksi Minimum Tensile Strength.

D. American Welding Society (AWS):

1. AWS D1.1 – Structural Welding Code - Steel.
2. AWS D1.8 – Structural Welding Code – Seismic Supplement.
3. AWS A2.4 – Standard Symbols for Welding, Brazing, and Nondestructive Examination.
4. AWS B2.1 – Base Metal Grouping for Welding Procedure and Performance Qualification.

E. SSPC – Steel Structures Painting Council:

1. SSPC-SP2 - Hand Tool Cleaning.
2. SSPC-PA-1 - Shop, Field and Maintenance Coating of Metals.

1.03 REGULATORY REQUIREMENTS

05/16/2019

- A. Structural steel shall conform to CBC requirements, except that steel manufactured by acid Bessemer process is not permitted for structural purposes.
- B. Sheet and strip steel other than those listed in CBC, if provided for structural purpose, shall comply with DSA requirements.

1.04 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings, including complete details and schedules for fabrication and shop assembly of members, and details, schedules, procedures and diagrams showing the sequence of erection. Fully detail minor connections and fastenings not shown or specified in the Contract Documents to meet required conditions using similar detailing as shown in the Contract Documents. Include a fully detailed, well controlled sequence and technique plan for shop and field welding that minimizes locked in stresses and distortion; submit sequence and technique plan for review by the ARCHITECT.
 - 1. Include details of cuts, connections, camber, and holes in accordance with Figure 4.5 of AWS D1.1 or AISC Chapter J, weld position plan and other pertinent data. Indicate welds by standard AWS symbols, and show size, length and type of each weld.
 - 2. Provide setting drawings, templates, and directions for installation of anchor bolts and other anchorages to be installed for Work specified in other sections.
 - 3. Erection and Bracing Plan and Erection Procedure: Submit an erection and framing plan, including columns, beams, and girders, signed and sealed by a Structural or Civil Engineer registered in the State of California in accordance with Title 8 California Code of Regulations, Section 1710, Structural Steel Erection. Maintain a copy at the Project site as required by the California Division of Industrial Safety.
 - 4. Submit a list of steel items to be galvanized.
 - 5. Include identification and details of Architecturally Exposed Structural Steel (AESS) members, if applicable.
- B. Product Data: Submit copies of fabricator's specifications and installation instructions for the following products. Include laboratory test reports and other data required demonstrating compliance with these Specifications:
 - 1. Structural steel, each type; including certified copies of mill reports covering chemical and physical properties.
 - 2. Welding electrodes.

05/16/2019

3. Welding gas.
 4. Unfinished bolts and nuts.
 5. Structural steel primer paint.
 6. High-strength bolts, including nuts and washers.
- C. Manufacturer's Mill Certificate: Submit, certifying that products meet or exceed specified requirements.
- D. Mill Test Reports: Submit manufacturer's certificates, indicating structural yield and tensile strength, destructive and non-destructive test analysis.
- E. Welding Procedure Specifications (WPS): Submit weld procedures for all welding on project to OWNER's testing laboratory for approval. After approval by testing laboratory, submit to ARCHITECT for Record. Weld procedures shall be qualified as described in AWS D1.5, AISC 341 and AISC 358, as applicable. Weld procedures shall indicate joints details and tolerances, preheat and interpass temperature, post-heat treatment, single or multiple stringer passes, peening of stringer passes for groove welds except for the first and the last pass, electrode type and size, welding current, polarity and amperes and root treatment. The welding variables for each stringer pass shall be recorded and averaged; from these averages the weld heat input shall be calculated. Submit the manufacturer's product data sheet for all welding material used.
- F. Welder's Certificates: Field welders shall be Project certified in accordance with AWS D1.1. Shop welders shall be Project certified for FCAW in accordance with AWS D1.1.
- G. Test Reports: Submit reports of tests conducted on shop and field welded and bolted connections. Include data on type of test conducted and test results.
- H. Welding Material Certification: Provide certificate that welding material complies with specifications. Submit to OWNER's testing laboratory.

1.05 QUALITY ASSURANCE

- A. Comply with the following as a minimum requirement, except as otherwise indicated:
1. American Institute of Steel Construction (AISC) "Code of Standard Practice for Steel Buildings and Bridges, modified as follows:
 - a. Replace "Structural Design Drawings" with "Contract Documents" throughout the document.

05/16/2019

- b. Paragraph 3.2 is hereby modified in its entirety as follows: “Contract Documents including but not limited to architectural, mechanical, plumbing, electrical, civil and kitchen design drawings and specifications shall be used as supplement to the structural plans to define configurations and construction information.”
 - c. Delete Paragraph 3.3.
 - d. In Paragraph 4.4, delete the following sentence: “These drawings shall be returned to the Fabricator within 14 calendar days.”
 - e. Delete Paragraph 4.4.1.(a) in its entirety.
 - f. Paragraph 4.4.2 is hereby modified in its entirety as follows: “No review action, implicit or explicit, shall be interpreted to authorize changes in the Contract Documents.”
2. Perform welding in accordance with AWS Standards, AWS D1.1, and California Building Code Section 2204A.1 and approved Weld Procedure Specifications (WPS).
- B. Shop fabrication shall be inspected in accordance with CBC.
 - C. Erect mock-up panel of fabricated structural steel meeting Architecturally Exposed Structural Steel (AESS) tolerances for exposed areas. Approval by ARCHITECT is required. Mock-up to remain for comparison but may not be left as part of the work.

1.06 DELIVERY, STORAGE AND HANDLING

- A. Store structural steel above grade on platforms, skids or other supports.
- B. Protect steel from corrosion.
- C. Store welding electrodes in accordance with AWS D 12.1.
- D. Store other materials in a weather-tight and dry place until installed into the Work.

PART 2 - PRODUCTS

2.01 GENERAL

- A. Stock Materials: Provide exact materials, sections, shapes, thickness, sizes, weights, and details of construction indicated on Drawings. Changes because of material stock or shop practices will be considered if net area of shape or section is not reduced

05/16/2019

thereby, if material and structural properties are at least equivalent, and if overall dimensions are not exceeded.

- B. Shapes, bars, plates, tubes and pipes shall be made of materials with at least 16 percent recycled content if produced from Basic Oxygen Furnace (BOF) or at least 67 percent recycled content if produced from Electric Arc Furnace (EAF).

2.02 MATERIALS

- A. Structural Steel: Wide flange shapes shall conform to ASTM A992 grade 50. Other steel shall conform to ASTM A36.
- B. Unfinished Threaded Fasteners: ASTM A307, Grade A, regular low carbon bolts and nuts.
- C. High-Strength Threaded Fasteners: ASTM F3125 or ASTM F959 quenched and tempered, steel bolts, nuts and washers.
- D. Primers: Lead-free metal primer:
 1. SSPC-Paint 20, Zinc-Rich Coating Inorganic and Organic.
 2. SSPC-Paint 23, Latex Primer for Steel Surfaces.
- E. Steel Pipe: ASTM A53, Type E or S, Grade B.
- F. Structural Tubing:
 1. Hot-formed, ASTM A501.
 2. Cold-formed, ASTM A500, Grade B.
- G. Galvanizing: ASTM A123.
- H. Shear stud connectors: ASTM A108, Grade 1015 forged steel, headed, uncoated, granular flux filled shear connector or anchor studs by Nelson Stud Welding Division, or equal.
- I. Grout: ASTM C1107, non-shrink type, pre-mixed compound consisting of non-metallic aggregate, cement, water reducing and plasticizing additives, capable of developing a minimum compressive strength of 7,000 psi at seven days; of consistency suitable for application and a 30 minute working time.

2.03 FABRICATION

05/16/2019

- A. Fabricate in accordance to AISC Code of Standard Practice for Steel Buildings and Bridges and AISC 360.
- B. Cleaning and Straightening Materials: Materials being fabricated shall be thoroughly cleaned of scale and rust, and straightened before fabrication. Cleaning and straightening methods shall not damage material. After punching or fabrication of component parts of a member, twists or bends shall be removed before parts are assembled.
- C. Cutting, Punching, Drilling and Tapping: Unless otherwise indicated or specified, structural steel fabricator shall perform the cutting, punching, drilling and tapping of Work so that Work of other trades will properly connect to steel Work.
- D. Milling: Compression joints depending on contact bearing shall be furnished with bearing surfaces prepared to a common plane by milling.
- E. Use of Burning Torch: Oxygen cutting of members shall be performed by machine. Gouges greater than 3/16 inch that remain from cutting shall be removed by grinding. Reentrant corners shall be shaped notch free to a radius of at least 1/2 inch. Gas cutting of holes for bolts or rivets is not permitted.
- F. Galvanizing: After fabrication, items indicated or specified to be galvanized shall be galvanized per Section 05 5013, Hot-Dip Galvanizing.
- G. Welding:
 - 1. Type of steel furnished in welded structures shall provide chemical properties suitable for welding as determined by chemical analysis. Welds shall conform to the verification and inspection requirements of CBC Chapter 17A. Conform to AWS D1.1, and CBC Chapter 22A.
 - 2. Materials and workmanship shall conform to the requirements specified herein and to CBC requirements, modified as follows:
 - a. No welded splices shall be permitted except those indicated on Drawings unless specifically reviewed by the ARCHITECT.
 - b. Drawings will designate joints in which it is important that welding sequence and technique be controlled to minimize shrinkage stresses and distortion.
 - 3. Welding shall be performed in accordance with requirements of the AWS Structural Welding Code.
 - 4. Architecturally Exposed Structural Steel: Verify that weld sizes, fabrication sequence, and equipment used for Architecturally Exposed Structural Steel will limit distortions to allowable tolerances. Prevent surface bleeding of back-side

05/16/2019

welding on exposed steel surfaces. Grind smooth exposed fillet welds ½ inch and larger. Grind flush butt welds. Dress exposed welds.

5. Remove erection bolts on welded, Architecturally Exposed Structural Steel; fill holes with plug welds; and grind smooth at exposed surfaces.

H. Shop Finish:

1. Notify the Project Inspector when Work is ready to receive shop prime coat. Work shall be inspected by the Project Inspector before installation of primer.
2. Structural steel and fittings shall receive a coat of primer, except:
 - a. Surfaces that will be galvanized.
 - b. Surfaces that will be fireproofed.
 - c. Surfaces that will be field welded.
 - d. Surfaces in contact with concrete.
 - e. Surfaces high strength bolted.
3. The primer specified shall be spray applied, filling joints and corners and covering surfaces with a smooth unbroken film. The minimum dry film thickness of the primer shall be 2.0 mils.

I. Comply with fabrication tolerance limits of AISC's "Code of Standard Practice for Steel Buildings and Bridges" for structural steel.

J. Fabricate Architecturally Exposed Structural Steel with exposed surfaces smooth, square, and free of surfaces blemishes, including pitting, rust and scale seam marks, roller marks, rolled trade names, and roughness.

1. Remove blemishes by filling, grinding, or by welding and grinding, prior to cleaning, treating and shop priming.
2. Comply with fabrication requirements, including tolerance limits of AISC's "Code of Standard Practice for Steel Buildings and Bridges" for Architecturally Exposed Structural Steel.

K. Architecturally Exposed Structural Steel: use special care in unloading, handling and erecting the steel to avoid marking or distorting the steel members. Minimize damage to any shop paint when temporary braces or erection clips are used. Avoid unsightly surfaces upon removal. Grind smooth tack welds and holes filled with weld metal or body solder. Plan and execute all operations in such a manner that the close fit and neat appearance of the structure will not be impaired.

05/16/2019

2.04 SHOP AND FIELD QUALITY CONTROL

- A. A special inspector, approved by DSA to inspect the Work of this section, shall inspect high-strength bolted connections. OWNER will provide a DSA approved independent testing laboratory to perform tests and prepare test reports in accordance with CBC 1704A. The Project Inspector shall be responsible for monitoring the work of the special inspector and testing laboratories to ensure that the testing program is satisfactorily completed.
- B. An AWS certified welding inspector (CWI), approved by DSA to inspect the Work of this section, shall inspect welded connections in accordance with CBC 1705A.2.5. The OWNER will provide a DSA approved independent testing laboratory to perform tests and prepare test reports. The Project Inspector shall be responsible for monitoring the work of the special inspector and testing laboratories to ensure that the testing program is satisfactorily completed.
- C. The independent testing laboratory shall conduct and interpret test and state in each report whether test specimens comply with requirements, and specifically state any deviations there from.
- D. Provide access to all places where structural steel Work is being fabricated or produced so required inspection and testing can be performed.
- E. The independent testing laboratory may inspect or test structural steel at plant before shipment; however, ARCHITECT reserves the right at any time before Contract Completion to deem materials not in compliance with the specified requirements as defective Work.
- F. Correct defects in structural Work when inspections and laboratory test reports indicate noncompliance with specified requirements. Perform additional tests as may be required to reconfirm noncompliance of original Work, and as may be required to show demonstrate compliance of corrected Work.
- G. Inspection of Structural Tube Steel/Hollow Structural Sections (HSS): Structural tube steel members (round, square, rectangular), disregarding steel origin, will be inspected during shop fabrication per DSA Bulletin 07-03. Inspector will perform a visual examination of the seam weld area for visible discontinuities. When defects are suspected, non-destructive testing will be considered.
- H. Welding: Inspect and test during fabrication and erection of structural steel assemblies as follows:
 - 1. Certify welders and conduct inspections and tests as required. Record types and locations of defects found in the Work. Record Work required and performed to correct deficiencies.

05/16/2019

2. Inspect welds. Welds shall be visually inspected before performing any non-destructive testing. Groove weld shall be inspected by ultrasonic or other approved non-destructive test methods. Testing shall be performed to AWS D1.1 Table 6.3 cyclically loaded non-tubular connections.
 3. Ultrasonic testing shall be performed by a specially trained and qualified technician who shall operate the equipment, examine welds, and maintain a record of welds examined, defects found, and disposition of each defect. Repair and test defective welds.
 4. Rate of Testing: Completed welds contained in joints and splices shall be tested 100 percent either by ultrasonic testing or by radiography.
 5. Welds, when installed in column splices, shall be tested by either ultrasonic testing or radiography.
 6. Base metal thicker than 1 ½-inch, when subjected to through-thickness weld shrinkage strains, shall be ultrasonically inspected by shear wave methods for discontinuities directly behind such welds. Tests shall be performed at least 48 hours after completed joint has cooled down to ambient air temperature.
 7. Material discontinuities shall be reviewed based on the defect rating in accordance with the criteria of AWS D1.1 table 6.3 by the ARCHITECT and DSA.
 8. Other method of non-destructive testing and inspection, for example, liquid dye penetrate testing, magnetic particle inspection or radiographic inspection may be performed on weld if required.
 9. Lamellar Tearing: Lamellar-tearing resulting from welding is a crack (with zero tolerance) and shall be repaired in accordance with AWS D1.1.
 10. Lamination: The rejection criteria shall be based on ASTM A435.
 11. Where testing reveals lamination or conditions of lamellar tearing in base metal, the steel fabricator shall submit a proposed method of repair for review by the ARCHITECT. Test repaired areas as required.
 12. Magnetic Particle Testing: Magnetic particle testing when required shall be provided in accordance with AWS D1.1 for procedure and technique. The standards of acceptance shall be in accordance with AWS D1.1 – Qualification.
- I. Lamellar Tearing: Prior to welding plates 1 to 1-½ inch thick and greater and rolled shapes within the distance from 6 inches above the top of the joint to 6 inches below the bottom of the joint shall be checked by ultrasonic testing for laminations in base metal which may interfere with the inspection of the completed joint. Should these

05/16/2019

defects occur, members will be reviewed by the ARCHITECT and DSA. Welding procedure specifications in paragraph 1.04.G specify welding practices to minimize lamellar tearing.

- J. Prior Testing of Base Material: Test material before fabrication.
- K. Lines and levels of erected steel shall be certified by a State of California licensed surveyor as set forth in related Division 01 section.
- L. Welded studs shall be tested and inspected by the special inspector in accordance with requirements of AWS D1.1 – Stud Welding.
- M. Record Drawings: After steel has been erected, correct or revise Shop Drawings and erection diagrams to correspond with reviewed changes performed in the field.

PART 3 - EXECUTION

3.01 PREPARATION

- A. Verify governing dimensions and conditions of the Work before commencing erection Work.
 - 1. Report discrepancies between drawings and field dimensions to ARCHITECT before commencing work.
 - 2. Beginning of installation means erector accepts existing conditions and surfaces underlying or adjacent to work of this section.
- B. Provide temporary shoring and bracing, and other support during performance of the Work. Remove after steel is in place and connected, and after cast-in-place concrete has reached its design strength.
- C. Coordinate prime coat repair and application with requirements of Section 09 9000.

3.02 ERECTION

- A. Install structural steel accurately in locations, to elevations indicated, and according to AISC specifications and CBC requirements.
- B. Clean surfaces of base plates and bearing plates.
 - 1. Install base and bearing plates for structural members on wedges, shims, or setting nuts as required.
 - 2. Tighten anchor bolts after supported members have been positioned and plumbed. Do not remove wedges or shims; cut off flush with edge of base or bearing plate before packing with grout.

05/16/2019

- C. Maintain erection tolerances of structural steel within AISC Code of Standard Practice for Steel Buildings and Bridges.
 - 1. Architecturally Exposed Structural Steel members and components, plumbed, leveled and aligned to a tolerance not to exceed one-half the amount permitted for structural steel. CONTRACTOR to provide adjustable connections between Architecturally Exposed Structural Steel and the structural steel frame or the masonry or concrete supports, in order to provide the erector with means for adjustment.
- D. Align and adjust various members forming part of complete frame or structure before permanently fastening. Before assembly, clean bearing surfaces and other surfaces that will be in permanent contact after assembly. Perform necessary adjustments to compensate for discrepancies in elevations and alignment.
 - 1. Level and plumb individual members of structure.
- E. Do not permit thermal cutting during erection of structural steel.
- F. Where indicated for field connections, provide standard bolts complying with ASTM A307.
- G. Install high strength steel bolts at locations indicated. Assembly and installation shall be in accordance with CBC requirements and AISC specifications.
 - 1. Allowable hole sizes: 1/16 inch larger than bolt size.
 - 2. Use friction type connection with standard hardened steel circular, square or rectangular washer under bolt nut.
 - 3. Thoroughly clean area under bolt head, nut and washer. Remove all paint, lacquer, oil or other coatings except organic zinc-rich paints in accordance with SSPC, SP-2.
 - 4. Tighten bolts by power torque wrench or hand wrench until twist-off.
- H. CONTRACTOR shall be responsible for correcting detailing and fabrication errors and for correct fitting of all members and components.
- I. Erect structural steel plumb and level and to proper tolerances as set forth in the AISC Manual. Provide temporary bracing, supports or connections required for complete safety of structure until final permanent connections are installed.
- J. Install column bases within a tolerance of 1/8 inch of detailed centerlines, level at proper elevations. Support bases on double nuts and solidly fill spaces under bases with cement grout.
- K. Provide anchor bolts with templates and diagrams. CONTRACTOR shall be responsible for proper location and installation of bolts. Correct deficiencies and errors.

05/16/2019

3.03 FITTING

- A. Closely fit members, finished true to line and in precise position required to allow accurate erection and proper joining in the field.
- B. Drilling to enlarge unfair holes will not be allowed. Allow only enough drifting during assembly to bring parts into position, but not enough to enlarge holes or distort the metal. Do not heat rolled sections, unless approved by ARCHITECT.

3.04 PUNCHING AND DRILLING

- A. Punch material 1/16 inch larger than nominal diameter of bolt, wherever thickness of metal is equal to or less than the diameter of the bolt plus 1/8 inch.
- B. Drill or sub-punch and ream where metal is equal to or more than the diameter of the bolt plus 1/8 inch. Make diameter for sub-punched and sub-drilled holes 1/16 inch larger than nominal diameter of bolt.
- C. Precisely locate holes to ensure passage of bolt through assembled materials without drifting. Enlarge holes when necessary to receive bolts by reaming; flame cutting to enlarge holes is not acceptable. Structural Steel members with poorly matched holes will be rejected.

3.05 FINISHING

- A. After erection, spots or surfaces where paint has been removed, damaged, or burned off, and field rivets, bolts, and other field connections shall be cleaned of dirt, oil, grease, and burned paint and furnished with a spot coat of the same primer installed during shop priming.
- B. Touchup:
 - 1. Painting: Immediately after erection, clean field welds, bolted connections, and abraded areas of shop paint. Install paint to exposed areas with the same material installed during shop painting. Install by brush or spray to provide a minimum dry film thickness of 1.5 mils.
 - 2. Galvanized Surfaces: Clean field welds, connections and damaged areas. Apply two coats of Carbomastic 15, by Carboline or equal product approved by OWNER's OEHS. Brush or roll to a 4 to 6 mil thickness.

3.06 FIELD QUALITY CONTROL

- A. OWNER will provide a special inspector and independent testing laboratory to perform field inspections and tests and to prepare test reports.

05/16/2019

- B. Correct deficiencies in or remove and replace structural steel that inspections and test reports indicate do not comply with specified requirements.

3.07 CLEAN UP

- A. Remove rubbish, debris and waste materials and legally dispose of off the Project Site.

3.08 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.09 HANDLING

- A. Both in shop and in the field, transport, handle and erect to prevent damage or overstressing of any component.

END OF SECTION

05/16/2019

SECTION 05 3000

METAL DECKING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Floor and roof metal decking.
2. Shear connector studs for composite decking construction.
3. Edge strips, closure strips and decking accessories.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 01 4523 - Testing and Inspection.
3. Section 03 3000 – Cast-In-Place Concrete.
4. Section 05 1200 - Structural Steel Framing.
5. Section 07 6000 - Flashing and Sheet Metal.
6. Section 07 8116 - Cementitious Fireproofing.

1.02 REFERENCES

A. ASTM International (ASTM):

1. ASTM A108 – Standard Specification for Steel Bar, Carbon and Alloy, Cold-Finished.
2. ASTM A653 - Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
3. ASTM A780 – Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings.
4. ASTM D746 - Standard Test Method for Brittleness Temperature of Plastics and Elastomers by Impact.

5. ASTM D1056 - Standard Specification for Flexible Cellular Materials—Sponge or Expanded Rubber.

B. American Welding Society (AWS):

1. AWS D1.1 - Structural Welding Code Sheet – Steel.
2. AWS D1.3 – Structural Welding Code Sheet – Sheet Steel.

C. American Iron and Steel Construction (AISI):

1. AISI – Specifications for the Design of Cold-Formed Steel Structural Members.

D. Underwriters Laboratory (UL):

1. UL – Fire Resistance Directory.

1.03 PERFORMANCE REQUIREMENTS

- A. Compute properties of deck sections on basis of effective design width as limited by provisions of the AISI specifications. Provide no less than deck section properties specified, including section modulus and moment of inertia per foot of width.

B. Regulatory Requirements:

1. Decking installed as part of a fire rated assembly shall meet the requirements of the applicable UL Fire Resistance Directory design number.
2. Work of this section shall be in accordance with CBC.

1.04 SUBMITTALS

- A. Shop Drawings: Drawings, sections and details indicate type of decking, location, finish, gage of metal, arrangement of sheets, necessary fabrication to incorporate decking into the Work, and relationship to openings and flashing.
- B. Product Data: For each type of decking specified, including structural properties, dimensions, profiles and finishes.
- C. Welder Certificates: Signed by CONTRACTOR certifying that welders comply with the requirements specified under Article “Quality Assurance”.

1.05 QUALITY ASSURANCE

- A. General: Metal decking steel shall conform to requirements of strengths and properties of standards specified.

- B. Qualifications of Welders: Properly certified for the type of Work involved in compliance with CBC requirements.
- C. Continuous inspection of welding will be performed by a special inspector, approved by DSA to inspect the Work of this section. Refer to Section 01 4523 - Testing and Inspection. The Project Inspector will be responsible for monitoring the work of the special inspector to ensure that the inspection program is satisfactorily completed.
- D. Identification of metal decking steel shall conform to the standards specified in this section and the Drawings.
 - 1. Fabricator shall furnish sufficient evidence to the ARCHITECT attesting compliance with specified requirements.
 - 2. Conform to CBC requirements. Unclassified or unidentified decking is not permitted. Furnish deck manufacturer's certified mill analyses and test reports for each heat covering decking having a minimum F_y of 33 Ksi. In addition, for decking having F_y greater than 33 Ksi, testing laboratory shall perform one tension and elongation test and one bend or flattening test for each gage.
- E. Unidentifiable Steel: Steel which is not readily identifiable as to grade from markings and test records is not permitted to be provided as part of the Work of this section.
- F. Manufacturers shall be members of Steel Deck Institute (SDI).

1.06 DELIVERY, STORAGE AND HANDLING

- A. Protect steel deck from corrosion, deformation and other damage during delivery, storage and handling.
- B. Deck bundles shall be stored off the ground, with one end elevated to provide drainage. Bundles shall be protected against condensation with a ventilated waterproof covering.

PART 2 - PRODUCTS

2.01 ACCEPTABLE MANUFACTURERS

- A. ASC Steel Deck.
- B. Verco Manufacturing Co.
- C. Epic Metals Corporation.
- D. Equal.

2.02 MATERIALS

- A. Metal Decking:
 - 1. Roll-formed sheets conforming to ASTM A653, with G90 zinc coating.
 - 2. Section properties conforming to applicable provisions of latest edition of AISI - Specification for the Design of Cold-Formed Steel Structural Members.
- B. Flexible Closure Strips for Deck: Vulcanized, closed-cell, expanded chloroprene elastomer, complying with ASTM D1056, Grade SCE #41.
 - 1. Brittleness Temperature: Minus 40 degrees F, ASTM D746.
 - 2. Flammability Resistance: Self-extinguishing,
- C. Decking Accessories: Metal cover plates, sheet metal edging, metal closure strips, valley and ridge strips, seat angles, sump pans, flashings: 22 gage minimum, with ASTM A653, G90 zinc coating.
- D. Shear Connectors: Headed stud type, ASTM A108 Grade 1015, cold-finished carbon steel complying with AISC specifications.
- E. Galvanizing Repair Paint: Mil. Spec. MIL-P-21035B and approved by the OWNER's Office of Environmental Health and Safety (OEHS).

2.03 FABRICATION

- A. Corrugated sheets or sections shall be designed to support required live load between supporting members.
- B. Provide decking in lengths to span over three or more supports.
- C. Except as detailed otherwise, provide decking with interlocking side laps, 2 ½-inch minimum end bearing, and 1 ½-inch minimum side bearing.
- D. Welding: Provide materials and methods in accordance with recommendations of steel decking manufacturer and reviewed submittals. Hold decking tight to the supporting elements with screws or other means for proper welding or crimping of the decking edges. Conform to AWS D1.3, and to the patterns and weld types indicated, with welds free from sharp edges and protrusions. Field coat welds and abraded surfaces at completion with an anodic type galvanizing repair paint. Omit the field paint coating where welds or abrasions are covered by concrete fill or sprayed fireproofing.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify supporting structure and existing conditions prior to starting work.
- B. Remove oil, dirt, paint, and rust from steel surfaces to which metal decking will be welded.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.02 OPENINGS

- A. Cut and reinforce units to provide openings which are located and dimensioned on the structural and mechanical Drawings.
- B. Provide openings, or other Work not indicated on the Drawings.

3.03 INSTALLATION

- A. Install metal decking in accordance with decking manufacturers' recommendations, requirements of Drawings, Shop Drawings, and Specifications.
- B. Install metal decking on supporting steel framework and adjust to final position before permanently fastening in place.
 - 1. Install each unit to proper bearing on supports.
 - 2. Install units in straight alignment for entire length of run of cells with close registration of cells of one unit with those of abutting unit.
- C. Fasten decking to steel framework at ends of units and at intermediate supports. Welding shall be as indicated on Drawings.
- D. Fasten side laps between supports as indicated on Drawings.
- E. Perform field cutting parallel with cells in area between cells, leaving sufficient horizontal material to permit welding to support steel.
- F. Weld shear connectors to supports thru decking units as required by Drawings. Weld only on clean, dry surfaces. Do not weld shear connectors thru two layers of decking units.

3.04 METAL FLASHINGS AND CLOSURES

- A. Furnish, install, and weld in position, sheet metal closure flashing, closure angles, closure plates, profile plates, and shear plates.
- B. Close open ends of cell runs at columns, openings, walls, similar interruptions and termination.

3.05 FIELD QUALITY CONTROL

- A. Install steel decking under continuous inspection according to CBC Section 1704A.
- B. Welding inspection for steel deck diaphragms shall conform to CBC Section 2204A.1.

3.06 CLEAN UP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

3.07 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 05 5000
METAL FABRICATIONS

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes: Metal fabrications:
1. Steel pipe.
 2. Square and rectangular steel tubing.
 3. Pipe columns.
 5. Handrails and guardrails.
 8. Steel Gates.
 9. Gratings, frames and covers.
 10. Miscellaneous fabrications, as indicated on the Drawings.
- B. Related Requirements:
1. Division 01 - General Requirements.
 2. Section 01 4523: Testing and Inspection.
 3. Section 05 1200: Structural Steel Framing.

1.02 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating provided materials, dimensions, anchoring detail, and details of termination or connection to adjacent construction. Indicate items that are purchased from a manufacturer and items that are shop fabricated. Indicate component parts requiring Project site fabrication or assembly.
- B. Product Data: Submit Product Data for manufactured items. Submit Product Data for primers and finishes.
- C. Material Samples: Submit Samples of primers and finishes on fabricated items.
- D. Installation Instructions: Submit installation instructions for manufactured items.

1.03 QUALITY ASSURANCE

- A. Comply with the following as a minimum requirement:
1. Design, fabricate, and install miscellaneous metals in accordance with AISC - Design, Fabrication, and Erection of Structural Steel for Buildings.

2. AWS D-1.1 Code - Welding in Building Construction.
 3. Inspection of Welding: Refer to Section 01 4523: Testing and Inspection.
 4. Welding: Refer to Section 01 4523 Testing and Inspection.
- B. Coordinate installation of accessory items required for metal fabrications.

1.04 DELIVERY, STORAGE AND HANDLING

- A. Store miscellaneous metal items above grade on platforms, skids, or other required supports.
- B. Protect from corrosion or damage.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Structural Steel Shapes: ASTM A36.
- B. Steel Pipe:
 1. Steel pipe for pipe columns and other structural purposes shall conform to ASTM A53, Type E or S, Grade B, as required.
 2. Steel pipe other than pipe furnished for structural purposes shall conform to ASTM A53.
- C. Square and Rectangular Steel Tubing:
 1. Steel tubing for structural purposes shall be carbon steel conforming to ASTM A500.
 2. Steel tubing other than tubing furnished for structural purposes shall be hot or cold rolled carbon steel electric welded tubing.
- D. Cast Steel: ASTM A27, Grade 65-35.
- E. Steel Bolts: ASTM A307, Grade A, with bolt head and nut dimensions conforming to ANSI B 18.2.1.
- F. Rolled Steel Plates and Shapes:

1. Shapes and plates shall conform to ASTM A36, except for plates to be bent or cold-formed.
2. Plates to be bent or cold-formed shall conform to ASTM A283, Grade C.

G. Chain: Chain shall be 4/0 double loop pattern coil chain.

H. Nonshrink, Nonmetallic Grout: Factory-packaged, nonstaining, noncorrosive, nongaseous grout complying with ASTM C1107. Provide grout specifically recommended by manufacturer for interior and exterior applications "Rapid set Cement".

2.02 FABRICATION

A. General:

1. For fabrication of Work exposed to view, provide only materials smooth and free of blemishes. Remove blemishes by grinding or by welding and grinding, before cleaning, treating, and installation of surface finishes including zinc coatings.
2. Ease exposed edges to a radius of approximately 1/32 inch, unless otherwise indicated or specified.

C. Railings:

1. Railings: Handrails and standards shall be fabricated of Grade B standard weight steel pipe or indicated on Drawings. After fabrication, rails shall be galvanized. Standards shall be attached to stringers and face of balcony as detailed.
2. Panels:
 - a. Mesh shall be 10 gage 1 1/2-inch diamond mesh. The wires shall extend through the channel frame and shall be clinched.
 - b. Frame members shall be 1 inch by 1/2 inch by 1/8 inch thick plate welded to top and end members. Corners shall be mortised and tenoned and continuously welded together. Panels shall be galvanized. Fasten panels to rails and standards as indicated.
3. Handrail Brackets: Type indicated.

D. Folding Steel Gates: Furnish and install folding steel gates, complete, where indicated. Gates shall be provided with hinged bottom track and shall allow for padlocking in both open and closed positions. Manufactured by Acorn Wire and Iron Works, American Woven Wire Corporation, King Wire Partitions, Inc., or equal.

1. Vertical bars shall consist of pairs of steel channels 3/4 inch by 3/8 inch by 1/8 inch minimum, approximately 6 inches on center with 5/8 inch by 3/16" inch steel lattice bars.
2. Gate leaves extending more than 8 feet shall be provided with over head tracks and hangers. Gates shall have casters unless over-head tracks are furnished and shall be hot dip galvanized or powder coat finish.

F. Miscellaneous Framing and Supports:

1. Except as otherwise indicated, space anchors 2 feet on center, and provide minimum anchor units of 1 1/4-inch by 1/4 inch by 8-inch steel straps.
2. Shelf angles for exterior construction shall be galvanized steel of sizes indicated.

G. Welding:

1. Weld connections unless otherwise indicated.
2. Weld corners and seams continuously and in accordance with requirements of AWS Code. Welds shall be inspected as required in Section 05 1200: Structural Steel Framing.
3. Grind exposed welds smooth and flush to match and blend with adjoining surfaces.

H. Galvanizing:

1. See Section 05 0513 – Hot-Dip Galvanizing

I. Shop Finish:

1. Metal fabrications shall be provided with a coat of primer, except those indicated to be completed with exposed galvanized finish.
2. Primers:
 - a. Universal Shop Primer: Fast-curing, lead- and chromate-free, universal modified-alkyd primer complying with MPI#79 and compatible with topcoat. Use primer containing pigments that make it easily distinguishable from zinc-rich primer.
 - b. Epoxy Zinc-Rich Primer: Complying with MPI#20 and compatible with topcoat.
 - c. Minimum dry film thickness of primer shall be 2.0 mils.
3. Preparation for Primer Painting: Miscellaneous ferrous metal, except items specified galvanized, shall be thoroughly cleaned and prepared for painting, including removal of shipping oils or protective coatings, mill scale, grease, dirt and rust. Prepare in accordance with SSPC recommendations. Deliver to Project site primed or galvanized as indicated, and ready to receive Project site applied finishes.

4. Galvanized Metal Work to receive Paint: Clean oil, grease and other foreign materials from surfaces. Apply vinyl wash pretreatment coating. Follow manufacturer's instructions for drying time, and then prime with one coat of metal primer.

PART 3 - EXECUTION

3.01 INSTALLATION

A. Handrails and Guardrails:

1. Install standards into metal sleeves cast in concrete, and extending into it at least 9 inches. Wedge standards true, plumb, and fastened by packing with grout. Finish grout smooth and flush with adjacent surfaces.
2. Rails contacting a vertical surface shall be fitted with standard pipe rail flanges, secured to concrete or masonry surfaces with 3/8 inch 2-unit cinch anchor bolts and secured to wood frame surfaces with 3/8 inch lag screws, unless otherwise indicated.
3. Railings abutting pipe columns shall be provided with shaped end caps to fit columns welded to rails, and secured to columns with self-tapping machine screws.

B. Gratings, Frames and Covers:

1. Over areas indicated, provide steel gratings and grating frames as detailed. Frames shall have mitered and welded corners, and be fitted with anchors.
2. Provide steel checkered plate covers and steel frames for sumps, grease traps, and sand traps, and other covers for access where indicated. Frames shall be provided with mitered and welded corners and be fitted with anchors as detailed. Cover shall be perforated. Each section of access cover shall be furnished with steel pull rings and tool operated fastening device. Screws to fasten covers shall be brass.

3.02 ADJUSTING

A. Touch Up Damaged Surfaces:

1. Shop Painted Finishes: Comply with SSPC-PA-1 for touch-up; apply with brush to produce a minimum 2.0 mil dry film thickness.
2. Galvanized Surfaces: Clean field welds, connections and damaged areas. Repair galvanized finishes in accord with ASTM A780.

3.03 CLEAN UP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

3.04 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 05 5910

STAINLESS STEEL HAND-WOVEN NETTING

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes: Metal fabrications:
 - 1. Stainless steel hand-woven netting and fittings.
 - 2. Galvanized steel rope and fittings.

- B. Related Requirements:
 - 1. Division 01 - General Requirements.
 - 2. Section 01 4523: Testing and Inspection.
 - 3. Section 05 1200: Structural Steel Framing.
 - 4. Section 05 5000: Metal Fabrications.

1.02 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating provided materials, dimensions, anchoring detail, and details of termination or connection to adjacent construction.
- B. Product Data: Submit Product Data for manufactured items. Submit Product Data for primers and finishes.
- C. Material Samples: Submit Samples of primers and finishes on fabricated items.
- D. Maintenance Instructions: Submit maintenance instructions.

1.03 QUALITY ASSURANCE

- A. All materials shall be new, delivered in identifiable packaging.

1.04 DELIVERY, STORAGE AND HANDLING

- A. Store miscellaneous metal items above grade on platforms, skids, or other required supports.
- B. Protect from corrosion or damage.

PART 2 - PRODUCTS

2.02 BASIS OF QUALITY

- A. NETS Unlimited, Inc. 2610 E. Mohawk Ln. #101, Phoenix AZ 85050, (480) 515-1300 or equal. To submit as an equal provide documentation indicating a minimum of five years experience supplying and installing hand-woven stainless steel netting for large animal enclosures. Submit three letters of reference from client institutions that are open to the public.

2.02 MATERIALS

- A. Hand-woven netting: Sizes shall be 2" x 2" or 3" x 3" as indicated. Cable size and type shall be 1/8" 7x19 Type 304 stainless steel with black oxide finish. Cable break strength shall be 1,760 pounds nominal. Fasten ends with stainless steel swage sleeves.
- B. Wire Rope: 6x19 Class. 1/2" cable size, 6x25 IWRC, galvanized finish, .46 pounds per foot, with a minimum breaking strength of 24,000 pounds.
- C. Drop forged turnbuckles: Galvanized, 3/4" x 12", jaw and jaw type with a working load limit of 5,200 pounds.
- D. Heavy duty wire rope thimble: for 1/2" wire rope, galvanized.
- E. Drop forges wire rope clip: for 1/2" wire rope, galvanized.
- F. Oval swage sleeve: for 1/2" wire rope, ZPC finish.

3.01 INSTALLATION

- A. Install wire rope to steel structure as indicated using swage sleeves and wire rope clips. Provide turnbuckles to eliminate rope slack resulting in ropes that are tight and true. Crushed or demormed steel rope shall not be used.
- B. Install hand-woven stainless steel netting. Weave netting to result in 2" x 2" or 3" x 3" leg length at locations indicated on drawings. Cable ends shall be terminated with swage sleeves. Netting sections shall be laced to steel rope or tension bars with 1/8" steel cable using half-hitch or full-hitch.
- C. Refer to diagrams at the end of this section.

3.02 ADJUSTING

- A. Check final installation and adjust as needed to result in tight and complete system.


3.03 CLEAN UP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

3.04 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION




NETS Unlimited, Inc.


Hand-Woven Netting—2" Mesh, 1/8" 7x19 SSAC T304

Mesh Size:	2" x 2"
Mesh Type:	Hand-Woven with a "Lock-Tuck" Construction
Cable Size and Type:	1/8" 7x19 Type 304 Stainless Steel
Cable Break Strength:	1,760 lbs Nominal Breaking Strength
Cable Finish:	Plain Stainless Steel or Black Oxide
Mesh Weight:	40.3 lbs Per 100 Square Feet
Mesh Finishing:	Nets are shipped unfinished. Unfinished ends of mesh should be fed into zinc plated copper or stainless steel swage sleeves and crimped with the appropriate sized swaging tool.

NOTE: Leg size is determined by measuring from center of mesh intersection to center of mesh intersection

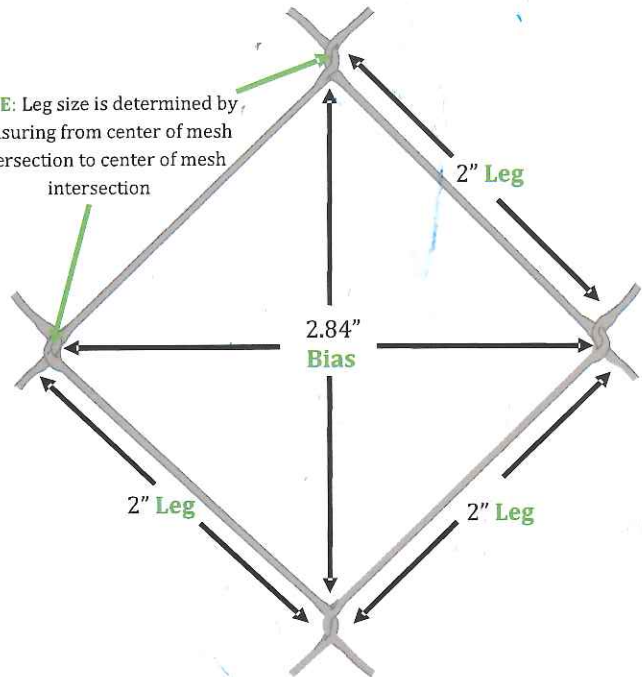


Mesh Lacing Technique:

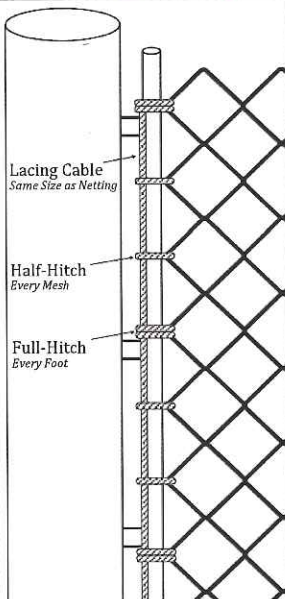


Lacing Detail (Half-hitch to Full-hitch)



Half-hitch Detail

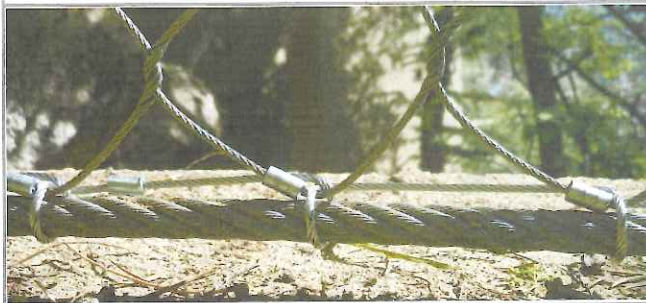

ZPC Swage Sleeves

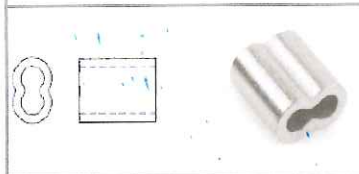


Sleeve Size	Weight Per 1,000 Pieces
1/8"	17 lbs

Mesh Finished with Swage Sleeve



Imagine the Alter **NET**ives


2610 E. Mohawk Ln. #101 Phoenix, AZ 85050 — (480) 515-1300 — info@netsunlimited.com




NETS Unlimited, Inc.

Hand-Woven Netting—3" Mesh, 1/8" 7x19 SSAC T304

Mesh Size:	3" x 3"
Mesh Type:	Hand-Woven with a "Lock-Tuck" Construction
Cable Size and Type:	1/8" 7x19 Type 304 Stainless Steel
Cable Break Strength:	1,760 lbs Nominal Breaking Strength
Cable Finish:	Plain Stainless Steel or Black Oxide
Mesh Weight:	26.0 lbs Per 100 Square Feet
Mesh Finishing:	Nets are shipped unfinished. Unfinished ends of mesh should be fed into zinc plated copper or stainless steel swage sleeves and crimped with the appropriate sized swaging tool.

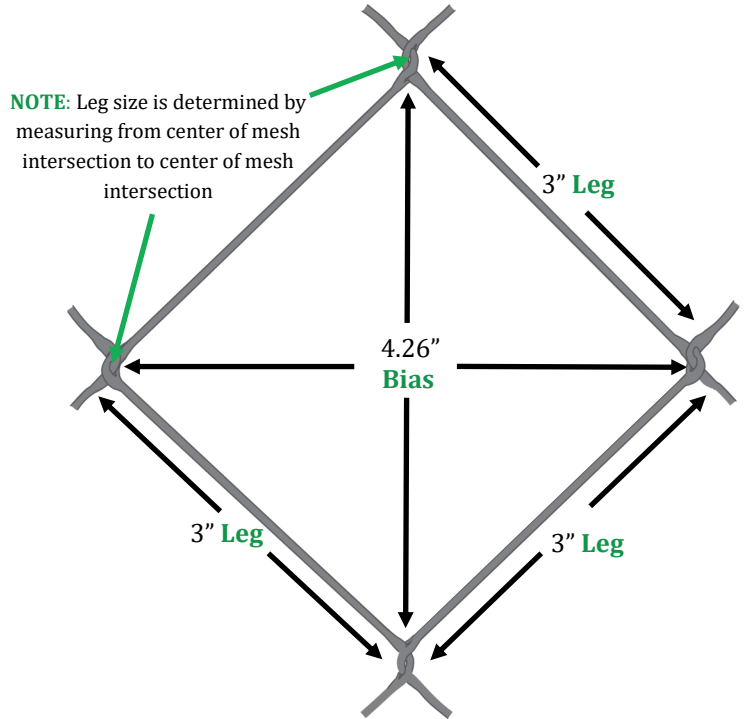

Mesh Lacing Technique:

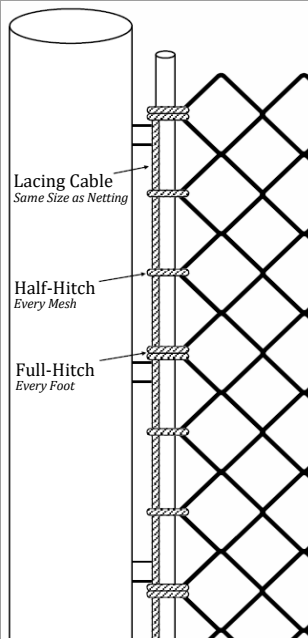


Lacing Detail (Half-Hitch to Full-Hitch)



Half-Hitch Detail




ZPC Swage Sleeves

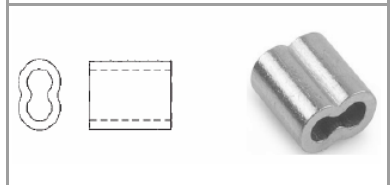

Sleeve Size	Weight Per 1,000 Pieces
1/8"	17 lbs


Mesh Finished with Swage

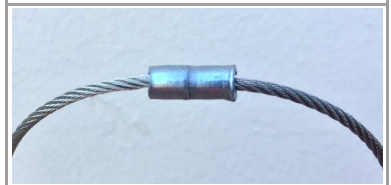

Imagine the Alter **NET**ives

2610 E. Mohawk Ln. #101 Phoenix, AZ 85050 — (480) 515-1300 — info@netsunlimited.com



WIRE ROPE (6X19 CLASS)



6x25 Filler Wire with IWRC


CABLE SIZE	CABLE TYPE	FINISH	WEIGHT PER FOOT	MINIMUM BREAKING STRENGTH
1/2"	6X25 IWRC	GALVANIZED	.46 LBS	24,000 LBS

TURNBUCKLE (DROP FORGED)

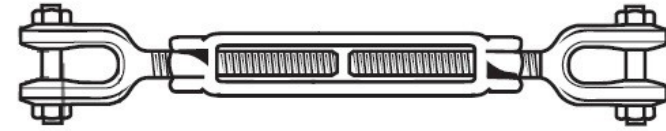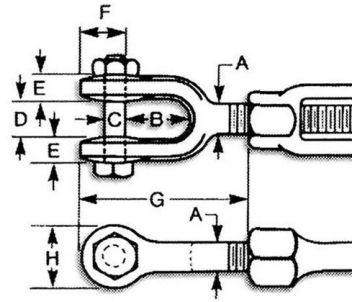


TURNBUCKLE SIZE (DIA. X TAKE-UP)	TURNBUCKLE TYPE	FINISH	WEIGHT	WORKING LOAD LIMIT	A	B	C	D	E	F	G	H
3/4" X 12"	JAW & JAW	GALVANIZED	5.75 LBS	5,200 LBS	.75"	1.5"	.63"	.94"	.56"	1.28"	4.13"	1.63"

WIRE ROPE CLIP (DROP FORGED)

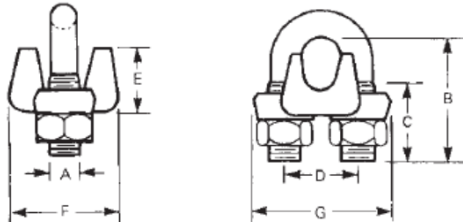


WIRE ROPE CLIP SIZE	FINISH	MIN. CLIPS REQUIRED	CABLE TURNBACK	TORQUE IN POUNDS PER FOOT	WEIGHT	A	B	C	D	E	F	G
1/2"	GALVANIZED	3	11-1/2"	65 LBS	.73 LBS	.50"	1.88"	1.00"	1.19"	1.06"	1.81"	2.31"

THIMBLE (HEAVY DUTY)

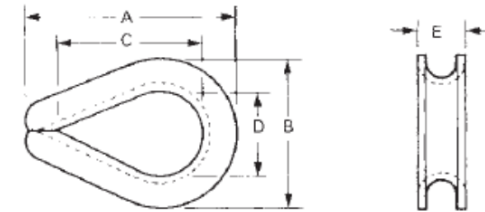

THIMBLE SIZE	FINISH	WEIGHT	A	B	C	D	E
1/2"	GALVANIZED	.51 LBS	3.63"	2.56"	2.75"	1.50"	.84"

WIRE ROPE CLIP, THIMBLE & CABLE ASSEMBLY




NETS UNLIMITED, INC.

2610 E. MOHAWK LANE, SUITE 101 ◊ PHOENIX, AZ 85050
480-515-1300 ◊ WWW.NETSUNLIMITED.COM ◊ AZROC236070

1/2" CABLE & RELATED HARDWARE
GALVANIZED FINISH



WIRE ROPE (6X19 CLASS)



6x25 Filler Wire with IWRC


CABLE SIZE	CABLE TYPE	FINISH	WEIGHT PER FOOT	MINIMUM BREAKING STRENGTH
1/2"	6X25 IWRC	GALVANIZED	.46 LBS	24,000 LBS

TURNBUCKLE (DROP FORGED)

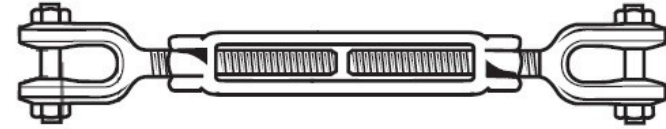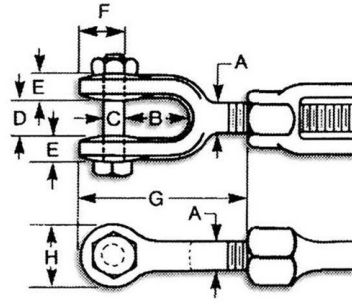


TURNBUCKLE SIZE (DIA. X TAKE-UP)	TURNBUCKLE TYPE	FINISH	WEIGHT	WORKING LOAD LIMIT	A	B	C	D	E	F	G	H
3/4" X 12"	JAW & JAW	GALVANIZED	5.75 LBS	5,200 LBS	.75"	1.5"	.63"	.94"	.56"	1.28"	4.13"	1.63"

THIMBLE (HEAVY DUTY)

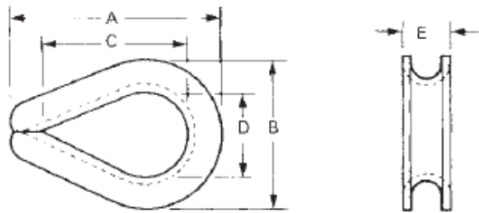

THIMBLE SIZE	FINISH	WEIGHT	A	B	C	D	E
1/2"	GALVANIZED	.51 LBS	3.63"	2.56"	2.75"	1.50"	.84"

OVAL SWAGE SLEEVE

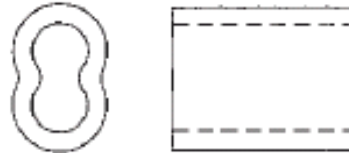

SLEEVE SIZE	FINISH	WEIGHT	CRIMPS PER SLEEVE
1/2"	ZPC	.41 LBS	3

SWAGE SLEEVE & THIMBLE CABLE ASSEMBLY



NETS UNLIMITED, INC.
 2610 E. MOHAWK LANE, SUITE 101 ◊ PHOENIX, AZ 85050
 480-515-1300 ◊ WWW.NETSUNLIMITED.COM ◊ AZROC236070
1/2" CABLE & RELATED HARDWARE
GALVANIZED FINISH

SECTION 07 9200

JOINT SEALANTS

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes:
 - 1. Joint sealants.
 - 2. Preparation for application of sealants.
- B. Related Requirements:
 - 1. Division 01 - General Requirements.
 - 2. Division 09 - Finishes.

1.02 SUBMITTALS

- A. Shop Drawings: Submit Shop Drawings indicating sealant joint locations, with full-size sealant joint details.
- B. Product Data: Submit manufacturer's literature for each sealant material.
- C. Material Samples: Submit Samples indicating color range available for each sealant material intended for installation in exposed locations.
- D. Certifications: Submit manufacturer's certification materials comply with requirements specified.
- E. Site Samples: At locations required, provide a Sample of sealant for each typical installation, approximately 24 inches long, including joint preparation, backing, sealant and tooling. Allow backing to extend 6 inches beyond end of sealant for inspection of substrate.
- F. Test Reports: Submit manufacturer's adhesion compatibility test reports according to ASTM C794 for each substrate.

1.03 QUALITY ASSURANCE

- A. Qualifications of Installer: The Work of this section shall be installed by a firm which has been in the business of installing similar materials for at least five consecutive years; and can show evidence of satisfactory completion of five projects of similar size and scope. Installer shall have applicators trained and approved by manufacturer for performing this Work.

1.04 DELIVERY, STORAGE AND HANDLING

- A. Store in accordance with manufacturer's recommendations. Provide a uniform ambient temperature between 60 and 80 degrees F.

1.05 WARRANTY

- A. Manufacturer: five year material warranty.
- B. Installer: two year installation/application warranty.

PART 2 - PRODUCTS

2.01 GENERAL

- A. Furnish sealants meeting following in-service requirements:
 - 1. Normal curing schedules are permitted.
 - 2. Non-staining, color fastness (resistance to color change), and durability when subjected to intense actinic (ultraviolet) radiation are required.
- B. Furnish the products of only one manufacturer unless otherwise required, sealant colors as selected to match the adjoining surfaces.

2.02 MANUFACTURERS

- A. Sealants must be approved by LAUSD's Office of Environmental Health and Safety (OEHS). Check OEHS website for approved products. Not all products by a manufacturer are approved by OEHS.

2.03 MATERIALS

- A. Sealants:
 - 1. Sealant 1: Acrylic latex, one-part, non-sag, mildew resistant acrylic emulsion compound complying with ASTM C834, Type S, Grade NS, formulated to be paintable.
 - a. Tremco Inc., Acrylic Latex Caulk.
 - b. Pecora Corporation, AC-20.
 - c. Equal.
 - 2. Sealant 2: Butyl sealant, one-part, non-sag, solvent-release-curing sealant complying with ASTM C1311, gun grade and formulated with a minimum of 75 percent solids.
 - a. Tremco Inc., Tremco Butyl Sealant.
 - b. Pecora Corp., BC-158.

- c. Equal.
 3. Sealant 3: Silicone sealant, one-part non-acid-curing silicone sealant complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Dow Corning Corp., Dow Corning 790, 791, 795.
 - b. General Electric Co., Silpruf.
 - c. Tremco, Inc., Spectrem 1.
 - d. Pecora Corp., 864.
 - e. Equal.
 4. Sealant 4: One-part mildew-resistant silicone sealant, complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Dow Corning Corp., Dow Corning 786.
 - b. General Electric Co., Sanitary 1700.
 - c. Tremco, Inc., Proglaze White.
 - d. Equal.
 5. Sealant 5: One-part non-sag urethane sealant, complying with ASTM C920, Type S, Grade NS, Class 25.
 - a. Sika Corporation, Sikaflex -221e.
 - b. Equal.
 6. Sealant 6: Multi-part pouring urethane sealant, complying with ASTM C920, Type M, Grade P, Class 25.
 - a. Sika Corporation, Sikaflex 2C NS/SL.
 - b. Equal.
 7. Sealant 7: Acoustical sealant, non-drying, non-hardening permanently flexible conforming to ASTM D217.
 - a. Pecora Corp., BA-98 Acoustical Sealant.
 - b. Equal.
- B. See 07 8413 - Penetration Firestopping for rated sealants.
- C. .Joint Backing: ASTM D1056; round, closed cell Polyethylene Foam Rod; oversized 30 to 50 percent larger than joint width, reticulated polyolefin foam.

- D. Primer: Non-Staining Type. Provide primer as required and shall be product of manufacturer of installed sealant.
- E. Bond Breaker: Pressure sensitive tape recommended by sealant manufacturer.
- F. Sealants shall have normal curing schedules, shall be nonstaining, color fast and shall resist deterioration due to ultraviolet radiation.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify that joint openings are ready to receive Work and field tolerances are within the guidelines recommended by sealant manufacturer.

3.02 SURFACE PREPARATION

- A. Joints and spaces to be sealed shall be completely cleaned of all dirt, dust, mortar, oil, and other foreign materials which might adversely affect sealing Work. Where necessary, degrease with a solvent or commercial degreasing agent. Surfaces shall be thoroughly dry before application of sealants.
- B. If recommended by manufacturer, remove paint and other protective coatings from surfaces to be sealed before priming and installation of sealants.
- C. Preparation of surfaces to receive sealant shall conform to the sealant manufacturer's specifications. Provide air pressure or other methods to achieve required results. Provide masking tape to keep sealants off surfaces that will be exposed in finished Work.
- D. Etch concrete or masonry surfaces to remove excess alkalinity, unless sealant manufacturer's printed instructions indicate that alkalinity does not interfere with sealant bond and performance. Etch with 5 percent solution of muriatic acid; neutralize with dilute ammonia solution, rinse thoroughly with water and allow to dry before sealant installation.
- E. Perform preparation in accordance with ASTM C804 for solvent release sealants, and ASTM C962 for elastomeric sealants.
- F. Protect elements surrounding Work of this section from damage or disfiguration.

3.03 SEALANT APPLICATION SCHEDULE

	<u>Location</u>	<u>Type</u>	<u>Color</u>
A.	Exterior and Interior joints in horizontal surfaces of concrete; between metal and concrete masonry and mortar.	Sealant 6	To match adjacent material
B.	Exterior door, entrance and window frames. Exterior and interior vertical joints in concrete and masonry	Sealant 3 or 5	To match adjacent material

metal flashing.

C.	Joints within glazed curtain wall system. Skylight framing system. Aluminum entrance system glass and glazing.	Sealant 3	Translucent or Black
D.	Interior joints in ceramic tile and at plumbing fixtures.	Sealant 4	Translucent or White
E.	Under thresholds.	Sealant 2	Black
F.	All interior joints not otherwise scheduled	Sealant 1	To Match Adjacent Surfaces
G.	Heads and sills, perimeters of frames and other openings in insulated partitions	Sealant 7	Match Adjacent Surfaces

3.04

APPLICATION

- A. Provide sealant around all openings in exterior walls, and any other locations indicated or required for structure weatherproofing and/or waterproofing.
- B. Sealants shall be installed by experienced mechanics using specified materials and proper tools. Preparatory Work (cleaning, etc.) and installation of sealant shall be as specified and in accordance with manufacturer's printed instructions and recommendations.
- C. Concrete, masonry, and other porous surfaces, and any other surfaces if recommended by manufacturer, shall be primed before installing sealants. Primer shall be installed with a brush that will reach all parts of joints to be filled with sealant.
- D. Sealants shall be stored and installed at temperatures as recommended by manufacturer. Sealants shall not be installed when they become too jelled to be discharged in a continuous flow from gun. Modification of sealants by addition of liquids, solvents, or powders is not permitted.
- E. Sealants shall be installed with guns furnished with proper size nozzles. Sufficient pressure shall be furnished to fill all voids and joints solid. In sealing around openings, include entire perimeter of each opening, unless indicated or specified otherwise. Where gun installation is impracticable, suitable hand tools shall be provided.
- F. Sealed joints shall be neatly pointed on flush surfaces with beading tool, and internal corners with a special tool. Excess material shall be cleanly removed. Sealant, where exposed, shall be free of wrinkles and uniformly smooth. Sealing shall be complete before final coats of paint are installed.

- G. Comply with sealant manufacturer's printed instructions except where more stringent requirements are indicated on Drawings or specified.
- H. Partially fill joints with joint backing material, furnishing only compatible materials, until joint depth does not exceed 1/2 inch joint width. Minimum joint width for metal to metal joints shall be 1/4 inch. Joint depth, shall be not less than 1/4 inch and not greater than 1/2 inch.
- I. Install sealant under sufficient pressure to completely fill voids. Finish exposed joints smooth, flush with surfaces or recessed as indicated. Install non-tracking sealant to concrete expansion joints subject to foot or vehicular traffic.
- J. Where joint depth prevents installation of standard bond breaker backing rod, furnish non-adhering tape covering to prevent bonding of sealant to back of joint. Under no circumstances shall sealant depth exceed 1/2 inch maximum, unless specifically indicated on Drawings.
- K. Prime porous surfaces after cleaning. Pack joints deeper than 3/4 inch with joint backing to within 3/4 inch of surface. Completely fill joints and spaces with gun applied compound, forming a neat, smooth bead.

3.05 MISCELLANEOUS WORK

- A. Sealing shall be provided wherever required to prevent light leakage as well as moisture leakage. Refer to Drawings for condition and related parts of Work.
- B. Install sealants to depths as indicated or, if not indicated, as recommended by sealant manufacturer but within following general limitations:
 - 1. For joints in concrete walks, slab and paving subject to traffic, fill joints to a depth equal to 75 percent of joint width, but not more than 3/4 inch deep or less than 3/8 inch deep, depending on joint width.
 - 2. For building joints, fill joints to a depth equal to 50 percent of joint width, but not more than 1/2 inch deep or less than 1/4 inch deep.

3.06 CLEANING

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

3.07 CURING

- A. Sealants shall cure in accordance with manufacturer's printed recommendations. Do not disturb seal until completely cured.

3.08 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 09 9000
PAINTING AND COATING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Exterior painting.

B. Following items shall not be painted:

1. Brass valves, chromium or nickel-plated piping and fittings.

2. Flexible conduit connections to equipment, miscellaneous name plates, stamping, and instruction labels and manufacturer's data.

3. Floodlight, parking light poles and loudspeaker poles, unless otherwise noted.

1.02 REGULATORY REQUIREMENTS

A. Paint materials shall comply with the Food and Drug Administration's (F.D.A.) Lead Law and the current rules and regulations of local, state and federal agencies governing the use of paint materials.

1.03 SUBMITTALS

A. List of Materials: Before submittal of samples, submit a complete list of proposed paint materials, identifying each material by distributor's name, manufacturer's name, product name and number, including primers, thinners, and coloring agents, together with manufacturers' catalog data fully describing each material as to contents, recommended installation, and preparation methods. Identify surfaces to receive various paint materials.

B. Material Samples: Submit manufacturer's standard colors samples for each type of paint specified. Once colors have been selected, submit Samples of each color selected for each type of paint accordingly:

1. Samples of Paint and Enamel must be submitted on standard 8 ½" x 11" Leneta Opacity-Display Charts. Each display chart shall have the color in full coverage. The sample shall be prepared from the material to be installed on the Work. Identify the school on which the paint is to be installed, the batch number, the color number, the type of material, and the name of the manufacturer.

2. Elastomeric shall be submitted in duplicate samples of the texture coating. Samples will be not less than 2 ½ by 3 ½ in size and installed upon backing. Finished Work will match the reviewed Sample in texture.

3. Materials and color samples shall be reviewed before starting any painting.

- C. For transparent and stained finishes, prepare samples on same species and quality of wood to be installed in the Work, with written description of system used.

1.04 QUALITY ASSURANCE

- A. Certification of Materials: With every delivery of paint materials, the manufacturer shall provide written certification the materials comply with the requirements of this section.
- B. Coats: The number of coats specified is the minimum number. If full coverage is not obtained with the specified number of coats, install additional coats as required to provide the required finish.
- C. Install coats and undercoats for finishes in strict accordance with the recommendations of the paint manufacturer as reviewed by the Architect.
- D. Paint materials shall comply with the following as a minimum requirement:
 1. Materials shall be delivered to Project site in original unbroken containers bearing manufacturer's name, brand number and batch number.
 2. Open and mix ingredients on premises in presence of the Project Inspector.

1.05 DELIVERY, STORAGE AND HANDLING

- A. Storage and Mixing of Materials: Store materials and mix only in spaces suitable for such purposes. Maintain spaces clean and provide necessary precautions to prevent fire. Store paint containers so the manufacturer's labels are clearly displayed.

1.06 SITE CONDITIONS

- A. Temperature: Do not install exterior paint in damp, rainy weather or until surface has thoroughly dried from effects of such weather. Do not install paint, interior, or exterior, when temperature is below 50 degrees F, or above 90 degrees F, or dust conditions are unfavorable for installation.

1.07 WARRANTY

- A. Manufacturer shall provide a three year material warranty.
- B. Installer shall provide a three year application warranty.

1.08 MAINTENANCE

- A. Provide at least one gallon of each type, color and sheen of paint coating installed. Label containers with color designation indicated on Drawings.

PART 2 - PRODUCTS

2.01 PAINT MATERIALS

- A. Furnish the products of only one paint manufacturer unless otherwise specified or required. Primers, intermediate and finish coats of each painting system must all be the

products of the same manufacturer, including thinners and coloring agents, except for materials furnished with shop prime coat by other trades.

- B. Factory mix paint materials to correct color, gloss, and consistency for installation to the maximum extent feasible.
- C. Paint materials to be minimum "Architectural Grade".
- D. Gloss degree standards shall be as follows:

HIGH GLOSS	70 and above	EGGSHELL	30 to 47
SEMI-GLOSS	48 to 69	SATIN	15 to 29

2.02 MANUFACTURERS

- A. Acceptable manufacturers, unless otherwise noted:
 1. Dunn-Edwards Corporation Paints
 2. Frazee Paints and Wall coverings
 3. Vista Paints
 4. Sherwin Williams
 5. ICI Paints
 6. Equal.
- B. Exterior steel:
 1. Carboline
 2. Equal.

PART 3 - EXECUTION

3.01 PREPARATION

- A. Examine surfaces to receive paint finish. Surfaces which are not properly prepared and cleaned or which are not in condition to receive the finish specified shall be corrected before prime coat is installed.
- B. Metal surfaces to be painted shall be thoroughly cleaned of rust, corrosion, oil, foreign materials, blisters, and loose paint.
- C. Do not install painting materials to wet, damp, dusty, dirty, finger marked, rough, unfinished or defective surfaces.

- D. Mask off areas where necessary.

3.02 APPLICATION

- A. Priming: Metal surfaces specified to receive paint finish shall be primed. Surfaces of miscellaneous metal and steel not embedded in concrete, and surfaces of unprimed plain sheet metal Work shall be primed immediately upon delivery to the Project site. Galvanized metal Work and interior and exterior woodwork shall be primed immediately after installation. Priming of surfaces and priming coat shall be as follows:
 1. Galvanized Metal Work: Remove all soluble and insoluble contaminants and corrosion. Remove any storage stains per Section 6.2 of ASTM D6386. Chemically treat with Krud Kutter ME or Great Lakes Laboratories Clean & Etch or Equal, in accordance with manufacturer's written instructions. Ensure that all surfaces have been effectively and uniformly treated per the manufacturer's recommendation. Follow manufacturer's instructions for drying time, and then prime with one coat of Cycloaliphatic Amine Epoxy.
 2. Unprimed Iron, Steel, and Other Uncoated Metals: Where specified to be painted, prime with one coat of metal primer.
 3. Shop Primed Metal Items: Touch up bare and abraded areas with metal primer before installation of second and third coats.
 4. Coats shall be installed evenly and with full coverage. Finished surfaces shall be free of sags, runs and other imperfections.
- C. Allow at least 24 hours between coats of paint.
- E. Each coat of painted metal, except last coat, shall be sandpapered smooth when dry.
- H. Paint Roller, brush and spray.
 1. Spray, brush and roller work is permitted.

3.03 CLEANING

- A. Remove rubbish, waste, and surplus material and clean woodwork, hardware, floors, and other adjacent Work.
- B. Remove paint, varnish and brush marks from glazing material and, upon completion of painting Work, wash and polish glazing material both sides. Glazing material, which is damaged, shall be removed and replaced with new material.
- C. Clean hardware and other unpainted metal surfaces with recommended cleaner. Do not furnish abrasives or edged tools.

3.04 SCHEDULE

- A. Exterior:

1. Metal: 3 coats. Shall be cleaned and pre-treated. Items to be painted include, but are not limited to: steel columns and miscellaneous steel items, railings and handrails gravel stops, metal doors and frames, hoods and flashings.
 - a. First Coat: Cycloaliphatic Amine Epoxy.
 - b. Second and Third Coats: Aliphatic Acrylic-Polyester Polyurethane.

C. Electrical Work:

1. Work shall be cleaned, pre-treated, and painted with 3 coats. Items to be painted include, but are not limited to: electrical conduit, fittings, pull boxes, outlet boxes, fittings and miscellaneous supports and hangers, miscellaneous metal cabinets, panels, and access doors and panels.
 - a. First Coat: As specified in this section under Priming.
 - b. Second and Third Coats: Interior enamel, semi-gloss or gloss to match adjacent wall or ceiling finish.

3.05 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.06 CLEANUP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 22 0500
COMMON WORK RESULTS FOR PLUMBING

PART 1 – GENERAL

1.01 SUMMARY

A. Section Includes:

1. This Section provides the basic plumbing requirements that apply to the Work of Division 22.

B. Related Requirements:

1. Division 01: General Requirements.
2. Division 22: Plumbing

1.02 REGULATORY REQUIREMENTS

- A. Current federal Safe Drinking Water Act (SDWA) regulations require the furnishing of lead-free pipe, solder, and flux in the installation or repair of plumbing in non-residential facilities connected to public drinking water systems. Under this regulation, solders and flux are considered lead-free when they contain 0.2 percent lead or less. Under California regulations pipes and pipe fittings are considered lead-free when they contain 0.25 percent lead or less as defined in California Assembly Bill 1953 (AB 1953). No pipe, pipe fittings, or any other fitting or fixture intended to convey or dispense water for human consumption by drinking or cooking is allowed in the domestic plumbing system, if they do not meet the low lead definition of AB 1953. Weighted average lead content of the wetted surface area of pipes, fittings and fixtures may not exceed 0.25 percent.

1. Provide lead-free water pipe, solder, and flux materials that meet the standards as outlined by the federal SDWA regulations and California AB 1953 if installed in drinking water system.
2. Collect pipe, solder, and flux material samples as required by the Project Inspector. Test samples shall be delivered to an Owner designated testing laboratory for testing of lead content.
 - a. Test samples for lead content by the atomic absorption spectrophotometry method.
3. Materials found not conforming to SDWA and California AB 1953 regulations shall be deemed defective Work and shall be replaced with lead-free materials.
4. Comprehensive testing of the remaining materials for their lead content shall be performed as required by the Project INSPECTOR.

- A. Materials, fabrication, equipment, and installation shall comply with industry standards and code requirements. Where manufacturer's recommendations exceed industry standards, the manufacturer's recommendation shall establish the minimum standard. As a minimum, standards from the following organizations shall apply:

1. ANSI - American National Standards Institute.

2. ASME - American Society of Mechanical Engineers.
 - a. ASME Boiler and Pressure Vessel Code.
 - b. ASME B31 - Standards for Pressure Piping.
 3. ASHRAE - American Society of Heating, Refrigerating and Air-Conditioning Engineers.
 4. ASTM - American Society for Testing and Materials.
 - a. ASTM A53 Specification for Welded and Seamless Pipe.
 5. AWWA - American Water Works Association.
 6. CSA - Canadian Standards Association.
 7. FM Global - Factory Mutual Global
 8. IAPMO - International Association of Plumbing and Mechanical Officials.
 9. NFPA - National Fire Protection Association.
 10. OSHA - Occupational Safety and Health Administration.
 11. SMACNA - Sheet Metal and Air Conditioning Contractors' National Association.
 12. UL - Underwriters Laboratories Inc.
 13. Intertek (ETL Certification).
- B. Materials, fabrication, equipment, and installation shall comply with federal, state, and local codes including, but not limited to, the following:
1. CBC, California Building Code, and CMC, California Plumbing Code.
 2. California Code of Regulations, Title 8, Industrial Relations, Division 1, Chapter 4, Division of Industrial Safety.
3. OSHA - Occupational Safety and Health Administration.
4. CDPH - California Department of Public Health.
 5. SCAQMD - South Coast Air Quality Management District.
- C. Specifications or Drawings shall not be construed to permit deviation from the requirements of governing codes unless approval has been obtained from legally constituted authorities having jurisdiction, and the Architect. The Contract Documents may contain more stringent requirements than those legally required.
- D. Permits and Fees: Refer to the General and Supplementary Conditions.

1.03

SUBMITTALS

- A. Provide submittals in accordance with Section 01 3300: Submittal Procedures and with specific requirements of Division 22 sections, as applicable.
- B. The above information shall become the basis for inspecting and testing materials and actual installation procedures performed in the Work.

- C. Shop Drawings: Submit one additional copy when control diagrams having line voltage connections are indicated. Shop Drawings shall be specifically prepared for the Work of this Project. Drawings prepared in accordance with requirements of Section 01 3113: Project Coordination and Section 01 3300 may be provided by the Architect to serve as a background for the Shop Drawings. Shop Drawings shall comply with the requirements of Section 01 3113 and Section 01 3300 and shall indicate at a minimum:
1. Complete system layout of equipment, components, plumbing fixtures, piping, indicating service clearances, and pipe sizes, fitting types and sizes and pipe elevations, distances of pipes and equipment from building reference points and hanger support locations. The above items shall be coordinated on the shop drawings according to the requirements of Section 01 3113.
 2. Schedule and description of equipment, piping and fittings.

1.04 PROJECT RECORD DOCUMENTS

- A. Operation and Maintenance Manuals:
1. Submit two copies of operation and maintenance manuals in required form and content. If no revisions are required, furnish one additional copy. If revisions are required, one copy shall be returned with instructions for changes; perform such changes and return three copies of manuals. Manuals shall be bound in accordance to Section 01 7700. Deliver manuals to the OAR. Submit an electronic copy of the entire manual in PDF file format.
 2. Contents of Manual:
 - a. Title sheet with Project name, including names, addresses and telephone number of Contractor, installer, and related equipment suppliers.
 - b. Manufacturer's operating instructions including, but not limited to, the following:
 - 1) Identification of components and controls.
 - 2) Trouble shooting checklist and guidelines.
 - 3) Recommendations for optimum performance.
 - 4) Warnings and safety precautions on improper or hazardous operational procedures or conditions
 - c. Manufacturer's product data and parts and maintenance booklet for each item of equipment furnished under Division 22 that includes the following as a minimum:
 - 1) Manufacturer's model, identification and serial numbers.
 - 2) Exploded view of assembly drawings identifying each component or part with the relevant part number.
 - 3) Directory of manufacturer's representatives, service contractors and part distributors.

- 4) Maintenance and trouble-shooting instructions, including schedule for preventive maintenance, periodic inspection and cleaning criteria.

1.05 COORDINATION

- A. Contract Documents indicate extent and general arrangement of Work under Division 22. Contractor shall coordinate work in accordance with Section 01 3113 requirements and make adjustments as required to provide maximum headroom, a neat arrangement to keep passageways and openings clear to provide accessibility and provisions for maintenance, and to meet code requirements.

1.06 DELIVERY, STORAGE, AND HANDLING

- A. Delivery and Storage: Deliver materials to Project site in their original unopened containers with labels intact and legible at time of delivery. Store in strict accordance with manufacturer's recommendations.
- B. Do not store plastic pipe or materials in direct sunlight.

PART 2 – PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. Unless otherwise specified, materials and equipment shall be new, in good and clean condition. Equipment, materials, and components shall be of the make; type and model number noted on Drawings or specified. Pieces of equipment of the same type shall be by the same manufacturer.
- B. Whenever an item is listed by a single proprietary name, with or without model number and type, it shall be for purpose of design only, to indicate characteristics and quality desired. Proprietary designation listed on Drawings, or listed first in Specifications, is used as a basis for design to establish a standard for quality and performance and space requirements.
- C. Equipment and materials indicated or required to be installed outdoors shall be of the type that is designed, manufactured, listed or approved by authorities having jurisdiction for outdoor installation by being resistant to the adverse effects of weather. The additional protective measures against outdoor weather required by the manufacturers' installation instructions and prevalent practice shall be provided.
- D. For substitution of materials or products, refer to the General Conditions.

PART 3 – EXECUTION

3.01 SERVICE INTERRUPTIONS, WATER

- A. Schedule Work so there shall be no service interruptions of existing systems or systems during normal hours of operation of affected systems and facilities.
- B. When service interruptions are mandatory, arrange in advance with the OAR as to time and date of such interruptions.
- C. Systems, which are interrupted, shall be returned back into operation in such manner that they will function as originally intended.

3.02 CUTTING, NOTCHING, AND BACKING

- A. Conform to California Building Code, Title 24, Part 2, for notches and bored holes in wood and for pipes and sleeves embedded in concrete and for cuts in steel, as detailed on structural Drawings.
- B. Where pipes pass through, or are located within one inch of any construction element, install a resilient pad, ½ inch thick minimum, to prevent contact.
- C. Furnish provisions for recesses, chases, and accesses and provide blocking and backing for proper reception and installation of plumbing Work.

3.03 LOCATION OF PIPING AND EQUIPMENT

- A. Location of piping, apparatus and equipment indicated on the Drawings is approximate and shall be altered to avoid obstructions, preserve headroom, and provide free and clear openings and passageways.
- B. Trenches parallel to footings shall not be closer than 18 inches to the face of footings and shall not be below a plane having a downward slope of 2 horizontal to one vertical, from a line 9 inches above bottom of footing.
- C. Pipe in tunnels shall be installed close to one side of tunnel to provide maximum space for passage. Pipe shall not be installed through crawl hole unless otherwise specified or detailed on Drawings.
- D. Place equipment in locations and spaces indicated, disassemble and/or reassemble equipment as required by Project conditions.

3.04 TESTS AND TESTING

- A. Tests shall be as required under the applicable sections of Division 22, including this Section.
- B. Additional tests may be required in the case of products, materials, and equipment if:
 - 1. Submitted items are altered, changed, or cannot be determined as exactly conforming to the Contract Documents.
 - 2. Performance testing and results may also be required on certain items which are as specified, including fan, and pump performance.
- C. Piping Tests:
 - 1. Perform tests required to demonstrate that operation of plumbing systems and their parts are in accordance with Specifications covering each item or system, and furnish materials, instruments and equipment necessary to conduct such tests. Tests shall be performed in presence of the Inspector, and representatives of any governmental agency having jurisdiction. Work shall not be concealed or covered until required results are provided.
 - 2. If required tests are not performed, Owner may provide in accordance with the Contract Documents.
 - 3. Pressure gauges furnished in testing shall comply with CPC. Air shall be bled from lines requiring hydrostatic or water tests.

4. Systems shall be pressure-tested in accordance with pipe testing schedule below. Pipe test shall indicate no loss in pressure after a minimum duration of 4 hours at test pressures indicated. Where local codes require higher test pressures than specified herein for fire sprinkler systems, local codes shall govern.
5. Fuel gas lines shall be first tested with piping exposed, before backfilling trenches or lathing; second with piping in finished arrangement, backfilled and paved where required, and walls finished.
6. Piping systems may be tested as a unit or in sections, but entire system shall successfully meet requirements specified herein, before final testing by the Inspector.
7. Repair of damage to pipes and their appurtenances or to any other structures resulting from or caused by these tests, shall be provided.

D. Pipe Testing Schedule:

System Tested	Test Pressure (psig)	Test With:
Cast-iron soil, waste and interior downspout, condensate drain from air conditioning equipment	10 feet of water, vertically	
Storm water disposal lines	Running water test	Water
Domestic water piping	200	Water

E. Equipment Performance Assurance Tests:

1. Before operating any equipment or systems, a thorough check shall be performed to determine that systems have been flushed and cleaned as required and that equipment has been properly installed, aligned, lubricated, and serviced. Factory instructions shall be checked to verify installations have been completed and recommended lubricants have been installed in bearings, gearboxes, crankcases, and similar equipment. Particular care shall be furnished in lubricating bearings to avoid damage by over-lubrication and blowing out seals. Equipment shall also be checked for damage that may have occurred during shipment, after delivery, or during installation. Damaged equipment, products, and materials shall be replaced or repaired as required.
2. Upon completion of the above, adjust the system settings to within normal operating conditions to prevent the system from being damaged upon start-up.
3. Run-test the equipment after start-up for five consecutive days. Tests shall include operation of all equipment and systems for a period of not less than two 8 hour periods at 90 percent of the full specified capacities.
4. Equipment Start-up Reports: For each equipment or system on which start-up is performed, submit 8 copies of start-up report for review by the Architect.
 - a. The start-up report shall include the manufacturer's standard start-up form completed and signed by the start-up technician.
5. Provide, maintain, and pay costs for equipment, instruments, and operating personnel as required for specified tests.

6. Provide electric energy and fuel required for tests.
7. Final adjustment to equipment or systems shall meet specified performance requirements.
8. Equipment, systems, or Work deemed defective during testing shall be replaced or corrected as required. Test until satisfactory results are provided.

3.05 NOISE AND VIBRATION REDUCTION

- A. Correct noise or vibration caused by plumbing systems. Provide all necessary adjustments to specified and installed equipment and accessories to reduce noise to the lowest possible level
- B. Correct noise or vibration problems caused by failure to install work in accordance with Contract Documents. Include all labor and materials required as a result of such failure. Pay for re-testing of corrected noise or vibration problems by the project acoustical consultant including travel, lodging, test equipment expenses, etc.

3.06 PROTECTION, CARE AND CLEANING

- A. In addition to storage criteria of the General Conditions, and provisions under Section 01 5000: Construction Facilities and Temporary Controls, the following shall be provided:
 1. Provide for the safety and good condition of materials and equipment until Substantial Completion. Protect materials and equipment from damage.
 2. Protect installed Work.
 3. Replacements: In case of damage, immediately provide repairs and/or replacements as required.
 4. Interior of piping shall be maintained free of dirt, grit, dust, and other foreign materials.
 5. Fixtures, piping, finished brass or bronze, and equipment shall have grease, adhesive, labels, and foreign materials removed. Chromium, nickel plate, polished bronze or brass Work shall be polished.
 6. Before initial start-up and again before Substantial Completion, piping shall be drained and flushed to completely remove grease and foreign matter. Pressure regulating assemblies, traps, strainers, boilers, flush valves, and similar items shall be thoroughly cleaned. Tag system with an information tag listing responsible party and date of element, before initial start-up and again before Substantial Completion.

END OF SECTION

SECTION 22 0513

BASIC PLUMBING MATERIALS AND METHODS

PART 1 – GENERAL

1.01 SUMMARY

A. Section Includes:

1. This Section prescribes basic materials and methods generally common to the Work of Division 22.

B. Related Requirements:

1. Division 01: General Requirements.
2. Division 22: Plumbing.

1.02 SUBMITTALS

- A. Provide in accordance with Division 01, Section 22 0500 and specific requirements of each section of Division 22.

- B. Types of welding rods to be used.

1.03 QUALITY ASSURANCE

- A. Standards: Comply with applicable national, state, and local codes and standards: ASTM, ASME, and ANSI. Federal Specifications, AWWA, SISPI, NFPA, FM, UL, CPC (California Plumbing Code), CMC (California Plumbing Code), CSA.

- B. Conform to provisions of Section 22 0500: Common Work Results for Plumbing.

- C. Manufacturer of plumbing products must be third-party certified to ANSI/NSF Standard 61, Section 9 certification, and ANSI/NSF 372 to demonstrate compliance with the federal requirements for lead contribution to drinking water, the Safe Drinking Water Act SDWA, and the California Health and Safety Code Section 116875.

- D. Qualifications of Manufacturer: Products used in the Work of this Section shall be produced by manufacturers regularly engaged in manufacture of similar items and with a history of successful production as reviewed by the ARCHITECT.

1.04 COORDINATION

- A. Coordinate related Work in accordance with provisions of Section 01 3113: Project Coordination.

PART 2 – PRODUCTS

2.01 GENERAL

- A. Provide the following products if they are indicated in the Contract Documents or if they are required for the proper installation, function or operation of equipment, systems or components indicated in the Contract Document.
- B. Provide the following products as a complete assembly with required accessories for a complete and functioning entity in compliance with governing codes and applicable standards as specified in Section 22 0500, manufacturer's instructions or as required.
1. Omission of minor details in the Contract Documents does not waive and/or otherwise relinquish compliance with the above requirements.

2.02 MANUFACTURERS AND MATERIALS

- A. Ball Valves: 2-inch and smaller:

BV-1: Class 150, 600 psi, Bronze, CWP two piece construction with reinforced TFE seats, full port, adjustable packing gland, (no threaded stem designs allowed), threaded or solder ends.

Manufacturer: NIBCO T-685-66-LF/S-685-66-LF, Hammond UP8303A/UP8513, Milwaukee UPBA400S/ UPBA450S, or equal.

- B. Piping and fittings:

1. Piping shall be continuously and permanently marked with manufacturer's name, type of material, size, pressure rating, and the applicable ASTM, ANSI, UL, or NSF listing. On plastic pipe, date of extrusion must also be marked.
2. Underground non-ferrous pressure pipes shall be installed with proper color tracer wires as directed by OWNER.

P-3: Copper drainage tube, inside structure and above grade. Type DWV hard temper, ASTM B 306.

Manufacturer: Mueller, Anaconda, Cerro Brass, Cambridge-Lee, Halstead, or equal.

PF-3: Cast brass drainage fittings ASA B 16.23, ASTM B 42.

Manufacturer: Mueller Brass, Nibco, Stanley Flagg, Lee Brass, or equal.

P-4: Copper water tube, Type L hard, ASTM B88. (For above ground use only.)

Manufacturer: Mueller, Cambridge-Lee, Halstead, or equal.

<p><u>NOTE: USE OF COPPER TUBING TYPE M IS PROHIBITED.</u></p>

PF-4a: Copper Press-Connect pressure fittings, comply with ASME B16.51 “Copper Alloy Press-Connect Pressure Fittings”, with Ethylene Propylene Diene Monomer, EPDM O-Ring Seal in each end. Fittings with the sizes of 2-1/2” and larger shall have cross-section Grab Rings and separation rings.

Manufacturer: Viega, Mueller Industries, Apollo, or equal.

PF-4b: Wrought copper - solder type ANSI B 16.22.

Manufacturer: Mueller Brass, Nibco, Lee Brass, or equal.

PF-4c: Grooved end type– ASTM B75 or B152 and ANSI B16.22 wrought copper, bronze sand casting per ASTM B584-87 copper alloy CDA 836 per ANSIB16.18. Couplings shall be CTS style 606 supplied with angle pattern bolt pads for rigidity, coated with copper coated alkyd enamel. Gaskets shall be pre-lubricated Flush seal type.

Manufacturer: Victaulic, or equal.

P-5: Copper water tube, Type K hard, ASTM B88.

Manufacturer: Mueller, Cerro Brass, Cambridge-Lee, Halstead, or equal.

P-14: PVC, schedule 40, extruded from 100 percent virgin Polyvinyl Chloride (PVC) compound, meeting requirements of class 1254-13 of ASTM D1784. (Use for irrigation systems after the control valves only.)

Manufacturer: Spears, Charlotte, or equal.

PF-14 Plastic fittings, schedule 40 molded from PVC type I compound, conforming to the requirements of specification ASTM D2466.

Manufacturer: Spears, Charlotte, Harvel Plastics Inc., or equal.

P-15: Purple pipe, PVC, schedule 40 for reclaimed or recycled water (below ground only for non-potable irrigation systems), type 1, grade 1, PVC-1120, Cell Class 12454 B.

Manufacturer: Charlotte, or equal.

PF-15: Purple Plastic fittings, schedule 40 molded from PVC type I compound, conforming to the requirements of specification ASTM D2466. Refer to section 32 8426 “Reclaimed Water Irrigation”.

Manufacturer: Charlotte, or equal.

- C. Pipe and Fitting Requirements Schedule: Unless otherwise specified or indicated on Drawings, pipe and fittings shall be installed in accordance with the following table:

TABLE I
PIPE AND FITTING SCHEDULE

Use	Limits	Pipe	Fittings
Domestic Cold Water, underground	Within 5' from building, All sizes	P-5	PF-4a, or PF-4b
Domestic Hot and Cold water, aboveground	Interior only	P-4	PF-4a, or PF-4b
Irrigation, After Backflow Preventer	All sizes	P14; Refer to 32 8413	PF-14; Refer to 32 8413
Irrigation, Reclaimed Water or Recycled Water	All sizes	P15; Refer to 32 8426	PF-15; Refer to 32 8426

PV-1 2 inches and smaller: Rockwell No.114, lubricated plug type, 200-pound., water operating gauge pressure iron body and plug, regular pattern, threaded, with indicating arc.

Manufacturer: Walworth, Homestead, WKM, or equal.

PART 3 – EXECUTION

3.01 EXAMINATION

- A. Examine areas and conditions under which Work of this Section shall be performed. Correct conditions detrimental to proper and timely completion of Work. Do not proceed until unsatisfactory conditions have been corrected.

3.02 INSTALLATION

- A. Provide all materials and equipment for the Work. Furnish and install necessary apparatus, parts, materials, and accessories.
- B. Pipe Installation:
1. Install piping parallel to wall and provide an orderly grouping of proper materials and execution.
 2. Piping shall clear obstructions, preserve headroom, provide openings and passageways clear, whether indicated or not. Verify the Work of other Divisions to avoid interference.

3. If obstructions or the Work of other Divisions prevent installation of piping or equipment as indicated by the Drawings, perform minor deviations as required by the ARCHITECT.
4. Install piping after excavation or cutting has been performed. Piping shall not be permanently enclosed, furred in, or covered before required inspection and testing is performed.
5. Exposed polished or enameled connections from fixtures or equipment shall be installed with no resulting tool marks or threads at fittings. Residue or exposed pipe compound shall be removed from exterior of pipe.
6. Reduce fitting where any change in pipe size occurs. Bushings shall not be furnished unless specifically reviewed by the ARCHITECT, or indicated on Drawings.
7. Piping subject to expansion or contraction shall be anchored in a manner, which permits strains to be evenly distributed. Swing joints or expansion loops shall be installed. Seismic restraints shall be installed so as not to interfere with expansion and contraction of piping. Seismic loops required at all building separations.
8. Immediately after lines have been installed, openings shall be capped or plugged to prevent entrance of foreign materials. Caps shall be left in place until removal is necessary for completion of installation.
9. Couplings shall not be installed except where required pipe runs between other fittings are longer than standard length of type of pipe being installed and except where their installation is specifically reviewed by the ARCHITECT.
10. Water piping shall be installed generally level, free of traps, unnecessary offset, arranged to conform to building requirements, clear of ducts, flues, conduits, and other Work. Piping shall be arranged with valves installed to provide for complete drainage and control of system. Piping shall not be installed which causes an objectionable noise from flow of water therein under normal conditions. Refer to Section 23 0500: Common Work Results for Plumbing.
11. Water lines may be installed in same trench with sewer lines, provided bottom of water line is 12 inches minimum above top and to the side of sewer line.
12. Changes in pipe sizes shall be furnished with eccentric reducers, flat on top. Offsets to clear obstruction shall not be installed so as to produce air pockets.

C. Pipe Joints and Connections:

1. Pipe and tubing shall be cut per IAPMO Installation Standards. Pipe shall have rough edges or burrs removed so that a smooth and unobstructed flow shall be provided.
2. Threads on pipe shall be cut with sharp, clean, unblemished dies and shall conform to ANSI/ASME B2.1 for tapered pipe threads.
3. Joint compounds shall be smoothly placed on male thread and not in fittings. Threaded joints shall be installed tight with tongs or wrenches and sealant of any kind is not permitted. Failed joints shall be replaced with new materials. Installation of thread cement or sealant to repair a leaking joint is not permitted.
4. Sharp-toothed Stillson, or similar wrenches, is not permitted for the installation of brass pipe or other piping with similar finished surfaces.

D. Copper Tubing and Brass Pipe with Threadless Fittings:

1. Silver brazed joints shall be used for attaching fittings to non-ferrous metallic refrigerant piping.
2. Non-pressure gravity fed condensate lines may be soldered with 95/5 solder.
3. Silver brazing alloy, Class BCUP-5. Surfaces to be joined shall be free of oil, grease, and oxides. Socket of fitting and end of pipe shall be thoroughly cleaned with emery cloth and wiped to remove oxides. After cleaning and before assembly or heating, flux shall be installed to each joint surface and spread evenly. Heat shall be applied in accordance with instructions in the Copper Tube Handbook issued by Copper Development Associates. Joints constructed of rough bronze fittings shall be provided as recommended by manufacturer.
4. Do not overheat piping and fittings when installing silver brazing.
5. Joints in non-ferrous piping for services not covered above shall be installed with solder composed of 95/5 tin/antimony, ASTM B32, Grade 5A. Surfaces to be jointed shall be free of oil, grease, and oxides. Sockets of fitting and end of pipe shall be cleaned with emery cloth to remove oxides. Solder flux shall be sparingly installed and solder added until joint is completely filled. Do not overheat. Excess solder, while plastic, shall be removed with a small brush in order to provide an uninterrupted fillet completely around joint. Random inspection of joints shall be conducted by Project Inspector to ensure joints are lead-free.
6. Grooved end joints for copper piping shall be assembled in accordance with the latest manufacturer recommendations. Pipe ends shall be clean and free from indentations, projections, and roll marks in the area from pipe end to

groove for proper gasket sealing. Grooving tools shall be as manufactured by Victaulic, RIDGID, MAG Tool, or equal.

7. Pressed fittings for copper or copper alloy pipe or tubing shall have an elastomeric O-ring that forms the joint. The pipe or tubing shall be fully inserted into the fitting, and the pipe or tubing marked at the shoulder of the fitting. Pipe or tubing shall be cut square, mechanically cleaned and reamed prior to joining to remove all burrs (interior and exterior) and restore full inside diameter and a smooth, chamfered exterior surface. The fitting alignment shall be checked against the mark on the pipe or tubing to ensure the pipe or tubing is inserted into the fitting. The joint shall be pressed using the tool recommended by the manufacturer.
- E. Ring-Type Pipe: Joints shall be installed in accordance with manufacturer's instructions with grooved couplings, fittings and rubber rings. Couplings and pipe shall be compatible and of the same manufacturer. Rings shall be accurately located and installed by grooves in coupling. Pipe shall be installed with zero deflection unless otherwise specified. Pressure pipe shall be furnished with thrust blocks at each offset point.
- F. Welded Pipe Joints:
1. Joints in welded steel pipelines shall be installed by oxyacetylene or electric arc process. Welding shall be continuous around pipe and provided as specified.
 2. Butt welds shall be of the single V-type, with ends of pipe and fittings beveled approximately $37\frac{1}{2}$ degrees. Piping shall be aligned before welding is started with the alignment maintained during welding.
 3. Welds for flanges and socket fittings shall be of the fillet type with a throat dimension not less than pipe wall thickness.
- G. Grooved End Pipe Joints: Grooved end joints for carbon steel piping shall be assembled in accordance with the latest manufacturer recommendations. Pipe ends shall be clean and free from indentations, projections, and roll marks in the area from pipe end to groove for proper gasket sealing. Grooving tools shall be as manufactured by Victaulic, RIDGID, MAG Tool, or equal.
- H. Joints shall be Vic-Press 304TM, or equal, made with Victaulic Series 'PFT' tools and the appropriate sized jaw. Pipe shall be certified for use with Vic-Press 304TM system, and shall be square cut, properly deburred and cleaned, and marked at the required location to insure full insertion into the fittings and/or couplings.
- I. Valves: Valves shall conform to the following:

1. Piping systems shall be furnished with valves at points indicated on Drawings and specified, arranged to provide complete regulating control of piping system throughout building and the Project site.
2. Valves shall be installed in a neat grouping, so that parts are easily accessible and maintained.
3. Valves shall be full size of line in which they are installed, unless otherwise indicated on Drawings or otherwise specified, and shall be one of types specified.
4. Provide chain operators on valves 2-inch and larger located 7 feet or more above the servicing floor level.
5. Valves for similar service shall be of one manufacturer.
6. Except where otherwise specified, valves shall be Belimo, Victaulic, Stockham, Crane, Jenkins, Milwaukee, Hammond, American, NIBCO, Hoffman, or equal.
7. Ball valves below grade in yard boxes shall have stainless steel handles.
8. Hose bibs in dense garden areas shall be $\frac{3}{4}$ inch in size with one hose bib in the lunch pavilion 1 inch in size. Other hose bibs shall be $\frac{3}{4}$ inch lock shield type. Bibs shall be furnished with vacuum breaker protection.

J. Hangers and Supports:

1. Piping shall be securely fastened to building structure by approved iron hangers, supports, guides, anchors, and sway braces to maintain pipe alignment to prevent sagging and to prevent noise or excessive strain on piping due to uncontrolled or seismic movement under operating conditions. Hangers and supports shall conform to Manufacturer's Standardization Society Specification SP-69. Hangers shall be relocated as required to correct unsatisfactory conditions that may become evident when system is placed into operation.
2. Hose faucets and similar items at ends of pipe branches shall be rigidly fastened to building construction near point of connection.
3. Piping shall not be supported by wire, rope, wood, plumbers' tape, or other non-recognized devices.
4. Hangers and supports shall be designed to support weight of pipe, fittings, weight of fluid and weight of pipe insulation, and shall have a minimum factor of safety of five, based on ultimate tensile strength of material installed.

5. Burning or welding of any structural member under load is not permitted. Field welding not specified on Drawings or reviewed Shop Drawings is not permitted without review by ARCHITECT.
6. Burning holes in beam flanges or other structural members is not permitted without review by the ARCHITECT.
7. Hanger rods shall be fastened to structural steel members with suitable beam clamps. Clamps shall be Tolco, Carpenter & Patterson, Fee and Mason, or equal, as follows:
 - a. Tolco I beam, Fig.62 for maximum 1000 pounds.
 - b. Tolco I or WF beam, Fig. 329, for maximum of 1290 pounds.
8. Hanger rods shall be fastened to concrete inserts in concrete slabs or beams. Inserts shall be Tolco, Carpenter & Patterson, Fee and Mason, or equal, as follows:
 - a. Tolco Fig.310 for maximum of 600 pounds.
 - b. Tolco Fig. 309 for maximum of 1140 pounds.
9. Hanger rod sizes for copper, iron, or steel pipe: 3/8 inch for pipe sizes 1/2 inch through 2-inch, 1/2 inch for pipe sizes 3-inch, 4-inch and 5-inch, 5/8 inch for pipe size 6-inch, and 3/4 inch for 8-inch and 10-inch pipe.
10. Turnbuckles, if furnished, shall provide a load carrying capacity equal to that of the pipe hanger with which they are being installed.
11. Pipe hangers shall be of same size, or nearest larger manufactured size available, as pipe or tubing on which they are being installed.
12. Hangers, clamps, and guides furnished for support of non-metallic pipe shall be padded with 1/8 inch thick rubber, neoprene, or soft resilient cloth.
13. Where special pipe-supporting requirements in the Specifications conflict with any standard requirements specified herein, the Specification requirements shall govern.

END OF SECTION

SECTION 22 1000

PLUMBING

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes: Labor, materials, tools, and equipment to install plumbing systems as indicated.
- B. Related Sections:
 - 1. Division 01 - General Requirements.
 - 2. Section 22 0500: Common Work Results for Plumbing.
 - 3. Section 22 0513: Basic Plumbing Materials and Methods.

1.02 SUBMITTALS

- A. Provide in accordance with Division 01 and Section 22 0500: Common Work Results for Plumbing.

1.03 QUALITY ASSURANCE

- A. Unless otherwise noted, the California Plumbing Code is hereby made part of this section.
- B. Conform to provisions of Section 22 0500: Common Work Results for Plumbing.

1.04 PRODUCT HANDLING

- A. Conform to provisions of Section 22 0513: Basic Plumbing Materials and Methods.

PART 2 - PRODUCTS

2.01 PIPING SYSTEMS

- A. Materials: Refer to Section 22 0513: Basic Plumbing Materials and Methods.

2.02 FIXTURES AND DRAINS

- A. General: Fixtures specified shall be furnished complete with trim and fittings.
- B. Finished Brass:
1. Unless otherwise specified, finished brass of a similar type shall be of same manufacturer and model throughout buildings.
 2. Finished and exposed brass equipment shall be nickel-bronze metal.
- C. Faucet Handles: Faucet handles shall be solid brass, chromium-plated and polished, and fastened to their stems by Allen type hollow head stainless steel set screws through the side of the handle extending into the stem. Handles with sharp edges or projections shall not be furnished.

2.03 DIELECTRIC UNIONS

- A. Schedule Numbers:
1. Dielectric style Unions using ferrous and no-ferrous metals are prohibited. Dielectric flanges are admitted for use – see DU-2.

DU-1: Lead Free Brass union with 6-inch Lead Free Brass nipple.

DU-2: Lead Free Brass union or Lead Free Brass flanged fittings are to be used in between pipes made of dissimilar metals to prevent accelerated corrosion and deterioration in the piping systems due to galvanic and stray current.

WATTS	WILKINS	ZURN	NIBCO	OR EQUAL
LF3100M3			733-LF	

2.04 HOSE BIBBS

- A. Schedule Numbers:

HB-2: For brick, CMU and poured in place concrete walls, furnished with box and stop, exposed trim chrome-plated, with or without door and with vacuum breaker.

ACORN	WOODFORD	PRIER	OR EQUAL
8141, 8104, 8151	B75	C-633NFC	

HB-3: ASTM B 62 bronze body, rubber composition disc or renewable seat, straight nose with brass die cast or enamel iron hand wheel and with vacuum breaker.

ACORN	ZURN	WOODFORD	PRIER	OR EQUAL
8131-RBVB	Z-1343-VB	Y24	C-155	

2.21 SERVICE SINKS and TRIM (DRINKING TROUGH)

A. Schedule Numbers:

SS-1: Fiat 24"x24"x12" terrazzo model number TSBC1610501 available from Grainger. Provide strainer Zurn D-2 or equal. Provide 2 inch waste line with brass ball valve.

2.22 TRENCH DRAIN

A. Schedule Numbers:

TD-1: ZURN Z883 or equal cast in place trench drain with ductile iron slotted grate.

2.23 YARD BOXES

A. Schedule Numbers:

YB-1 Yard Boxes: 14 3/4-inch by 20-inch by 12-inch, cast concrete, with cast iron hinged locking traffic cover marked "WATER"

BROOKS No. 36-HFL Assembly with cast iron hinged locking cover	OR EQUAL
--	----------

PART 3 - EXECUTION

3.01 EXAMINATION

A. Examine areas and conditions under which Work of this section will be performed. Correct conditions detrimental to proper and timely completion of Work. Do not proceed until unsatisfactory conditions have been corrected.

3.02 INSTALLATION

A. General:

1. Unless otherwise specified, plumbing fixtures, equipment and appliances that require connections to plumbing line shall be connected. This shall include fixtures specified or indicated as furnished by others, furnished by Owner, or specified in other related sections. Install supplies, stops, valves, traps, wall flanges, or pipe casing for connection of this equipment.
2. Install equipment as indicated on reviewed and accepted Shop Drawings.

3. Avoid interference with Work of other trades. Do not deviate from Drawings without review of the Architect.
- B. Examination: Check each piece of equipment in system for defects verifying that parts are properly furnished and installed.
- C. For piping Work, refer to Section 22 0513: Basic Plumbing Materials and Methods.
- D. Plumbing Fixture and Equipment Installation:
1. Unless otherwise indicated, fixtures shall be installed with 5/16 inch brass bolts or screws of sufficient length to securely fasten fixture to backing, wall, or closet ring.
 2. Fixtures installed against concrete or masonry walls shall have their hangers fastened with 5/16 inch brass bolts, Philip Shield type anchors, or 2 unit cinch anchors. Wood or plastic plugs are not permitted.
 3. Fixtures installed against wood or metal stud walls shall have their hangers fastened to metal backing plates with 5/16 inch brass bolts screwed into plate. Fixture hangers for urinals shall be fastened centered vertically on metal backing plate with three 5/16 brass bolts each for small individual hangers and six, for larger one piece hangers. Lavatories shall be hung with not less than four 5/16 inch brass bolts or not less than five 1/4 inch brass bolts. Each sink hanger shall be hung with not less than four 5/16 inch brass bolt or not less than five 1/4 inch brass bolts.
 4. Pan type drinking fountains shall be hung with 5/16 inch cadmium plated bolts with a bolt in each bolt opening in hanger. Hangers for pan type drinking fountains shall provide 2 inches (plus or minus 1/4 inch) between pan and wall. Spaces due to irregularities between fixtures and tile walls shall be neatly filled with white cement or silicone filler.
 5. Backing for hanging of plumbing fixtures and equipment shall be installed in supporting wall at time rough piping is installed. Backing for stud walls shall be steel plate 1/4 inch thick, not less than 4 inches wide. Backing for urinals shall be 1/4-inches thick by 6-inch wide steel plate. Steel plate shall be attached to stud at each end of plate and to each stud it crosses. Plate shall be attached to metal studs by bolting with two 1/4 inch U-bolts per stud with bolts through plate and around stud flange or by welding with a 1/8 inch fillet weld full width of stud flange, top and bottom of plate. At wood studs, plate shall be carefully recessed flush with face of stud and attached to each stud with 2 No. 14 flat-head wood screws, 2 inches in length into pre-drilled 1/8 inch holes. Backing for stud walls supporting wall-hung closets shall be as detailed.

6. Rough-in for fixtures, equipment and appliances shall be as indicated on Drawings and as specified, including those items indicated as furnished by others, furnished by Owner, or future capacity. When connections to equipment from capped or plugged lines are required, caps or plugs shall be removed at time equipment is set and stops or valves installed and connections provided as specified.
7. Piping materials for trap arms shall be Brass, Cast Iron or DWV copper
8. Piping shall be stubbed out to exact location of fixtures and stubs shall be installed symmetrical with fixtures. Hot and cold water supplies for center set faucets on lavatories shall be installed on 8-inch centers, unless otherwise specified or required.
9. Kitchen equipment requiring backflow protection with hot and cold water connections shall be installed with approved backflow prevention assemblies; BPV-3 and drain into floor sink with air gap.

3.03 CLEANING - PLUMBING PIPING SYSTEMS AND FIXTURES

- A. Plumbing lines and fixtures shall be flushed to remove dirt and foreign material until water runs clear and no foreign substance or odor is present. Strainers and screens on faucets shall be removed during this cleaning operation.
- B. After satisfactory cleaning of strainer and screen replacements has been witnessed by the Project Inspector, post and maintain signs stating: "CAUTION - Water at this construction project has not yet been certified for human consumption." Signs shall be furnished with letters at least 1/2 inch in height and shall be conspicuously posted at entrances to the Project site. Signs shall be paneled, black and yellow, in conformance with OSHA Section 1910.1455.

3.04 DISINFECTING DOMESTIC WATER PIPING SYSTEMS

- A. Newly installed or replaced piping and/or fixtures dispensing potable water, and any additional piping and/or equipment impacting the integrity of this system shall be disinfected and undergo an approved bacteriological analysis before water system is allowed for public use.
- B. Disinfection shall commence upon complete installation of all related domestic water systems including fixtures, valves, faucets, water heating systems, etc.
- C. Work shall be performed by Technicians Certified by the American Water Works Association (AWWA) and/or the State of California Department Health Services, Grade II Water Treatment Operator Certification or higher issued by the Department

of Health Services (DHS) for the State of California. Comply with Title 22, Code of Regulations Division 4, Chapter 13, and Article 2 Operator Certification Grades.

D. Method:

1. A Physical Separation of minimum 6" or Reduced Pressure Backflow assembly shall be installed to protect from cross contamination of the local water purveyor's meter service supply when at any time there is any type of water connection with the piping to be disinfected (Chlorinated) and the water meter service supply.
2. Install a Chlorination Port including a T fitting and a shut off valve to the proximity of the point of connection at the new piping system.
3. System is to be flushed to remove any materials that may have entered the system.
4. Using a chemical feed metering pump and a chlorine tank, the chlorine solution is injected into the water system.

E. Disinfection and De-chlorination procedure (24 or 3 Hour Contact Time):

1. 24-hour Test Method:
 - a. Prior to disinfection, post signs on all water outlets of the system to be disinfected. Sign or tags shall read, "Water System Being Chlorinated- "Danger Do Not Drink Water" or similar warning.
 - b. Piping system shall then be adequately flushed with water to remove any particles and eliminate air pockets.
 - c. Using the continuous feed method, sodium hypochlorite conforming to ANSI/ AWWA B300 will be injected into the water system at a minimum of 50 PPM. A water flow meter provided by the water treatment technician will be used to determine the rate of injection and a chlorine test kit, Hach or equivalent, will be used to monitor the residual.
 - d. Chlorine residual test will be taken at all appropriate points and outlets to verify 50 PPM residual levels.
 - e. The chlorinated system shall be shut down for any use and the chlorinated water shall remain in the water system for retention of 24 hours.
 - f. After 24 hours, chlorine residual levels will again be tested at various points throughout the system to insure a minimum of 25 PPM

residual. If the system has not met the minimum of a 25 PPM residual, the above disinfection process shall be repeated.

- g. After satisfactory completion of the residual testing, flush out system until Hach or equivalent test reveal the water outlets have a free chlorine residual concentration less than 0.5 PPM. The procedure shall be in accordance with the AWWA standard C651-05.
- h. The OAR may allow temporary use of the water system for construction purposes pending results of the bacteriological test analysis. Sign or Tags shall be left on all outlets stating water system is not safe for consumption until laboratory results are complete and meet these specifications.

2. 3 Hour Test Method:

- a. If the water systems must be turned on for use as soon as possible, a 3 hours chlorine contact time to allow for disinfection is permitted with the OWNER's approval.
- b. Prior to disinfection, post signs on all water outlets of the system to be disinfected. Sign or tags shall read, "Water System Being Chlorinated- "Danger Do Not Drink Water" or similar warning.
- c. Piping system shall be then adequately flushed with water to remove any particles and eliminate air pockets. Using the continuous feed method, sodium hypochlorite conforming to ANSI/ AWWA B300 will be injected into the water system at a minimum of 200 PPM. A water flow meter provided by the water treatment technician will be used to determine the rate of injection and a chlorine test kit, Hach or equivalent, will be used to monitor the residual.
- d. Chlorine residual test will be taken at all appropriate points and outlets to verify 200 PPM levels. The chlorinated system shall be shut down for any use and the chlorinated water shall remain in the water system for retention of 3 hours.
- e. After satisfactory completion of a 3 hour disinfection period, flush out system until Hach or equivalent test reveal the water outlets have a free chlorine residual concentration less than 0.5 PPM. The procedure shall be in accordance with the AWWA standard C651-05.
- f. The OWNER may allow temporary use of the water system for construction purposes pending results of the bacteriological test analysis. Sign or Tags shall be left on all outlets stating water system

is not safe for consumption until laboratory results are complete and meet these specifications.

F. Bacteriological Test:

1. After final flushing and satisfactory results from the residual free chlorine concentration test, Bacteriological test samples shall be collected. The intent of the following is to provide insurance for an accurate representation to a complete Bacteriological test of the water system. At least two samples shall be taken from each floor of each building.
2. Bacteriological test samples shall be delivered to a State of California Department of Health Services Certified Laboratory to perform qualitative and quantitative bacterial analyses on the water samples for the presence of any Total Coliform bacteria and Plate Count. This count must be less than 500 cfu/mL.
3. The procedure shall be repeated if it shown by bacteriological examination made by an approved agency that the level of Disinfection does not meet these specifications.
4. After satisfactory results for the bacteriological test are provided to the OAR, the physical barrier or temporary reduce pressure back flow devise shall be removed, and the new piping shall be connected to the point of connection. All the connecting piping and fittings shall be disinfected prior to installation. Chlorination Port shall be capped water tight. Warning sign or tags shall be removed.

- G. Drinking Fountain and Bottle Filler Lead Test: After installation of Drinking Fountain or Bottle Filler, and successful Bacteriological Test, shut off domestic water supply line feeding the fixture, and inform OWNER. Do not remove related construction warning sign and tags.

3.05 VALVES ON PLUMBING SYSTEM

- A. Furnish and install gates, ball, globes, angles, and check valves on plumbing Work at following locations whether indicated on drawings or not.
- B. Hot and cold valves shall be:
1. Lead free complying with AB1953.
 2. Above the ground copper water system, 2-inch and larger, may utilize Victaulic butterfly valves and fittings for their connections. A 2-inch or larger Victaulic valve may be in a wall if an adequately sized access panel is provided for maintenance or removal.

3.06 ELECTROLYSIS PREVENTION

- A. Brass nipples, 6 inches, with recognized brass unions; flanges shall be furnished and installed at locations described herein. Flanges shall be installed with complete insulating component consisting of gasket bolt sleeves and bolt washers. Dielectric insulators shall be installed at following locations:
1. Where special applications indicated on Drawings require an insulation flange or brass union, with 6-inch brass nipple to be installed in a condensate line, or steam line, flange insulation shall be of a high temperature type, suitable for continuous operation at temperatures up to 220 degrees F. for condensate and 400 degrees F. for steam.
 2. Where steel or cast iron in ground connects to copper or brass piping above ground, transition from steel or cast iron pipe to copper or brass pipe shall be provided in an accessible location.
 3. Underground dielectric connections shall be furnished in accessible yard boxes.
 4. Above ground dielectric connections shall be exposed; or if in finished rooms shall be located in accessible access boxes.

3.07 UNDERGROUND PIPE MARKERS

- A. Pipe markers shall be furnished according to Section 22 0553: "Plumbing Identification"
- B. Underground Caution Tape shall be placed 12 to 18 inches above the utility line. The Caution Tape shall be a designated color and marked with the appropriate name for the specific type of utility pipe as follows:
1. Blue – with the words: CAUTION WATER LINE BELOW

3.08 CLEANUP

- A. Remove rubbish, debris, and waste materials and legally dispose off Project site.

3.09 PROTECTION

- A. Protect Work of this section until Substantial Completion.

END OF SECTION

SECTION 26 0000
GENERAL PROVISIONS

PART 1 - GENERAL

- A. The general contract provisions apply to this section and take precedent over this section in case of conflict.

1.01 GENERAL PROVISIONS

- A. This division supplements the applicable requirements of other divisions.

1.02 DEFINITIONS

- A. For the purposes of Division 260000, the following definitions apply:
 - 1. Provide: Furnish and install.
 - 2. Indicated: As shown on the drawings or specified herein.
 - 3. Circuit Designation: Panel designation and circuit number, i.e., LA-13.
 - 4. Approved equal: Approved by the engineer of record as equal in his sole determination.

1.03 SCOPE OF WORK

- A. The Specifications for Work of Division 260000 include, but are not limited to the following sections:

26 0000–General Provisions

26 0050–Basic Electrical Materials and Methods

26 0060–Minor Electrical Demolition for Remodeling

26 0111–Conduits

26 0116–Wire Basket Cable Trays

26 0120–Conductors

26 0130–Electrical Boxes

26 0140–Wiring Devices

26 0142–Nameplates and Warning Signs

26 0164–Branch Circuit Panelboards

26 0170–Disconnects

26 0190–Support Devices

26 2450–Grounding

26 2510–Lighting Fixtures

- B. Work Included: All labor, materials, appliances, tools, equipment, facilities, transportation and services necessary for and incidental to performing all operations in connection with furnishing, delivery and installation of the work of this division, complete, as shown on the drawings and/or specified herein. Work includes, but is not necessarily limited to the following:
1. Examine all divisions for related work required to be included as work under this division.
 2. General provisions for electrical work.
 3. Site observation including existing conditions.
- C. Related Work Specified Elsewhere but included in the scope of work:
1. Motors and their installation.
 2. Control wiring and conduit for heating, ventilating and air conditioning.
- D. Work Not In Contract (N.I.C.):
1. Telephone instruments.
- E. Coordination
1. The following supplements are additional General Requirements pertaining to work of this Division. Provisions of Division 1 - General Requirements shall remain in effect.
 - a. Coordinate work of various sections of Division 26 and 27.
 - b. Coordinate work of this Division 26 with work of Divisions 2 through 25.

1.04 REFERENCE STANDARDS

- A. American National Standards Institute (ANSI).
- B. Association of Edison Illuminating Companies (AEIC).
- C. Electrical Testing Laboratories (ETL).
- D. Illuminating Engineering Society (IES).
- E. Institute of Electrical and Electronic Engineers (IEEE).
- F. Insulated Cable Engineers Association (ICEA).
- G. National Electrical Manufacturers Association (NEMA).
- H. National Fire Protection Association (NFPA).
- I. Underwriters Laboratories, Inc. (UL).
- J. California State Fire Marshal (CSFM).
- K. California Energy Commission (CEC) Title 24.

1.05 QUALITY ASSURANCE

- A. Regulations: All the electrical equipment and materials, including their installations, shall conform to the following applicable latest codes and standards:
 - 1. California Electric Code, Latest Adopted Edition (NEC), 2008 unless a more current version has been adopted.
 - 2. Local and State Fire Marshal.
 - 3. Occupational Safety and Health Act (OSHA).
 - 4. Requirements of the Serving Utility Company.
 - 5. Local Codes and Ordinances.
 - 6. Requirements of the Office of the California State Architect (OSA).
 - 7. California Administrative Code, Title 8, Chapter 4, Industrial Safety Orders.
 - 8. California Administrative Code, Title 24.
 - 9. County of Ventura Codes and Regulations.

- B. Variances: In instances where two or more codes are at variance, the most restrictive requirement shall apply. In instances where plans and specifications are at variance or conflict the most restrictive requirement shall apply. Contractor shall be responsible for all his associated work and materials and also the work and materials of related or affected trades.
- C. Contractor's Expense: Obtain and pay for all required bonds, insurance, licenses, and pay for all taxes, fees and utility charges required for the electrical work.
- D. Testing and Adjustment:
 - 1. Perform all necessary tests required to ascertain that the electrical system has been properly installed, that the power supply to each item of equipment is correct, and that the system is free of grounds, ground faults, and open circuits, that all motors are rotating in the proper directions, and such other tests and adjustments as may be required for the proper completion and operation of the electrical system. Contractor shall provide a copy of all test reports to prove these tests have been performed.
 - 2. If, during the course of testing, it is found that system imbalance is in excess of 20%, rearrange single-pole branch circuit in lighting and receptacle panels to bring system balance to within 20% on all phases. Record all such changes on the typewritten panelboard schedule and submit a summary of changes to the Engineer on the record drawings.

1.06 SUBMITTALS

- A. Procedure: In accord with the Submittal Section.
- B. Shop drawings: Detailed shop drawings for the following equipment:
 - 1. Plug-in busways.
 - 2. Distribution panelboards.
 - 3. Branch circuit panelboards.
 - 4. Circuit breaker load center.
 - 5. Cable trays and accessories.
 - 6. Lightning protection.
 - 7. Uninterruptible power supplies.
 - 8. Switchboards.

9. Ground fault protection.
10. Ground fault detection and alarm.
11. Highway and roadway light poles.
12. Dimmer cabinets.
13. Emergency generators.
14. Fire alarm system.
15. Vault alarm system.
16. Motor control centers.
17. Contactors and cabinet.
18. Security system.
19. Low voltage cabling riser diagram

C. Product data: Detailed manufacturer's data for:

1. Underfloor duct.
2. Cable tray.
3. Cabinets.
4. Concrete pull boxes.
5. Disconnects.
6. Individually mounted circuit breakers.
7. Auto-transfer switches.
8. Transformers.
9. Capacitors.
10. Lighting fixtures and associated equipment including control.
11. Generators.
12. AM & CS door alarms.
13. Electric door strikes.

14. Audio systems.
 15. Gel-filled wire connectors.
- D. Test results for the following:
1. Generator systems.
 2. Fire alarm system.
 3. Vault alarm system.
 4. Circuit breakers.
 5. Grounding systems.
 6. Cables.
- E. Include sufficient information to indicate complete compliance with Contract Documents. Include illustrations, catalog cuts, installation instructions, drawings, and certifications. On each sheet show manufacturer's name or trademark.
- F. Operating, maintenance, and instruction data for:
1. Auto-transfer switches.
 2. Power supplies.
 3. Switchboards.
 4. Ground fault protection.
 5. Alarm and detection.
 6. Dimmer cabinets.
 7. Emergency generators.
 8. Audio equipment.
- G. Instruction materials:
1. Provide at the time of personnel instruction period three bound copies of instruction manuals for the systems as listed in Subparagraph 1.04.A.4.f.
 2. Include the following (minimum) information in each copy of instruction manual:
 - a. Manufacturers' names and addresses including phone numbers.

- b. Serial numbers of items furnished.
- c. Catalog cuts, exploded views and brochures, complete with technical and performance data for all equipment, marked to indicate actual items furnished and intended use.
- d. Recommended spare parts.

1.07 OWNER'S PERSONNEL INSTRUCTIONS

- A. Prior to completion of the contract, and at the Owner's convenience, instruct verbally and demonstrate to the Owner's personnel, the operation of the systems as listed under operating, maintenance, and instructional data and/or emergency generator, automatic transfer switch and fire alarm annunciator panel.

1.08 CLEANING

- A. Clean exterior surfaces and interiors of equipment and remove all dirt, cement, plaster and other debris. Protect interior of equipment from dirt during construction and clean thoroughly before energizing.
- B. Clean out cracks, corners and surfaces on equipment to be painted. Remove grease and oil spots so that paint may be applied without further preparation.

1.09 PROJECT RECORD DOCUMENTS - Prepare the following and submit to the engineer before final acceptance:

- A. Mark Project Record Documents daily to indicate all changes made in the field.
 - 1. In addition to general requirements of Project Record Drawings, indicate on drawings, changes of equipment locations and ratings, trip sizes, and settings on circuit breakers, alterations in raceway runs and sizes, changes in wire sizes, circuit designations, installation details, one-line diagrams, control diagrams and schedules.
- B. Use green to indicate deletions and red to indicate additions.
 - 1. Use the same symbols and follow the same drafting procedures used on the Contract Drawings.
- C. Locate dimensionally off of contract drawings all underground conduit stubbed-out for future use, underground feeder conduits, and feeder pull box locations using building lines by indicating on the Project Record Drawings.

- D. At the completion of underground conduit installation provide underground conduit record documents to owner's representative.
- E. Two copies, in binder form, of all test results as required by these specifications - 260030.
- F. Two copies of local and/or state code enforcing authorities final inspection certificates.
- G. Two copies, in binder form, of electrical equipment cut sheets, manufacturer's installation instructions, warranty certificates, and product literature for all products utilized on project.

1.10 SERVICE INTERRUPTIONS AND UTILITY

- A. Coordinate with the Owner the interruption of services necessary to accomplish the work.
- B. Coordinate with the utility company all work associated with power and communications distribution systems and service entrance equipment.
- C. Electrical contractor shall supply temporary power for all trades.

1.11 MINIMUM SPECIFICATION REQUIREMENTS (ALL WORK OF DIVISION 260000)

- A. As a minimum Specification requirement, all materials and methods shall comply with applicable governing codes.

1.12 PENETRATION SEALING

- A. Seal penetration through exterior walls and fire rated walls, floors, ceilings, and roofs with 3M Firestopping materials of fire rating capacity rated per architectural plans and UBC or prevailing building code requirements.

1.13 PLACING EQUIPMENT IN SERVICE

- A. Do not energize or place electrical equipment in service until all interested parties have been duly notified and are present or have waived their rights to be present. Where equipment to be placed in service involves service or connection from another contractor of the owner, notify the owner in writing when the equipment will be ready for final testing/connection and schedule to the owner's satisfaction of this service connection. Notify the owner two weeks in advance of the date the various items of equipment will be complete.

1.14 OWNER-FURNISHED ITEMS

- A. Pick up Owner-furnished items and handle, deliver, install, and make all final connections.
 - 1. Assume responsibility for the items when consigned at the storage facility or in the field in accord with requirements of the Contract Documents.

1.15 ELECTRIC ITEM LOCATION

- A. Electrical drawings are generally diagrammatic. Verify equipment sizes with shop drawings and manufacturers' data and coordinate location layout with other trades. Notify owner and engineer of any changes of location requirements prior to installation and obtain engineer's written acceptance for all changes/revisions.

1.16 DEMOLITION

- A. Scope: Provide and perform demolition, preparatory and miscellaneous work as indicated and specified, complete.
- B. Principle Items of Work:
 - 1. Demolition and removal of existing electrical conduit, wiring and equipment required to complete the project.
 - 2. Preparation of the existing building to receive or connect the new work.
 - 3. Miscellaneous demolition, cutting, alteration, and repair work in and around the existing building necessary for the completion of the entire project.
 - 4. Disconnecting and reconnection of electrical equipment as required by the construction modifications.
- C. Existing Conditions: Make a detailed survey of the existing conditions pertaining to the work. Check the locations of all existing structures, equipment and wiring (branch circuiting and controls). Provide at bid time any exclusions for existing conditions work.
- D. Salvage and Disposal: All removed material other than items to be reused shall be returned to the owner or disposed of in accordance with instructions from the owner's representative. Disposal shall be done in accordance with EPA and governing body requirements and regulations. Contractor shall pay all fees and charges for disposal.

1.17 ELECTRICAL WORKMANSHIP REQUIREMENTS

- A. It is required that all electrical construction of this Contract be performed by journeyman electricians. All journeyman electricians shall have a minimum of 4 years of apprenticeship training and hold a valid Certificate of Completion from an apprenticeship training course approved by the State of California Department of Industrial Relations, Division of Apprenticeship Standards. This is intended to mean that a person who does not hold a valid Certificate of Completion from an apprenticeship training course approved by the State of California Department of Industrial Relations, Division of Apprenticeship Standards will not be permitted to do electrical work of any kind that involves new construction, nor make repairs, alterations, additions, or changes of any kind to any existing system of electrical wiring, apparatus, equipment, light, heat, or power.
- B. Contractor may employ electrical helpers or apprentices on any job of electrical construction, new or existing, when the work of such helpers or apprentices is performed under direct and constant personal supervision of a journeyman electrician holding a valid Certificate of Completion from an apprenticeship training course approved by the State of California Department of Industrial Relations, Division of Apprenticeship Standards.
 - 1. Each journeyman electrician will be permitted to be responsible for quality of workmanship for a maximum of eight helpers or apprentices during any same time period, provided the nature of work is such that good supervision can be maintained and quality of workmanship achieved is the best, as expected by Owner and as implied by the latest edition of the California Electrical Code (National Electrical Code with State of California amendments).
 - 2. Before each journeyman electrician commences work, deliver to Owner at project site a photocopy of journeyman's valid Certificate of Completion from an apprenticeship training course approved by the State of California Department of Industrial Relations, Division of Apprenticeship Standards.
- C. All electrical systems shall be installed in a neat and workmanlike manner per National Electrical Code requirements and ANSI approved NEIS National Electrical Installation Standards.

1.18 DESIGN CHANGES AFTER AWARD OF BID

- A. When a change in the quantity or size of conductors is made, the conduit size will remain in accordance with that indicated in the original contract drawings rather than the drawing symbol conduit table. When code permits, provide conductor insulation 'THWN' where required to maintain conduit fill conformance with the National Electrical Code.

1.19 CREDITS AND EXTRAS (in case of conflict the provisions of section 1000 shall govern)

- A. Material prices shall be in accordance with the latest issue of Trade Service Publication Inc's. 'Electrical Trade Book', less contractor's discount, or submitted manufacturer's or supplier's quotes, plus tax and 1% cartage.
- B. Labor rates shall be based on local union scale and shall include only benefits required by the union.
- C. The maximum charged for the Foreman or General Foreman shall be the minimum required by the local union.
- D. The amount of labor charged to accomplish the required work shall be based on NECA's 'Manual of Labor Rates'.
- E. The amount of added direct labor cost shall not exceed 30% of the actual labor cost and shall include insurance, taxes, small tools, payroll expenses, office supervision, management development, training, and etc.
- F. Rental cost or rates shall be based on the American Equipment Dealers rated manual, less contractor's discount. Copies of the Equipment Rental Invoices shall be submitted to the architect.
- G. The contractor and the architect shall negotiate any cost item where it can be shown that the job conditions are beyond the scope of the above listed manuals. In this case, the burden of proof shall be the responsibility of the contractor. He shall provide invoices, detailed breakdowns, confirmation by the resident inspector of existing conditions and etc., as may be required to justify his claim.
- H. The fee for the prime electrical sub-contractor shall be in accordance with the general and supplemental conditions of the specification, but shall not exceed 5% overhead and 5% profit. No additional overhead and profit shall be allowed for sub-contractors to the prime sub-contractor.
- I. The contractor shall submit detailed material and labor cost breakdown on all cost changes to the contract in the form directed by the architect.
- J. For credit changes to the contract, the fee shall not be included, except where additions and deductions are made by a single change order, the cost shall be based on the net change in material and labor prior to determining the fee.

1.20 MATERIAL AND EQUIPMENT SUBSTITUTION

- A. Where two or more trade names or manufacturers are mentioned, selection shall be made from the group listed for use in the base bid. The order in which names are listed is not intended to be any indication of preference.
- B. Where a single manufacturer, product or trade name is stated, that manufacturer, product or trade name shall be used in the base bid. The use of other manufacturers,

products or trade names will be considered by the engineer of record (unless that product is indicated for no substitution) only if submitted as alternate items at the time of bidding, with evidence of equality and a statement of net price difference as compared to the specified item. After approval by the engineer of record, the architect and owner reserve the right to review such submittals and to determine the acceptability for use.

- C. Equipment other than that specified will be accepted only when written approval is given by the engineer of record and architect, in accordance with Division 1.
- D. The contractor shall be held responsible for all physical changes in piping, equipment, etc. resulting from equipment substitution and likewise bear any increased cost of other trades in making said substitution. Approval by the architect of equipment other than that specified does not relieve this contractor of this responsibility.

1.21 REQUESTS FOR INFORMATION

- A. The contractor shall submit all requests for information (RFI's) typewritten on the attached form.

PART 2 - PRODUCTS

Not Used.

PART 3 - EXECUTION

Not Used.

END OF SECTION

SECTION 26 0050
BASIC ELECTRICAL MATERIALS & METHODS

PART 1 - GENERAL

- 1.01 DESCRIPTION: Division 1 applies to this Section. This Section contains general requirements for the Sections in Division 26.
- A. Related Work Not in Division 26: Refer to individual Division 26 Sections.
- 1.02 QUALITY ASSURANCE:
- A. Codes: Entire installation shall comply with requirements of authorities having jurisdiction.
- B. Permits: Contractor shall pay for all permits required by work under this Division.
- C. Inspections: Contractor shall arrange for all inspections and correct non-complying installations.
- 1.03 SUBMITTALS: Refer to Division 1 for procedures.
- A. Material and Equipment: Prior to start of work, 6 copies of a list of all materials and equipment covered by Division 26 shall be submitted for approval. Contractor shall allow ample time for checking and processing and shall assume responsibility for delays incurred due to rejected items. No installation of material concerned shall be made until such written approval has been obtained. Approval of materials and equipment shall in no way obviate compliance with the Contract Documents. Each item proposed shall be referenced to the applicable Section, Page, and Paragraph of Division 26. For each item proposed, give name of manufacturer, trade name, catalog data, and performance data.
- B. Equipment Layout Drawings: Submit "Equipment Layout Drawings" for each equipment room or area containing equipment items furnished under this Division. Layout Drawings shall consist of plan view of room, to scale, showing projected outlines of all equipment, complete with dotted line indication of all required clearances including all those needed for removal or service. Location of all conduit and pull boxes shall be indicated.
- C. Service Manuals: NOT APPLICABLE
- D. Record Drawings: Prepare and submit in accordance with requirements. Contractor shall make notations, neat and legible, daily as the work proceeds. Drawings shall be available for inspection at all times and kept at the job site. All buried conduit and/or indicated future connections outside any building shall be located both by depth and by accurate measurement from a permanently established landmark such as a building or structure.
- E. Seismic Calculation: Refer to Article 3.01 herein.
- F. Spare Parts: Conform to the Submittal Section. Deliver following spare parts to Owner and obtain receipts. Submit at same time as Operating Instructions:

1. Spare fuses; 1 set for each combination fuse breaker.
 2. Spare pilot light lamps of each type used on project, in quantity of 10%, but not less than 2%.
 3. Overload heater elements; 2 sets for each size used on project.
- G. Special Tools: If any part of the equipment furnished under Division 26 requires a special tool for assembly, adjustment, resetting, or maintenance thereof and such tool is not readily available on the commercial tool market, it shall be furnished with the equipment as a standard accessory and delivered to the Owner.
- H. Maintenance Paint: One (1) can of touch-up paint shall be delivered to Owner for each different color factory finish which is to be the final finished surfaces of the product.
- 1.04 DRAWINGS:
- A. Diagrammatic Drawings: For purposes of clarity and legibility, drawings are essentially diagrammatic although size and location of equipment is drawn to scale wherever possible, Contractor shall make use of data in all the Contract Documents and verify information at building site.
 - B. Routing of Conduit and Piping: The drawings indicate required size and termination of conduits and raceways. It is not intent to indicate all necessary offsets and it shall be the responsibility under this Division to install conduit in such a manner as to conform to structure, avoid obstructions, preserve headroom, keep openings and passageways clear, and make all equipment requiring inspection, maintenance and repair accessible without extra cost to the Owner.
 - C. Coordination with Other Trades: Check with other Divisions of the Specifications so that no interference shall occur and in order that elevations may be established for the work. Installed work which interferes with the work of other trades shall be removed and rerouted at the discretion of the Architect.
- 1.05 DAMAGE AND REPAIRS:
- A. Emergency Repairs: Owner reserves the right to make temporary repairs as necessary to keep equipment in operating condition without voiding Contractor's warranty or relieving Contractor of his responsibility during warranty period.
 - B. Responsibility for Damage: Contractor shall be responsible for damage to grounds, buildings, or equipment due to work furnished or installed under this Division 26.
- 1.06 PROTECTION, CARE, AND CLEANING:
- A. Protection: Provide adequate protection for finished parts of materials and equipment against physical damage from any cause during progress of work and until final completion. Sensitive electrical equipment shall not be installed until major construction is completed.
 - B. Care: During entire construction, properly cap all lines and equipment to prevent entrance of sand and dirt. Protect equipment against moisture, plaster, cement, paint or work of other trades by covering with polyethylene sheets.

- C. **Cleaning:** After installation is completed, clean all systems as follows in addition to requirements specified:
 - 1. **Field Painted Items:** Clean exterior of conduits, raceways, piping and equipment exposed in completed structure; removing all rust, plaster, cement and dirt by wire brushing. Remove grease oil and similar materials by wiping with clean rags and suitable solvents.
 - 2. **Factory Finished Items:** Remove grease and oil on all factory finished items such as cabinets and controllers, and leave surfaces clean and polished.
- D. **Connection:** Prior to energizing, check all electrical connection hardware and torque where necessary.

PART 2 - PRODUCTS

- 2.01 **PRODUCTS:** Products and materials shall be as specified in the pertinent Sections of Division 26.
- 2.02 **MATERIALS AND EQUIPMENT:** Wherever possible, all materials and equipment used in installation of this work shall be of same manufacturer throughout for each class of material or equipment. Materials shall be new and bear UL label, wherever subject to such approval. Comply with ANSI, IEEE and NEMA standards, where applicable.

PART 3 - EXECUTION

- 3.01 **SEISMIC REQUIREMENTS:** Electrical equipment for emergency systems shall be braced to withstand the lateral forces that result from earthquakes. Under Work of Division 26, submit seismic calculations stamped and signed by a registered California structural engineer confirming size, number, and location of required anchoring hardware. Electrical equipment vendors shall furnish weights together with dimensions and the center of gravity location for all emergency electrical equipment for this purpose.
- 3.02 **GENERAL LATERAL BRACING REQUIREMENTS:** As shown on Drawings. Additional bracing requirements shall conform to specific requirements shown on Drawings or in other Sections of Division 26. Anchorages for equipment subject to thermal expansion and movement shall conform to manufacturer's recommendation and intent of general bracing requirements. When general and specific bracing requirements enumerated above are in conflict with referenced standards, the most stringent requirements shall govern.
- 3.03 **EXCAVATION AND BACKFILL:** Perform all excavation and back fill required to install Work of Division 26, both inside and outside. Perform all excavation and backfilling in accordance with Division 2.
 - A. **Excavation:** Bury conduits outside building to a depth of not less than 24" (or as required by Code) below finish grade, unless noted otherwise.

- B. Backfilling: Do not backfill until after final inspection and approval of conduit installation by all legally constituted authorities and recording of the buried items on the Record Drawings.
- 3.04 CUTTING AND PATCHING:
- A. Cutting of Existing Structural Work: Holes in existing slabs and concrete walls shall be cored to the minimum size required. The Contractor shall submit Drawings showing dimensioned sizes and locations for all such holes to Architect for approval before cutting. Where required for conduit installation, slabs on grade shall be saw-cut to minimum required width; submit cutting Drawings to the Architect for approval before cutting.
- B. Patching: Holes or chases shall be patched to match adjacent surfaces.
- 3.05 CONCRETE WORK: Concrete construction required for the Work of Division 26 shall be provided under the Work of Division 26.
- 3.06 PAINTING: Finish painting of electrical equipment will be per manufacturers standards, unless equipment is herein specified to be furnished with factory applied finish coats. Equipment to be field painted shall be furnished with a factory applied prime coat.
- A. Touch-Up: If factory finish on any equipment furnished under Division 26 is damaged in shipment or during construction of building, the equipment shall be refinished by Contractor to satisfaction of Architect.
- B. Concealed Equipment: Uncoated cast-iron or steel that will be concealed, or will not be accessible when installations are completed, shall be given one heavy coat of black asphaltum before installation.
- 3.07 OPERATING INSTRUCTIONS: Contractor to provide services of an experienced Engineer to instruct Owner in operation of entire installation. Instructional period shall be during normal work day hours. This instruction period may be simultaneous with compliance tests.
- 3.08 COMPLIANCE TESTS: Conduct such tests of all portions of installation as may be necessary to ensure full compliance with the Drawings and Specifications. Tests shall be made in the presence of the Owner. Costs of test shall be borne by Contractor and Contractor shall provide all instruments, equipment, labor and materials to complete all the tests. Tests may be required on any item between installation of Work and the end of 1 year warranty period. Should these tests develop any defective materials, poor workmanship or variance with requirements of Specifications, Contractor shall make any changes necessary and remedy any defects at his expense.
- A. All Feeders: Measure and record as follows:
1. 600 volt conductors shall be tested with 500 volt megger to ground on each phase. megger to be on test for one minute before any readings are taken. The minimum values on all feeders shall be 100,000 OHMS.
 2. Copies of the certified test readings shall be transmitted to Owner.

3.09 SYSTEM ACCEPTANCE:

- A. Final Review: The Contractor shall request a final review prior to system acceptance after:
 - 1. Completion of installation of all systems required under the Contract Documents.
 - 2. Submission and acceptance of operating and maintenance data.
 - 3. Completion of identification program.
- B. Acceptance: Is contingent on:
 - 1. Completion of final review and correction of all deficiencies.
 - 2. Satisfactory completion of acceptance tests demonstrating compliance with all performance and technical requirements of Contract Documents.
 - 3. Satisfactory completion of training program and submission of manuals and Drawings required by Contract Documents.

3.10 PRELIMINARY OPERATION: The Owner reserves the right to operate portions of the electrical system on a preliminary basis without voiding the warranty or relieving the Contractor of his responsibilities.

3.11 CLEAN-UP: Conform to the Submittal Section. Upon completion and at other times during progress or Work, when required, remove all surplus materials, rubbish, and debris resulting from Work of Division 26.

END OF SECTION

SECTION 26 0060

MINOR ELECTRICAL DEMOLITION FOR REMODELING

PART 1 - GENERAL

1.01 SECTION INCLUDES

- A. Electrical demolition.

PART 2 - PRODUCTS

2.01 MATERIALS AND EQUIPMENT

- A. Materials and equipment for patching and extending work: As specified in individual Sections.

PART 3 - EXECUTION

3.01 EXAMINATION

- A. Verify field measurements and circuiting arrangements are as shown on Drawings.
- B. Verify that abandoned wiring and equipment serve only abandoned facilities.
- C. Demolition Drawings are based on casual field observation and existing record documents. Report discrepancies to Owner and Architect/Engineer before disturbing existing installation.
- D. Beginning of demolition means installer accepts existing conditions.

3.02 PREPARATION

- A. Disconnect and make safe all electrical systems in walls, floors, and ceilings scheduled for removal.
- B. Coordinate utility service outages with Owner's representative.
- C. Provide temporary wiring and connections to maintain required existing systems in service during construction. When work must be performed on energized equipment or circuits, use personnel experienced in such operations.
- D. Existing Electrical Service: Maintain existing system in service until new system is complete and ready for service. Disable system only to make switchovers and

connections. Obtain permission from Owner at least 72 hours before partially or completely disabling system. Minimize outage duration. Make temporary connections to maintain service in areas adjacent to work area when outage affects business operation.

- E. Existing Fire Alarm System: Maintain existing system in service until new system is accepted. Disable system only to make switchovers and connections. Notify Owner and local fire service at least 72 hours before partially or completely disabling system. Minimize outage duration. Make temporary connections to maintain service in areas adjacent to work area.
- F. Existing Telephone System: Maintain existing system in service until new system is complete and ready for service and new system is accepted. Disable system only to make switchovers and connections. Notify Owner and Telephone Utility Company at least 72 hours before partially or completely disabling system. Minimize outage duration. Make temporary connections to maintain service in areas adjacent to work area.
- G. Existing Security System: Maintain existing system in service until new system is complete and ready for service and new system is accepted. Disable system only to make switchovers and connections. Obtain permission from the Owner and security company at least 72 hours before partially or completely disabling system. Minimize outage duration. Make temporary connections to maintain service in areas adjacent to work area.

3.03 DEMOLITION AND EXTENSION OF EXISTING ELECTRICAL WORK

- A. Demolish and extend existing electrical work under provisions of this Section.
- B. Remove, relocate, and extend existing installations to accommodate new construction.
- C. Remove abandoned wiring to source of supply and re-label devices as spares.
- D. Remove exposed abandoned conduit, including abandoned conduit above accessible ceiling finishes. Cut conduit flush with walls and floors, and patch surfaces.
- E. Disconnect abandoned outlets and remove devices. Remove abandoned outlets if conduit servicing them is abandoned and removed. Provide blank cover for abandoned outlets which are not removed.
- F. Disconnect and remove abandoned panelboards and distribution equipment.
- G. Disconnect and remove electrical devices and equipment serving utilization equipment that has been removed.
- H. Disconnect and remove abandoned luminaires. Remove brackets, stems, hangers, and other accessories.
- I. Disconnect and remove abandoned conduit.

- J. Repair adjacent construction and finishes damaged during demolition and extension work.
- K. Maintain access to existing electrical installations which remain active. Modify installation or provide access panel as appropriate.
- L. Extend existing installations using materials and methods compatible with existing electrical installations, and in compliance with new project specifications.
- M. Modify existing as-built drawings to note changes.

3.04 CLEANING AND REPAIR

- A. Clean and repair existing materials and equipment which remain or are to be reused.
- B. Panelboards: Clean exposed surfaces and check tightness of electrical connections. Replace damaged circuit breakers and provide closure plates for vacant positions. Provide typed circuit directory showing revised circuiting arrangement.
- C. Luminaires: Remove existing luminaires for cleaning. Use mild detergent to clean all exterior and interior surfaces; rinse with clean water and wipe dry. Replace lamps, ballasts, and broken electrical parts.

3.05 INSTALLATION

- A. Install relocated materials and as required by this section and Owner's representative.

END OF SECTION

SECTION 26 0111

CONDUITS

PART 1 - GENERAL

- A. The general provisions apply to this section.

1.01 WORK INCLUDED

- A. Conduits; including:
 - 1. Electrical metallic tubing (EMT).
 - 2. Polyvinyl chloride conduit (PVC).
 - 3. Flexible metal conduit.
 - 4. Liquid-tight flexible metal conduit.

1.02 DEFINITION

- A. Conduit: This term shall be construed to mean conduit and conduit fittings; and tubing and tubing fittings.

1.03 RELATED WORK SPECIFIED ELSEWHERE

PART 2 - PRODUCTS

2.01 MATERIAL AND FABRICATION - ALL MATERIALS SHALL BE MANUFACTURED IN THE USA.

- A. Electrical Metallic Tubing: Manufactured in accordance with ANSI C80.3 and UL 797.
 - 1. Provide compression fittings in walls, ceiling spaces or exposed construction areas.
 - 2. Provide compression (water tight) fittings in damp areas or areas exposed to weather.
- B. Polyvinyl Chloride Conduit: Schedule 40 and schedule 80, manufactured in accordance with ANSI C33.91, UL 651, and Nema TC-2.
 - 1. Cemented type fittings of the same manufacturer as the conduit.
- C. Flexible Metal Conduit: Hot-dipped galvanized steel, manufacturer in accordance with UL 1.
 - 1.

1. Squeeze type, malleable iron, cadmium plated, straight and angle connectors for all sizes and twist-in connectors for 1/2-inch and 3/4-inch flexible metal conduit.
- D. Liquid-Tight Flexible Conduit: Hot-dipped galvanized with liquid-tight vinyl jacket.
1. Liquid-tight fittings.

PART 3 - EXECUTION

3.01 USE

- A. EMT for all exposed and concealed work except as indicated in Paragraphs B, C, D, E, F, and G.
- B. Schedule 80 PVC in areas where exposed conduit could be subject to physical damage or where conduit is exposed and conductor phase to ground voltage exceeds 300 volts.
- C. PVC Conduit:
 1. Schedule 40 for runs below grade in direct contact with earth.
 2. Schedule 40 in concrete floors, walls or roofs.
 3. Schedule 80 for risers and above grade (with UV protection)
- D. Flexible Conduit (steel only permitted):
 1. For connection to equipment subject to vibration, maximum length 18 inches. In wet locations use liquid-tight flexible conduit.
 2. For connection to lighting fixtures above suspended ceilings. Lengths limited to 72 inches.
 3. Install ground conductors in all flexible conduits.
- E. Where 3/4-inch conduit runs are concealed in walls or ceilings and these runs are through wood studs and wood joists, flexible steel conduit may be used up to a maximum length of 6'0".
- F. All risers shall be schedule 80 PVC with bushings.
- G. In concrete or below grade use conduit not smaller than 1 inch. Maximum size in concrete slab: 1 inch. Run larger sizes under slab.
- H. Use long sweep elbows with minimum radius 10 times nominal conduit diameter for all telephone and communication runs.

3.02 INSTALLATION

- A. Provide conduit support and bracing in accordance with the latest published SMACNA guidelines.
- B. Perform excavating, trenching, backfilling, and compacting.
- C. Minimum cover for runs below finished grade outside buildings: 24 inches except where noted or required by the serving utility. Minimum cover for conduit in concrete floors, walls or roof: 1/3 thickness of slab. Minimum cover under building slabs is 12-inches.
- D. Minimum separation from uninsulated hot water pipes, steam pipes, heater flues or vents: 6 inches. Avoid running conduit directly under water lines. Minimum distance to low voltage and audio systems is 12”.
- E. Protect inside of conduit from dirt and rubbish during construction by capping all openings with plastic caps intended for the purpose.
- F. Provide conduit bodies for exposed conduit runs at junctions, bends or offsets where required. Do not use elbows or bends around outside corners of beams, walls or equipment. Make conduit body covers accessible.
- G. Make conduit field cuts square with saw and ream out to full size. Shoulder conduits in couplings.
- H. Run a minimum of one 3/4-inch empty conduit for every three single pole spare circuit breakers, spaces or fraction thereof and not less than two 3/4-inch conduits from every flush mounted panel to an accessible space above the ceiling and below the floor.
- I. Make conduit projections from covered areas to areas exposed to the weather watertight by proper flashing. Extend flashing a minimum of 6 inches in all directions from conduit.
- J. Where conduit is to remain empty, install polypropylene or nylon pull-line 3/16" minimum diameter from end to end with tag at each end designating opposite terminations.
- K. Run conduit parallel and at right angle to building lines, when visible in finished construction.
- L. Cap conduits indicated to be stubbed-out underground using glued-on PVC caps intended for this purpose.
- M. Install a coupling flush with the floor on all conduits stubbed up through floors on grade.
- N. Make no bends with a radius less than 12 times the diameter of the cable it contains nor more than 90 degrees. Make field bends with tools designed for conduit bending. Heating of metallic conduit to facilitate bending is not permitted.

- O. Where conduit installed in concrete or masonry extends across building construction joints, provide expansion fittings as manufactured by O.Z.; Crouse-Hinds; Appleton; or equal, with approved ground straps and clamps.
- P. Concrete Wall or Slab Penetrations: All core drilling, sleeves, blockouts or other penetrations must be approved by the Structural Engineer prior to installation.
 - 1. Space sleeves and core drills to insure a minimum dimension of 3 times the nominal trade diameter of the largest adjacent conduit between sleeves or core drills.
 - 2. Use blockouts for concentrations of conduits in a confined area.
- Q. Do not penetrate walls with flexible conduit where subject to physical damage. Use recessed box with extension ring for transition from interior to exterior of wall.
- R. All homeruns shown shall be run to the panel indicated independently of all other homeruns. Provide pull points so as not to exceed total bends of 360 degrees between them unless otherwise indicated.
- S. At switchboards, manholes and floor standing distribution panelboards, provide insulated throat bushings or bell ends on all non-metallic conduit entries and bushings on all metallic conduit entries.
- T. Provide bushings on all conduit terminations sized 1" and larger.
- U. Provide weatherproof boxes and connectors for all exposed parking structure raceways and boxes.
- V. Provide bell ends on all conduits into pullboxes and manholes, seal all conduits after conductors are pulled.
- W. Cap all unused conduits with end cap. Do not tape.

END OF SECTION

SECTION 26 0120

CONDUCTORS

PART 1 - GENERAL

1.01 WORK INCLUDED

- A. Conductors; for power, lighting, sound, communication and control, including conductors for general wiring, flexible cords and cables, and ground conductors.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Submittals: Section 260000.

PART 2 - PRODUCTS

2.01 MATERIAL AND FABRICATION

- A. Conductors for General Wiring: Thermoplastic insulated rated for 600V manufactured in accordance with UL 83.
 - 1. Provide 3/4 hard drawn copper conductors. Provide solid conductor for #14 AWG and smaller. Provide stranded conductors for #12 AWG and larger.
- B. Conductor Connectors for General Wiring:
 - 1. Sizes No. 14 to No. 8: Splice with insulated spring wire connectors.
 - a. Ideal No. 451, 455 and 453.
 - b. Minnesota Mining: Types Y, R, G, and B.
 - c. Buchanan No. B1, B2 and B4.
 - 2. Size No. 6 or Larger, Copper: Splice and terminate with compression or pressure type connectors and terminal lugs.
- C. Provide connector sealing packs for all area lighting and exterior box splices which require complete protection from dampness and water.
 - 1. Scotchlok No.'s 3576, 3577 and 3578, by 3M Company.

PART 3 - EXECUTION

3.01 USE

MOORPARK COLLEGE EATM LION ENCLOSURE
VENTURA COUNTY COMMUNITY COLLEGE DISTRICT

CONDUCTORS
26 0120-1

- A. Conductors for General Wiring:
1. Minimum 90 degrees C temperature rated insulation on conductors, except use minimum 90 degrees C temperature rated insulation on conductors in conduits exposed on roof, or where required due to ambient temperature.
 2. Stranded conductors at motors, audio video and other applications where subject to vibration.
 3. Minimum size conductors for power and lighting #12 AWG, except where noted.
 4. Minimum size conductors for control circuits #14 AWG stranded with THHN/THWN insulation.
- B. Use flexible cords and cables for connection of special equipment as indicated. Length not to exceed 72 inches.
- C. Ground Conductors:
1. Provide an insulated green ground conductor for all branch circuit wiring where indicated.
 2. Bare copper conductor may be used.
 - a. Install ground conductors in all non-metallic conduits as required by code. Install ground conductors in all motor branch circuits and all feeders. Where ground conductor size is not indicated, provide size as required for an equipment ground conductor by the National Electrical Code.
 - b. Install ground conductors in all flexible metal conduits.
- D. Install XHHW – 2, 90°C copper conductors for all underground installations unless noted otherwise on the plans.
- E. Install for all dimmers, stranded THHN/THWN – 2 copper 90°C conductors with dedicated neutrals.

3.02 INSPECTION

- A. Check conduit system for damage and loose connections, replace damaged sections.
- B. Check for caps at conduit openings. Make sure that inside of conduit is free of dirt and moisture.
- C. Pull mandrel, one size smaller than the conduit, through entire length of all underground conduits prior to conductor installation.

3.03 INSTALLATION

A. Conductors for General Wiring:

1. Color code conductors insulation as follows:

CONDUCTOR	SYSTEM 208Y/120	VOLTAGE 480Y/277
Phase A	Black	Brown
Phase B	Red	Orange
Phase C	Blue	Yellow

2. For conductors #6 AWG or larger, permanent plastic colored tape may be used to mark conductor in lieu of coded insulation. Tape shall cover not less than 2 inches of conductor insulation within enclosure.
 - a. Provide color tape on each end and at all terminal points and splices on wire enclosed in conduit.
 - b. Provide color tape every 3 feet on wire not enclosed in a listed wireway.
3. When pulling conductors, do not exceed manufacturer's recommended values.
4. Use polypropylene or nylon ropes for pulling conductors.

B. Insulate splices with plastic electrical tape: Scotch No. 33+, Tomic No. 1T, or equal.

C. Terminate all control wires with terminal lugs on terminal boards not designed with pressure plates. If splices are needed, use same procedure, installing a terminal board in a junction box for protection.

D. All splices or connections shall be compression type Thomas & Betts or Burndy, no split bolt connections are allowed.

3.04 IDENTIFICATION

A. Feeders: Identify with the corresponding circuit designation at over-current device and load ends, at all splices and in pull boxes.

B. Branch Circuits: Identify with the corresponding circuit designation at the over-current device and at all splices and devices.

C. Control Wires: Identify with the indicated number and/or letter designation at all terminal points and connections.

D. Alarm and Detection Wires: Identify with the indicated wire and zone numbers at all connections, terminal points, and coiled conductors within cabinets.

E. Conductors Terminated By Others: Indicate location of opposite end of conductor, i.e., Pull Box-Room 101.

- F. For identification of conductors, use heat shrinkable white marking sleeves such as Brady Permasleeve with type written identification.
- G. Circuit designation is construed to mean panel designation and circuit number, i.e., LA-13.

END OF SECTION

SECTION 26 0130
ELECTRICAL BOXES

PART 1 - GENERAL

1.01 WORK INCLUDED

- A. Boxes; including:
1. Outlet boxes.
 2. Pull and junction boxes.
 3. Cabinets.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Submittals: Section 260000.

PART 2 - PRODUCTS

2.01 MATERIAL AND FABRICATION

- A. Outlet Boxes:
1. Pressed Steel Boxes: Knockout type, hot-dipped or electro-plate galvanized.
 2. Cast Iron Boxes: Hot-dipped or electro-plate galvanized with threaded hubs.
 3. Cast Iron Conduit Bodies: Hot-dipped or electro-plate galvanized with threaded hubs.
 4. Cast copper free aluminum conduit bodies with threaded hubs.
 5. Covers for Pressed Steel Boxes: Hot dipped or electro-plate galvanized.
 6. Outlet boxes manufactured in accordance with UL 514.
- B. Pull and Junction Boxes:
1. Sheet steel, hot-dipped or electro-plate galvanized, or prime coated and a final coat of manufacturer's standard enamel or lacquer finish. Manufactured in accordance with UL 50.

- a. Where exposed to weather, provide raintight hubs for conduits entering the boxes, top and sides only.
- 2. Floor Boxes:
 - a. Single gang, similar to Hubbell #B-2536.
 - b. Covers:
 - 1) Combination, similar to Hubbell #S-2525.
 - 2) Duplex receptacle, similar to Hubbell #S-3925.
 - c. Carpet flange, similar to Hubbell #S-3075 thru #S-3079.
 - d. Hubs: Provide hubs as required to suit the conduit arrangement.
- 3. Pre-Cast Concrete Pull Boxes: As manufactured by Jensen Pre-Cast or Utility Vault and shown on drawings.
- 4. High impact resistant PVC boxes: As manufactured by Carlon, Sedco, or R & G Sloan.
- C. Cabinets: Sheet metal, prime coat and final coat of manufacturer's standard enamel or lacquer finish. Manufactured in accordance with UL 50.
 - 1. Control Cabinet: NEMA 1 enclosure, door with butt hinges and flush handle latches.
 - a. Provide with removable steel back panel.
 - 2. Terminal Cabinets: NEMA 1 enclosure, door with concealed hinges and spring catch type flush cylinder locks. Key locks alike, provide two keys with each lock.
 - 3. Provide engraved plastic nameplates with 1/2" minimum height letters indicating designation of control and terminal cabinets as shown on the drawings.
 - 4. Secure nameplates with at least two screws or rivets. Cementing and adhesive installation not acceptable.

PART 3 - EXECUTION

3.01 USE

A. Outlet Boxes:

- 1. Ceiling Outlet Boxes: Not less than 4" octagonal by 2" deep.

2. FDD cast iron or cast aluminum device boxes and conduit bodies with metal covers for exposed conduit installation. Provide gasket for covers in wet areas.
3. Intercom, Microphone and TV Outlet Boxes: Not less than 4-11/16" square x 2-1/8" deep.
4. Provide floor boxes with quantity of gangs as required for power, communication or control as indicated. Use boxes with barriers where required. Provide carpet flanges in carpeted areas.

B. Pull and Junction Boxes:

1. Use sheet steel boxes NEMA Type 1 for indoor and NEMA Type 3R for outdoor installation, except as follows.
2. Use pre-cast concrete boxes for boxes flush in finish grade where requiring a nominal capacity greater than 144 cubic inches, where located in vehicular traffic areas, or where indicated.
3. Use polyvinyl chloride (PVC) boxes flush in finish grade when the nominal internal volume is less than or equal to 144 cubic inches or where indicated.
4. Use cast iron boxes for boxes flush in slab on grade.

3.02 INSTALLATION

- A. Provide 3/8" fixture studs in wall bracket and ceiling boxes.
- B. Provide covers suitable for the fixtures or devices used.
- C. Make outlet box covers flush with finished surfaces.
- D. Close unused open knockouts with knockout seals.
- E. Provide 1" deep plaster rings on recessed outlet boxes installed in areas where concrete will be exposed after construction is complete.
- F. Where boxes are concealed in exposed concrete unit masonry, use square cornered types or boxes fitted with rings of sufficient depth for the box to be recessed completely within cavity of block or tile. Install box to insure that ring fits an opening sawed out of the masonry, so that no mortar is required to fill between ring and construction.
- G. Provide a 6" base of compacted crushed rock under pre-cast concrete pull boxes.
- H. Adjust floor boxes so they are level with top of finished floors.

- I. Provide pull boxes and junction boxes in all branch circuit and feeder runs as indicated. Do not provide pull boxes unless they are indicated or required by the Electrical Code.

3.03 IDENTIFICATION

- A. Junction Boxes: Use permanent black marker, 2" high lettering, and on each cover plate indicate the power source and circuits contained within that junction box.

END OF SECTION

SECTION 26 0140

WIRING DEVICES

PART 1 - GENERAL

1.01 SECTION INCLUDES:

- A. Wiring devices.

1.02 Related Work Specified Elsewhere

- A. Electrical and Junction Boxes: Section 260130.

1.03 Submittals

- A. In accord with Section 260000.

1.04 Definition

- A. Wiring devices: This term includes all wall switches, pushbuttons, receptacles, and plates used for general purpose installation.

PART 2 - PRODUCTS

2.01 Material and Fabrication

- A. Wall switches:

1. Quiet toggle type, 20A – 120/277 VAC rated, with terminal screws to take up to No. 10 AWG conductors:

	SPST	DPST	3-WAY	SPST KEY SWITCH LOCK	4-WAY
Arrow-Hart	1991-I	1992-I	1993-I	1991-L	1994-I
Bryant	4901-I	4902-I	4903-I	4901-L	4904-I
General Electric	GE5951-2	GE5952-2	GE5953-2	GE5951-OL	GE5954-2
Hubbell	1221-I	1222-I	1223-I	1221-L	1224-I
Pass & Seymour/ Legrand	20AC1-I	20AC2-I	20AC3-I	20AC1-L	20AC4-I

2. Momentary contact type, 20A-120/277V, two-circuit, three-position, center off:

Arrow-Hart	1995-I
Bryant	4921-I
General Electric	GE5935-2

Hubbell	1557-I
Pass & Seymour/Legrand	1250-I

3. Passive infrared wall switch sensors: Ivory, 180° field of view, adjustable time out and ambient light, 1200 sq. ft. Coverage, 120 VAC, 60 Hz, 1500W. Maximum load, incandescent and fluorescent. As manufactured by Hubbell No. AT1201 or Owner- approved equivalent by Leviton or Pass & Seymour.
4. Fan speed controllers: AC unit rated 15A - 120V used to control up to twelve 56 in./52 in./48 in. ceiling fans or up to twenty 42 in. fans on a single circuit. Rinaudo's Reproductions No. 22394.

B. Passive infrared motion switching system:

1. Ceiling mount sensor, white, 500 sq. ft. coverage, requires control unit. Hubbell No. ATD500CRP.
2. Ceiling mount sensor, white, 2000 sq. ft. coverage, ceiling height dependent, requires control unit. Hubbell No. ATD2000CRP.
3. Ceiling or wall mount sensor, white, 1000 sq. ft. coverage, requires control unit. Hubbell No. ATD1000CRP.
4. Ceiling or wall mount hallway sensor, white, covers area 75 ft. long by 20 ft. wide, requires control unit. Hubbell No. PIR90HW1.
5. Low-voltage control unit, 120VAC, controls one to four sensors. Mount in 4 in. x 4in. enclosure. Hubbell No. CU120A.
6. Relay, 120VAC coil, used when load to be controlled exceeds capacity of a single circuit. Hubbell No. AAR

C. Receptacles, caps, and connectors:

1. 15A-125V, NEMA 5-15, parallel slot type with grounding pin:

	DUPLEX	SINGLE	GFI
Arrow-Hart	5252-I	5261-I	GF5242-I
Bryant	5252-I	5261-I	GFR52FT
General Electric	5252-2	5261-2	TGTR115F
Hubbell	5252-I	5251-I	GF5252-I
Pass & Seymour/Legrand	5252-I	5261-I	1591-SHG

2. 15A-250V, NEMA 6-15, straight blade grounding type:

	RECEPTACLE	CAP
Arrow-Hart	5661-I	6666
Bryant	5661-I	5666-N
General Electric	GE4069-2	GED0611
Hubbell	5661-I	5666-C
Pass & Seymour/Legrand	5662-I	5666-X

3. 15A-125V, NEMA L5-15, locking type with ground:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	4700	4721	4731
Bryant	4700	4721-NSY	4732-NSY
General Electric	GL4700	GLD0511	GLD0513
Hubbell	4700	4720-C	4729-C
Pass & Seymour/Legrand	4700	L515-P	L515-C

4. 20A-125V, NEMA 5-20, straight blade grounding type:

	RECEPTACLE	CAP
Arrow-Hart	5361-I	5362-I
Bryant	5361-I	5362-I
General Electric	GE4102-2	GE4108-2
Hubbell	5361-I	5362-I
Pass & Seymour/Legrand	5361-I	5362-I

5. 20A-125V, NEMA L5-20, two-pole, three-wire locking type, with ground:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	6200	6202	6204
Bryant	70520-FR	70520-NP	70520-NC
General Electric	GL0520	GLD0521	GLD0523
Hubbell	2310-A	2311	2313
Pass & Seymour/Legrand	L520-R	L520-P	L520-C

6. 20A-125V, NEMA 5-20, two-pole, three-wire, straight blade isolated grounding type receptacle:

	DUPLEX	SINGLE
Arrow-Hart	IG5362	IG5361
Bryant	5362-IG	5361-IG
General Electric	GE8300-IG	GE8310-IG
Hubbell	IG-5362	IG-5361
Pass & Seymour/Legrand	IG-6300	IG-5361

7. 20A-125 VAC, two-pole, three-wire, NEMA 5-20, straight blade, specification grade, ivory color, ground fault circuit interrupter receptacle (GFCI), rated for feed-through wiring, with LED indicator light:

	GFCI RECEPTACLE
Hubbell	GF-5362I
Pass & Seymour	2091-S-L-I
Leviton	6898-I

8. 20A-125/250V, NEMA 14-20, three-pole, four-wire straight blade grounding type:

	RECEPTACLE	CAP
Arrow-Hart	5759	5757
Bryant	-	-
General Electric	GE1420	GED1421
Hubbell	8410	8411-C
Pass & Seymour/Legrand	L1420-R	L1420-P

9. 20A-250V, NEMA 6-20, two-pole, three-wire straight blade grounding type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	8510	6866	6869
Bryant	5461	5466N	5469N
General Electric	GE4182	GED0621	GED0623
Hubbell	5461	HBL5466-C	HBL5469-C
Pass & Seymour/Legrand	5871	5466-X	5469-X

10. 20A-120/208V, NEMA L21-20, four-pole, five-wire locking and grounding type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	6470	6472	6474
Bryant	72120-FR	72120-NP	72120-NC
General Electric	GL2120	GLD2121	GLD2123
Hubbell	2510A	2511	2513
Pass & Seymour/Legrand	L2120R	L2120P	L2120C

11. 20A-250V, NEMA L6-20, two-pole, three-wire locking and grounding type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	6210	6212	6214
Bryant	70620FR	70620NP	70620NC
General Electric	GL0620	GLD0621	GLD0623
Hubbell	2320A	2321	2323
Pass & Seymour/Legrand	L620-R	L620-P	L620-C

12. 20A-480V, NEMA L16-20, three-pole, four-wire locking type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	6430	6432	6434
Bryant	71620-FR	71620-NP	71620-NC
General Electric	GL1620	GLD1621	GLD1623
Hubbell	2430A	2431	2433
Pass & Seymour/Legrand	L1620-R	L1620-P	L1620-C

13. 30A-125V, NEMA 5-30, two-pole, three-wire straight blade grounding type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	5716N	5717N	6716N
Bryant	9530-FR	9630-RP	-
General Electric	GE4138-3	GED0531	GED0533
Hubbell	9308	9309	-
Pass & Seymour/Legrand	3802	5921	-

14. 30A-125V, NEMA L5-30, two-pole, three-wire grounding and locking type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	6330	6332	6334
Bryant	70530-FR	70530-NP	70530-NC
General Electric	GL0530	GLD0531	GLD0533
Hubbell	2610	2611	2613
Pass & Seymour/Legrand	L530-R	L530-P	L530-C

15. 30A-125/250V, NEMA 14-30, three-pole, four-wire straight blade grounding type:

	RECEPTACLE	CAP
Arrow-Hart	5744N	5746N
Bryant	9430-FR	5746
General Electric	GE4191-3	GED1431
Hubbell	9430	9431
Pass & Seymour/Legrand	5740	5741-AN

16. 30A-125/250V, NEMA L14-30, three-pole, four-wire grounding and locking type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	6510	6512	6514
Bryant	71430-FR	71430-NP	71430-NC
General Electric	GL1430	GLD1431	GLD1433
Hubbell	2710-A	2711	2713
Pass & Seymour/Legrand	L1430-R	L1430-P	L1430-C

17. 30A-250V, NEMA L6-30, two-pole, three-wire locking blade grounding type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	6340	6342	6344
Bryant	70630-FR	70630-NP	70630-NC
General Electric	GL0630	GLD0631	GLD0633
Hubbell	2620-A	2621	2623
Pass & Seymour/Legrand	L630-R	L630-P	L630-C

18. 30A-250V, NEMA 6-30, two-pole, three-wire straight blade grounding type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	5700N	5701N	6700N
Bryant	9630-FR	9630-ANP	-
General Electric	GE4139-3	GE4328-9	GE4373-9
Hubbell	9330	9331	-
Pass & Seymour/Legrand	3801	5931	-

19. 50A-208V (50A-600V), three-pole, four-wire locking type with ground:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	3769	3765	3764
Bryant	3769	3765	3764
General Electric	LD3769	LD3765	LD3764
Hubbell	3769	3765-C	3764-C
Pass & Seymour/LeGrand	3769	3765	3764

20. 50A-125/250V, NEMA 15-50, three-pole, four-wire grounding straight blade type:

	RECEPTACLE	CAP
Arrow-Hart	5754N	5745N
Bryant	9450-FR	5745
General Electric	GE4181-3	GE4180-3
Hubbell	9450	9451
Pass & Seymour/LeGrand	5750	5751-AN

21. 50A-125/250V, three-pole, four-wire grounding locking blade type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	CS6369	CS6365	CS6364
Bryant	CS6369	CS6365	CS6364
General Electric	-	-	-
Hubbell	CS6369	CS6365	CS6364
Pass & Seymour/LeGrand	-	-	-

22. 50A-250V, NEMA 6-50, two-pole, three-wire grounding straight blade type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	5709N	5710N	6709N
Bryant	9650-FR	9650-RP	-
General Electric	GE4141-3	GED0651	GED0653
Hubbell	9367	9368	-
Pass & Seymour/LeGrand	3804	3869	-

23. 60A-120/208V, three-phase, 60 Hz, five-pole, five-wire, watertight, with threaded cap:

	BOX	ANGLE ADAPTER	RECEPTACLE BODY	COMPLETE ASSEMBLY
Hubbell	26401	26404	26520	-
Crouse-Hinds	-	-	-	Area-6575
Russell Stoll	-	-	-	DS6516-FRAB-

24. 60A-480V, NEMA L16-20, three-pole, four-wire locking type:

	RECEPTACLE	CAP	CONNECTOR
Arrow-Hart	-	-	-
Bryant	-	-	-
General Electric	-	-	-
Hubbell	HBL 26410	HBL 26402	HBL 26418
Pass & Seymour/LeGrand	-	-	-

- D. Safety receptacle: 15A-125V, NEMA 5-15, straight blade grounding safety receptacle, Hubbell No. SG-62H-1.
- E. Door monitoring switches:
1. General: Provide magnetic door switches (one per leaf) and key switches at specific door locations as indicated on Drawings. Refer to Electrical Drawings details for schematic installation details of door switches.
 2. Magnetic contact switches: Provide concealed magnetic SPDT switches with minimum 6-ft. wire leads, Sentrol No. 1076W-06 for hollow metal doors and frames. Where necessary, provide other similar Sentrol types to suit concealed installation conditions, as approved by Owner and compatible with Owner's ride control and/or existing security system equipment. Color of switches to closely match finish or paint color of door frame.
 3. Key switches: Arrow-Hart No. 1191L.
- F. Device cover plates:
1. Interior plates: Specification grade plastic, 0.1 in. thick, ivory in color, UL listed.
 - a. Plates in kitchens and restrooms to be polished stainless steel, 0.040 in. thick except in kitchens use double lift lid weatherproof gasketed plates for convenience receptacles.
 - b. MATV plate: RMS No. CA-4028.
 2. Exterior plates: Choose type of exterior cover plate in accord with the device location and/or manner in which device will be used. Device cover plates shall be die-cast aluminum with hinged cover, rated for respective type of use specified below, or as indicated on Drawings.
 - a. Outlet box weatherproof hoods: NEMA 3R rating, gasketed, for unattended use with cover closed, padlockable latching cover to meet OSHA lockout/tagout requirements, large cord opening and UL listed. As manufactured by Hubbell, Intermatic or Leviton.
 - b. Low profile weatherproof cover: Gasketed, approved for use with cover open, self-closing hinged covers (two independent self-closing lids for duplex receptacles which are horizontally mounted), UL listed. As manufactured by Hubbell, Leviton or Pass & Seymour.
 - c. Communication outlet weatherproof hoods: NEMA 3R rating for unattended use with cover closed, two-cord openings and UL listed. As manufactured by Red Dot.

PART 3 - EXECUTION

3.01 Installation

- A. Mount switches and receptacles in vertical position in building interiors.
- B. Mount receptacles with weatherproof plates in horizontal position.
- C. Install receptacles mounted vertically so that the ground contact falls on the top position, and horizontally-mounted receptacles with neutral pole in top position.
- D. Use plastic blank plates on J-boxes in public areas.
- E. Use mechanical type door switches for load control.
- F. Install receptacles for plug in lighting fixtures within 36 in. of fixture location.
- G. Use safety type receptacles with low profile weatherproof metal covers for all convenience outlets in guest accessible areas (i.e., queue lines, waiting areas, etc.).
- H. All GFI type exterior receptacles shall be provided with weatherproof metal hoods.
- I. GFI type receptacles shall not be fed-through wire.

END OF SECTION

SECTION 26 0142

NAMEPLATES AND WARNING SIGNS

PART 1 - GENERAL

Not Used.

PART 2 - PRODUCTS

2.01 NAMEPLATES

- A. Nameplate shall be plastic laminate with 3/4" high letters in white on black background screwed onto equipment designations shall clearly state:
1. Equipment Enclosure Nameplates.
 - a. Manufacturer's nameplate including equipment design rating of current, voltage, KVA, HP, bus bracing rating, or as applicable.
 - b. Equipment nameplate designating system usage and purpose, system nominal voltage, equipment rating for KVA, amperes, HP and RPM as applicable. Designation data per drawings or to be supplied with shop drawings approval.
 2. Device nameplates: Device usage, purpose, or circuit number; manufacturer and electrical characteristic ratings including the following:
 - a. Circuit Breakers: Voltage, continuous current, maximum interrupting current and trip current.
 - b. Switches: Voltage, continuous current, horsepower or maximum current switching. If fused, include nameplate stating "Fuses must be replaced with current limiting type of identical characteristics."
 - c. Contactors: Voltage, continuous current, horsepower or interrupting current, and whether "mechanically-held" or "electrically-held".
 - d. Motors: Rated voltage, full load amperes, frequency, phases, speed, horsepower, code letter rating, time rating, type of winding, class and temperature.

- e. Controllers: Voltage, current, horsepower and trip setting of motor running over current protection.

2.02 WARNING SIGNS

- A. Warning signs shall be minimum 18 gauge steel, white porcelain enamel finish with red lettering. Lettering to read "DANGER - HIGH VOLTAGE" in 1" letters. Warning signs to be included on door or immediately above door of all electrical equipment rooms, vaults or closets containing equipment rooms, vaults or closets containing equipment energized above 150 volts to ground, except where such spaces are accessible from public areas.

2.03 WARNING SIGN DESIGNATION

- A. Warning designation in 1" red letters shall be painted by stencil or pre-printed adhesive on each pull box, cabinet or 1-foot length of exposed conduit stating "DANGER" and giving voltage of enclosed conductors such as "DANGER - 480 VOLTS", for all systems over 150 volts to ground.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. Nameplates shall be mounted by self-tapping or threaded screws and bolts or by rivets.
- B. Signs shall be permanently mounted with cadmium plated steel screws or nickel-plated brass bolts.

END OF SECTION

SECTION 26 0164
BRANCH CIRCUIT PANELBOARDS

PART 1 - GENERAL

1.01 WORK INCLUDED

- A. Branch circuit panelboards.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Submittals: Section 260000.
- B. Overcurrent Protective Devices: Section 260180.
- C. Control Devices: Section 264901.

PART 2 - PRODUCTS

2.01 MATERIAL AND FABRICATION

- A. Provide factory assembled, enclosed panelboards in dead front cabinets, with doors, surface mounted or recessed as indicated, not less than 20" wide and 5-3/4" deep. Height will depend on the number of breakers and spaces.
- B. Where a control compartment is indicated, provide an integral compartment with a separate hinged lockable door held with captive screws. Identify all internal control wiring with manufacturers wire numbering or control wire numbering when indicated, at all terminal points and connections.
- C. Provide feeder terminal lugs for both main lugs only and main breakers rated for use with copper conductors.
- D. Provide full length copper bussing including areas indicated as space only.
- E. Provide full size neutral bus where neutral bus is indicated. Provide equipment ground bus and bolt-on circuit breakers.
- F. Key all door locks alike.
- G. 120/208V, 3 Phase, 4 Wire Panelboards: Square-D Co. Type NQOD or Powerlink G3 NF with programmable module where designated, alternate bid for General Electric type AQ.

- H. 277/480V, 3 Phase, 4 Wire Panelboards: Square-D Co. Type NF, alternate bid for General Electric type CCB.
- I. All equipment shall be listed to meet or exceed the available fault current by 10%.
- J. Doors shall be hinged.
- K. All placards are welded steel type.
- L. Provide hinged deadfront doors to allow internal access to panel without totally rewiring cover panel.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. Secure panelboards to building structure to withstand wire pulling strains.
- B. Secure surface mounted panelboards to wood studs or channel material spanning metal studs.
- C. Do not use toggle bolts.
- D. Contractor shall program lighting control Powerlink panelboard per owner's requirements.

3.02 LABELING AND IDENTIFICATION

- A. Provide engraved plastic nameplates on all branch circuit panelboards shown on the single line diagram.
- B. Provide panelboard and source feed designation on nameplates with 3/8" minimum height lettering for the panel name and 1/4" height lettering for the source feed designation.

EXAMPLE: LA

FED FROM: DLA

- C. Secure nameplates with at least two screws or rivets. Cementing and adhesive installation not acceptable.
- D. Provide a typewritten directory for each branch circuit panelboard, showing each circuits and its use. Provide metal directory frame with plastic window.

END OF SECTION

SECTION 26 0170

DISCONNECTS

PART 1 - GENERAL

1.01 WORK INCLUDED

- A. Disconnects: Switches, fused or unfused.

1.02 RELATED WORK SPECIFIED ELSEWHERE

- A. Submittals: Section 260010.
- B. Fuses: Section 260180.

PART 2 - PRODUCTS

2.01 ACCEPTABLE MANUFACTURERS

- A. Square D Company
- B. General Electric

2.02 MATERIAL AND FABRICATION

- A. Provide heavy duty type, quick-make, quick-break disconnects with cover interlocks.
- B. Provide NEMA Type 1 enclosure for dry locations, provide the proper enclosure for other locations as indicated.
- C. Provide motor rated toggle switches where indicated.
- D. Provide fused disconnect for elevator drive motors.
- E. Provide rejection clips on disconnects where rejection type fuses are to be installed.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. Securely fasten disconnects to structure to withstand wire pulling strains.

3.02 LABELING AND IDENTIFICATION

- A. Provide engraved plastic nameplates on individually mounted disconnects with minimum 1/4" height letters indicating the load served and the source feed designation.

EXAMPLE: LOAD: A/C-1

FROM: DHA-1

- B. Secure nameplates with at least two screws or rivets. Cementing and adhesive installation not acceptable.

END OF SECTION

SECTION 26 0190
SUPPORT DEVICES

PART 1 - GENERAL

1.01 WORK INCLUDED

- A. Support devices for conduit, boxes, lighting fixtures and equipment.

PART 2 - PRODUCTS

2.01 ACCEPTABLE MANUFACTURERS

- A. Hangers, Straps and Beam Clamps:
 - 1. Efcor.
 - 2. Raco, Inc.
 - 3. Steel City.
 - 4. O.Z./Gedney Co.
 - 5. Caddy Fastening System by ERICO Products Inc.
- B. Channels and Fittings:
 - 1. Kindorf.
 - 2. Unistrut Corp.
- C. Anchors:
 - 1. Acherman-Johnson Corp.
 - 2. Phillips Drill Co.
 - 3. Rawl Products Co.

2.02 MATERIAL AND FABRICATION

- A. Hangers: Steel cadmium plated.

- B. Straps: One-hole and two-hole malleable iron, hot-dipped galvanized or steel, cadmium or zinc plated.
- C. Beam Clamps: Malleable iron, hot-dipped galvanized or cadmium plated.
- D. Channels and Fittings:
 - 1. Channels: Hot-dipped galvanized.
 - 2. Fittings: Galvanized.
- E. Anchors: Self drilling and expansion bolt types. No wood or fiber plugs or concrete nails are acceptable.

PART 3 - EXECUTION

3.01 USE

- A. Use one-hole or two-hole straps for single conduit runs on walls or ceilings.
- B. Use hangers with solid steel rods for hanging single conduits.
- C. Use formed channel trapezes for groups of two or more conduits.
- D. To fasten boxes and supports to:
 - 1. Wood: Use wood screws or screw type nails of equal holding power.
 - 2. Brick and Concrete: Use bolts and expansion shields.
 - 3. Hollow Masonry Units: Use toggle bolts.
- E. Support sheet metal boxes from building structure directly or by bar hangers.
- F. Do not penetrate reinforced concrete beams with fastenings more than 1-1/2" or reinforced concrete joints with more than 3/4" fastenings to prevent contact with reinforcing steel.

END OF SECTION

SECTION 26 2450

GROUNDING

PART 1 - GENERAL

1.01 REFERENCES

- A. N.E.C.: Article 250 "Grounding".
- B. Underwriter's Laboratories (U.L.). Standard A67 - "Grounding and Bonding Equipment". STD 869 - Grounding and Bonding.
- C. ITEE - Standards 142 and 241.

1.02 DESCRIPTION OF SYSTEM:

- A. A permanent grounding system with methods and materials in accordance with applicable Codes and Standards, able to conduct ground fault currents to the grounded neutral of electrical distribution systems, and limit potential differences between grounding conductors, raceways and enclosures.

1.03 SUBMITTALS

- A. Product Data: Submit manufacturer's data on grounding systems and accessories.
- B. Shop Drawings: Submit layout drawings of grounding systems and accessories including, but not limited to, ground wiring, copper braid and bus, ground rods, and plate electrodes.

1.04 QUALITY ASSURANCE:

- A. Installer qualifies with at least 3 years of successful installation experience on projects with electrical grounding experience similar to that required for project.

1.05 DELIVERY, STORAGE, AND HANDLING:

- A. Handle electrical grounding accessories and components carefully to avoid damage. Store in location that will protect from dirt and weather.

PART 2 - PRODUCTS

2.01 GROUND RODS:

- A. Copper clad steel, unless indicated otherwise. Minimum dimension of 5/8" diameter by 8' long or larger if indicated and sectional rods with couplings where lengths exceeding 12' are specified or indicated, or where added driving depth is required to achieve a specified minimum resistance.

2.02 GROUNDING ELECTRODE:

- A. Bare stranded copper, 3/0 AWG unless indicated otherwise, for installation in soil or embedded in concrete and cable with type TW insulation when installed in raceway. Install without splice from connection to connection.

2.03 GROUNDING CONDUCTORS:

- A. Type TW insulation, unless specified or indicated otherwise with a continuous green outer insulating jacket for size #6 AWG and smaller and with green tape banding for #4 AWG and larger, marked at each access point (e.g.: Junction boxes, Enclosures).

2.04 CLAMPS AND PRESSURE CONNECTORS:

- A. Cast copper, copper alloy, or bronze alloy suitable for use with aluminum and copper. Double bolt type with formed shoe and "U" cable clamp for connection to pipe or conduit; Single bolt type with cable shoe and "U" clamp for connections to flat bar or metal; and double bolt, parallel conductor split clamp type for cable to cable connections.

2.05 WELDED CONNECTIONS:

- A. Exothermic process (Cadweld or Thermoweld).

2.06 EQUIPMENT ROOM GROUND TERMINAL BAR:

- A. Copper 1/4" X 2-1/2" X 24", unless otherwise indicated. Two rows of holes on 1-1/2" centers for 1/2" bolt, to receive cables from two directions.

PART 3 - EXECUTION

3.01 GENERAL:

- A. Ground conductive raceways, cable trays and enclosures for electrical systems wiring. Make ground circuits complete to form permanent conductive paths. Solidly ground each low voltage electrical system unless indicated or specified as ungrounded, or grounded through an impedance of a specified value. Provide bare conductors when in open air or soil and provide 600 volt, green, insulated conductors when in raceway.

3.02 MAIN GROUNDING JUMPER:

- A. Install a main grounding jumper between the system neutral and the enclosure ground bus (or directly to enclosure where ground bus is not present) at each location where system grounding is required. Main grounding jumper:
 - 1. Formed bus in switchboards and panelboards.
 - 2. Formed bus or copper cable in transformers not coupled in unitized assembly with distribution equipment.

3.03 GROUND CONNECTIONS:

- A. Make grounding electrode connections electrically ahead of any overcurrent or disconnect device or tap connection such that disconnection of neutral load conductors does not interfere with or remove the system ground connection. Use separate lugs on the transformer neutral terminals for neutral and main grounding jumpers when cable is used for transformer connections.

3.04 SEPARATELY DERIVED SYSTEMS:

- A. For each separately derived system, grounded or ungrounded, install a grounding electrode conductor between each system enclosure ground bus (or bolted connection to enclosure where ground bus is not present) and a cold water pipe or building structural steel of one (1) inch size or larger near the separately derived system ground connection. Make connections to water pipes or steel accessible for easy inspection. Provide a separate ground conductor for each audio, video, isolated panels and UPS as noted on the plans.

3.05 SERVICE GROUND:

- A. For each low voltage service, install a grounding electrode conductor between the system enclosure ground bus and the water service entrance to the building and install bonding jumpers around insulating unions and removable fittings in the water pipe between the grounding electrode conductor connection to the water pipe and the water service entrance.

3.06 GROUNDING ELECTRODE SYSTEM:

- A. Install a complete grounding electrode system with interconnecting cables and terminations at the equipment room ground terminal bar. Make connections to the grounding electrode system accessible. Install the following grounding electrode systems:
 - 1. Metal frame of building.
 - 2. Grounding electrode encased by at least two inches of concrete, within and near the bottom of the building foundation or footing of the type specified in Part 2 - Products, at least 20 feet in length without splice from connection to connection.

3. Connection of other metal piping systems as required by National Electrical Code Article 250.
4. Driven ground rods.
5. Driven steel piles.
6. Connection to water service with bonding jumper around water meter.

3.07 GROUNDING ELECTRODE CONDUCTORS:

- A. Install grounding electrode conductor in PVC or other non-conductive, non-metallic enclosure where a raceway system is indicated or necessary for conductor installation. Install grounding electrode conductors without splice from the enclosure ground bus to the connection at the grounding electrode system.

3.08 GROUND RODS:

- A. Install a vertical position, full length below grade unless specified otherwise, and with conductor and top of rod 6" minimum below grade. Provide exothermic welds at all connections.

3.09 EQUIPMENT ROOM GROUND TERMINAL BAR:

- A. Install in equipment rooms where indicated. Mount bar by anchors and bolts using 1-1/2" long segments of 1/2" rigid conduit as spacer between bar and wall. Use a minimum of two supports, 18" on center. Connect grounding electrode system conductors, system enclosure ground bus, and other indicated electrode systems to the terminal bar. Label permanently all ground conductors as to destination location, e.g. TR1, panel IPS, etcetera.

3.10 EQUIPMENT GROUND:

- A. Form the equipment ground circuits with rigid metallic raceways (e.g., EMT, rigid steel conduit) unless indicated otherwise. Make all threaded coupling connections wrench tight. Install bonding jumpers for continuity around fittings and terminations where the conductive raceway is made non-continuous. Where indicated or specified, install ground conductors in raceways to augment the circuits formed by the metallic raceway system. Bond the conductors to boxes or enclosures in which access is possible. Size conductors as specified, indicated, or required by code, whichever is larger. Install grounding bushings and bonding jumpers to enclosures or ground bussing for the following: Service entrance feeder; each location where multiple ring knockouts are damaged during conduit installation; each location where conduits are stubbed up into floor mounted and each conduit termination at a painted enclosure where paint is not removed before installation of raceway.

3.11 FLEXIBLE RACEWAY GROUNDING:

- A. Install a ground conductor inside all flexible raceways (e.g., Flexible steel, liquid tight) regardless of length. Bond the conductor to the enclosure or ground bus in the nearest box or access on either side of the flexible section. Size conductor as specified, indicated, or required by code, whichever is larger.

3.12 NON-CONDUCTIVE RACEWAY:

- A. Install a ground conductor in raceways of non-conductive materials. Bond conductor to conductive enclosures in which access is possible. Bond non-current carrying conductive equipment contained in a non-conductive enclosure. Install insulated or bare conductors, sized as specified, indicated, or required by code, whichever is larger.

3.13 SECTIONAL RACEWAY:

- A. Install a ground conductor in sectional raceways with removable covers for access (e.g., Plug-in strips, surface raceway systems, and wireways) unless specified otherwise. Size conductor in accordance with the N.E.C. for the largest phase conductor size installed in raceway, or as indicated. Bond sections of the raceway to the ground conductor. Connect receptacle ground terminals in the raceway to the ground conductor, and make other ground connections indicated on the drawings.

3.14 CABLE SUPPORT SYSTEMS:

- A. Ground elements of the cable support system to panelboards, cabinets and switchboards from which their circuits originate. Install a ground conductor sized as required by code, as indicated, or #12 AWG, whichever is larger.

3.15 MULTI-CONDUCTOR CABLE, METALLIC SHEATH:

- A. Use multi-conductor cable with metallic sheath or armor approved for use as ground circuit conductor or install ground conductor(s). Size ground circuit conductor as required by code, as specified, or as indicated on the drawings, whichever is larger. Terminating devices for cable using the sheath or armor as the ground circuit conductor shall be approved for use as the connecting device between the cable and the enclosure. Terminate internal ground circuit conductors by lug to the interior of the enclosure or to the contained ground bus where present. Use bare or clearly identified internal grounding conductors.

3.16 MULTI-CONDUCTOR CABLE, NON-METALLIC SHEATHED:

- A. Use only non-metallic sheathed multi-conductor cables having a ground circuit conductor enclosed in the sheath the same size as the ungrounded conductors. Use bare or clearly

identified internal grounding conductors. Terminate ground circuit conductor by lug to the enclosure ground bus where present or to the interior of the enclosure.

3.17 GROUND CONDUCTOR BONDING:

- A. Bond grounding conductors to boxes or enclosures at each access point. Do not use building steel as equipment grounding path. Use welded ground connections, at least where such are buried in soil, installed below slabs on grade, or embedded in concrete.

END OF SECTION

SECTION 26 2510
LIGHTING FIXTURES

PART 1 - GENERAL

1.01 SUMMARY

- A. Section includes:
 - 1. Lighting fixtures, including lamps, accessories and support materials.
- B. Related work:
 - 1. Submittals: Section 260000.
 - 2. Outlet and Junction Boxes: Section 260130.

PART 2 - PRODUCTS

2.01 MATERIAL AND FABRICATION

- A. Fixtures schedule lists one or more acceptable manufacturers for each fixture type.
- B. Provide all lighting fixtures of each type from the same manufacturer.
- C. Provide sockets for screw base lamps of plated steel, brass or bronze.
- D. Lamps Acceptable Manufacturers:
 - 1. General Electric.
 - 2. Phillips.
 - 3. Sylvania.
 - 4. As indicated for specialty lamps.
- E. Flexible metal conduit systems connecting individual tandem wired lighting fixtures.
 - 1. Conductors carrying line voltage and current shall be sized in accordance with the overcurrent device protecting the circuit indicated.
 - 2. Provide a #12 AWG minimum size ground conductor.
- F. Provide solid state drivers for all LED fixtures.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. Provide a lighting fixture for each lighting outlet indicated.
- B. Provide recessed and semi recessed fixtures with mounting frames compatible with the ceiling and wall systems employed and secure fixture mechanically to frame.
- C. Align rows of suspended and surface mounted fluorescent fixtures to form straight lines at uniform elevations.
- D. Provide swivel ball type hangers which will allow a minimum of 45 degrees angle for fixtures indicated as pendant mounted.
- E. Make recessed fixture fit snugly against ceiling to prevent light leakage.
- F. Support suspended and surface mounted LED fixtures as follows:
 - 1. Fixtures not over 12 inches wide and not over 50 inches long, a minimum of two fastenings.
 - 2. Fixtures not over 12 inches wide and over 50 inches long, a minimum of three fastenings.
 - 3. Fixtures over 12 inches wide and not over 50 inches long, a minimum of four fastenings.
- G. Support pendant mounted LED fixtures as follows:
 - 1. Single fixtures not over 12 inches wide, a minimum of two single pendants.
 - 2. Single fixtures over 12 inches wide, a minimum of two single pendants at each end or one double pendant at each end.
 - 3. Continuous rows of fixtures not over 12 inches wide, a minimum of one single pendant for each fixture plus one for each row.
 - 4. Continuous rows of fixtures over 12 inches wide, a minimum of two single pendants or one double pendant for each fixture plus one for each row.
 - 5. Locate pendants for continuous row fixtures at each joint and each end of row.
 - 6. Rigidly fasten continuous row fixtures together with fixtures manufacturer supplied joiner.
- H. Provide each lighting fixture with the lamps indicated on the fixture schedule.

1. Provide self extinguishing lamps in open bottom or unshielded metal halide fixtures.
 - I. Clean and relamp existing fixtures to be reused.
 - J. EMT shall not be used to support suspended fixtures of any type. Suspension shall be by means of standard hangers, where available and applicable, by rigid threaded conduit and fittings, or by rods.
 - K. Where fixtures are to be mounted on, or suspended from concrete ceiling, provide cast in place inserts.
 - L. Fixtures shall not be supported by outlet box cover screws alone; provide a fixture stud or "hickey" for added support.
 - M. Provide a junction box at each exit light fixture indicated.
 - N. Provide weatherproof boxes and connectors and liquid tight flexible conduit to each light fixture.
 - O. All suspended fixtures will be installed with 1/8-inch safety cable and four Crosby clamps (two top and two bottom) to be used as a fixture support backup.

END OF SECTION

SECTION 31 1000

SITE CLEARING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Removal of vegetation, grass, grass roots, shrubs, tree stumps, trees, upturned stumps, weed growth, tree roots, brush, masonry, concrete, rubbish, debris and other materials.
2. Removal of concrete and bituminous surfaces.
3. Removal of existing fences and gates.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 31 2200 - Grading.
3. Section 31 2313 - Excavation and Fill.
7. Section 31 2326 - Base Course.
8. Section 32 3113 - Chain Link Fences and Gates.

1.02 SUBMITTALS

- A. Shop Drawings: Submit site plan indicating extent of site clearing.

1.03 QUALITY ASSURANCE

- A. Comply with Standard Specifications for Public Works Construction, current edition, as a minimum requirement.

PART 2 - PRODUCTS - NOT USED

PART 3 - EXECUTION

3.01 TREE ROOTS REMOVAL

- A. Where required for construction of improvements, remove bulk of roots, to a minimum depth of 24 feet below bottom and 12 inches of any structures or slabs.

- B. Fill and compact excavation from tree root removal. Fill in 6 inch layers, each compacted to 90 percent of maximum density in accordance with ASTM D1557.
 - 1. Back filling shall not commence until the excavation is inspected and tested.

3.02 CONCRETE AND BITUMINOUS SURFACING REMOVAL

- A. Break up and completely remove existing concrete surfacing, curbs, gutters, walks and bituminous surfacing to indicated limits. Cutting shall be performed to a neat and even line with proper tools or a concrete cutting saw. Minimum depth of cut shall be 1 1/2-inch, unless otherwise indicated. Remove concrete broken beyond the indicated limits to the nearest joint or score line and replace with new concrete to match existing.

3.03 FENCING

- A. Existing fences scheduled to remain may be removed to facilitate the Work, provided they are installed to their original condition in accordance with requirements of Section 32 3113 - Chain Link Fences and Gates.
- B. Fencing indicated to be removed and not reinstalled shall be completely removed, including footings. Fill and compact excavations.
- C. Install chain link fencing indicated to be relocated or reset in accordance with applicable requirements specified under Section 32 3113 - Chain Link Fences and Gates.

3.04 CLEANUP

- A. Remove rubbish, debris and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 31 2200

GRADING

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. General exterior grading, cutting and filling, including grading for building area, paving, planting areas, banks and hillsides.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 31 1000 - Site Clearing.
3. Section 31 2313 - Excavation and Fill.
7. Section 31 2326 - Base Course.

1.02 PROJECT REQUIREMENTS

A. General:

1. Fees: Pay as required by authorities having jurisdiction over the area.
2. Bonds: Post as required by authorities having jurisdiction over the area.
3. Haul Routes and Restrictions: Comply with requirements of authorities having jurisdiction over the area.
4. Before grading, contact Underground Service Alert of Southern California (USASC) for information on public buried utilities and pipelines. Retain the services of an underground utility locator for on-site utilities.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Materials shall conform to requirements specified in this and related sections.

PART 3 - EXECUTION

3.01 PREPARATION

- A. Protect and maintain installed survey stakes until their removal is required for the Work. Provide replacement grade or location stakes lost or disturbed.
- B. Install grade stakes and compare to indicated grades. If discrepancies are found between existing grades and grades indicated on Drawings, do not proceed until discrepancies are resolved.

3.02 ROUGH AND FINE GRADING

- A. Rough grade area sufficiently high to require cutting by fine grading:
 - 1. Grade area for bituminous surfacing and other paving to the indicated grades, equal to the section of the indicated base and pavement.
 - 2. Slope banks to required finish grades as cut progresses or leave cuts full and finish grade by mechanical equipment to provide grades and soil densities indicated on the Drawings.
 - 3. Rough grade, fill and compact banks beyond indicated finish grades. Finish grade banks and slopes to indicated grades and specified soil densities.
 - 4. Grade Only Areas: In areas not indicated to receive pavement, rough grade to approximate finish grades and then scarify, moisten and roll to obtain required density and indicated finish grades.
 - 5. Tolerances: Finish grades shall be within a tolerance of 0.05 inch per foot above or below grades indicated. Provide an average grade as indicated.
- B. Base or Subgrade:
 - 1. After subgrade has been constructed to approximate required grades, scarify to a depth of at least 6 inches:
 - a. After scarifying, process loosened material to a finely divided condition and adjust moisture content to optimum condition by addition of water, addition and blending of dry suitable material, or by drying of existing material.
 - b. Subgrade material shall be compacted by tamping, sheepfoot rollers or pneumatic tire rollers. Required relative compaction shall be **90** percent minimum for the top 6 inches below subgrade.
 - c. Install base course in accordance with Section 31 2326 - Base Course.
 - 2. Tolerance of completed grades of base or subgrade shall not vary more than 0.03 inch per foot from grades indicated. Provide an average grade as indicated.

3.03 SHORING

- A. Provide shoring as necessary to properly and safely support earth sides of excavations, and existing curbs, sidewalks, gutter, drives and stairs, against movement and collapse.

- B. Design and Calculations: Provide in accordance with requirement of CalOHSA.
- C. Remove shoring upon completion of the Work of this section or when no longer needed unless required otherwise by authorities having jurisdiction.

3.04 EXCESS MATERIAL DISPOSAL

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

3.05 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

END OF SECTION

SECTION 31 2313

EXCAVATION AND FILL

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Excavating, filling, backfilling, and compacting for Project site pavement, planting areas, buildings, and other structures.
2. Trenches for utility lines such as water, gas, irrigation, storm drain and sewer lines, concrete-encased conduits, manholes, vaults, valve boxes, catch basins, underground tanks, thrust blocks, yard boxes, pull boxes, and other utility appurtenances.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 31 1000 - Site Clearing.
3. Section 31 2200 - Grading.
4. Section 31 2326 - Base Course.
5. Section 32 3113 - Chain Link Fences and Gates.
6. Division 22 - Plumbing.
7. Division 26 - Electrical.

1.02 PROJECT REQUIREMENTS

A. Import and Export of Earth Materials:

1. Fees: Pay as required by authorities having jurisdiction over the area.
2. Bonds: Post as required by authorities having jurisdiction over the area.
3. Haul Routes and Restrictions: Comply with requirements of authorities having jurisdiction over the area.

1.03 SUBMITTALS

- A. Shoring calculations as required in Article 3.03 of this Section.

1.04 QUALITY ASSURANCE

- A. Comply with the Standard Specifications for Public Works Construction, current edition, except as modified herein.
- B. Sampling, testing, and certification of imported and exported soils shall be performed in accordance with Section 01 4524, Environmental Import/Export Materials Testing.

1.05 TESTING

- A. OWNER will retain a Geotechnical Engineer as an OWNER Consultant who will provide observations, tests, inspections and approvals identified in the Contract Documents as being responsibility of OWNER.
- B. Imported Soils: The Geotechnical Engineer will obtain initial product Sample for testing in accordance Article 3.05 of this Section.

1.06 PROJECT CONDITIONS

- A. Information on Drawings or in soil investigation report does not constitute a guarantee of accuracy or uniformity of soil conditions over the Project site.

PART 2 - PRODUCTS

2.01 FILL AND BACKFILL MATERIALS

- A. Fill and backfill material shall be a granular material previously removed from excavation or imported fill material, free of clods and stones larger than 3 inches, (2½ inches for utility trenches) foreign materials, vegetable growths, sod, expansive soils, rubbish and debris. Material shall conform to these specified requirements and related sections.
- B. Fill material exhibiting a wide variation in consistency and moisture content shall be blended and aerated to stabilize and upgrade the material.
- C. Bedding material from trench bottom to one foot above the pipe:
 - 1. Sand, gravel, crushed aggregate or native free-draining granular material providing a sand equivalent of at least 30 or a coefficient of permeability greater than 1.4 inches per hour.
 - 2. Sand complying with the Specifications for cement concrete aggregates.
- D. Any rubble and broken concrete originating from the Project site shall be legally disposed of off the Project site. No such material shall be imported from outside the Project site.
- E. Permeable Backfill (Not Used):
- F. Cement-sand slurry shall be provided with one sack of cement per cubic yard of the mixture.

2.02 BASE MATERIALS

- A. Concrete Slabs on Grade: Provide "Crushed Aggregate Base" as specified in Standard Specifications for Public Works Construction, Section 200 - Rock Materials, with 3/4-inch maximum size aggregates. Provide base thickness as noted on the Drawings, or 3 inches minimum, unless noted otherwise.
- B. Bituminous Surfacing: Provide as indicated on Drawings and specified in Section 31 2326 Base Course.

PART 3 - EXECUTION

3.01 GENERAL

- A. Before initiating intrusive activities, contact Underground Service Alert of Southern California (USA or Dig Alert) to obtain a Dig Alert case ticket for location information on buried public and USA member utilities and pipelines at least 48-hours prior to beginning work. A copy of the Dig Alert ticket shall be forwarded to the OWNER. For on-site utilities, retain a state-licensed third-party underground utility locating service.
- B. Where the Work includes a building extension or addition on an occupied Project site, perform Work in such a manner, and at such times, as not to disrupt performance of existing utility services to existing Project site facilities. Where an interruption is necessary, obtain review from the OWNER before proceeding.
- C. Remove concrete or bituminous pavement to straight lines by saw cutting.

3.02 PROTECTION

- A. Protect and guard excavations against danger to life, limb, and property as required by, but not limited to, OSHA regulations.
- B. Protect existing improvements including landscaping against damage. Repair or replace damaged items.
- C. Protect existing utility services and distribution systems from damage or displacement.
- D. Remove conduits or pipes not in service, exposed during Work, unless a minimum cover of two feet is provided. Remove all concrete, clay or other non-metallic pipe, unless otherwise indicated or approved by the OWNER.
- E. Shore, crib, or lag excavations and earthen banks as necessary to prevent cave in, erosion or gulying of sides.
- F. Provide excavations free from standing water by pumping, draining, or providing protection against water intrusion. If soil becomes soft, soggy, or saturated, excavate to firm undisturbed earth and fill as required. Slope adjacent grades away from excavations to minimize entry of water.

3.03 SHORING

- A. Provide shoring as necessary to properly and safely support earth sides of excavations, and existing curbs, sidewalks, gutter, drives and stairs, against movement and collapse.
- B. Design and Calculations: Provide in accordance with requirement of governing Cal-OSHA requirements.

- C. Remove shoring upon completion of the Work of this Section or when no longer needed unless required otherwise by authorities having jurisdiction.

3.04 EXCAVATION

- A. Unclassified Excavations: Comply with the Standard Specifications for Public Works Construction, Section 300: "Earthwork", except as modified herein.
- B. Form sides of footings, pads, grade beams, and slab foundations, unless otherwise indicated. Provide excavations of sufficient size to permit installation and removal of forms and other required Work.
- C. Machine-drill excavation for round footings to size and depth indicated. Provide a collar or casing, or other adequate protection, to exclude dirt and debris. Protect excavations with plank covers until concrete is placed.
- D. Provide excavation bottoms level and free from loose material. Excavate to indicated or required elevations of undisturbed earth.
- E. Barricade trenches, ditches, pits, sumps, and similar Work outside the barricaded working area with chain link fence as specified in Section 01 5000 - Construction Facilities and Temporary Controls, and in accord with Cal-OSHA standards and requirements.
- F. Trenches over five feet in depth shall comply with the Construction Safety Orders of the California Division of Industrial Safety.
- G. Where indicated or required to excavate in lawn areas, protect adjoining lawn areas outside of the Work area. Replace or install removed sod upon completion of backfill by installing sod level with adjacent lawns. If installation of removed sod fails, furnish sod and install to match existing lawns.
- H. For Structures:
 - 1. Calculate excavation quantities based on elevations or depths indicated on Drawings.
 - 2. Provide 2,000 psi concrete for backfill of over-excavated areas to indicated or required elevations.
 - 3. Special preparation of bottom of excavated planes areas: Excavate areas shown on Drawings as bottom of excavated planes (B.E.P.), by excavating and filling to indicated grades and elevations.
- I. For Utilities:
 - 1. Excavate trenches to required depth for utility lines, such as pipes, conduits, and tanks, with minimum allowance of 6 inches at the bottom and 6 inches at the sides for bedding or concrete encasement as indicated on Drawings. Grade bottom of trenches to a uniform smooth surface. Remove loose soil from the excavation before placing sand bedding or concrete encasement.
 - 2. Do not install piping lengthwise under concrete walks without review by the ARCHITECT.

3. Do not excavate trenches parallel to footings closer than 18 inches from the face of the footing or below a plane having a downward slope of two horizontal to one vertical, from a line 9 inches above bottom of footings.
 - a. Unless otherwise indicated on Drawings, depth of excavations outside buildings shall provide for a minimum coverage above top of piping, tank or conduit measured from the lowest adjoining finished grade, as follows:

Steel Pipe	24 inches below finish grade
Copper Water Tube	18 inches below finish grade
Cast-Iron, Pressure Pipe	36 inches below finished grade
Plastic Pipe (other than waste)	30 inches below finished grade
Tanks or other structure	36 inches below finished grade
Soil, sewer and storm drain	minimum 18 inches below finished grade, and as required for proper pitch and traffic load. Install polypropylene sewer pipe with at least 24 inches of coverage.
Irrigation Pipe:	Non-pressure pipe - 12 inches, pressure pipe - 24 inches.
 - b. Trench width shall provide space for fitting and joining. Excavate for piping bells and fittings, bell and spigot pipe and other fittings.
4. Where portions of existing structures, walks, paving, or other improvements are removed or cut for piping or conduit installation, replace the material with equal quality, finished to match adjoining existing improvements. Repair pavement as specified in Section 32 0117 - Pavement Repair.
5. Provide a minimum clear dimension of 2 inches from sides of wall excavation to outer surfaces of buried pipes or conduits placed in the same trench or outside surfaces of containers and tanks.

3.05 IMPORT/EXPORT OF MATERIALS

- A. Unclassified Fill and Compaction: Comply with the Standard Specifications for Public Works Construction, Section 300 - Earthwork, except as modified herein. Install and compact fill in layers not to exceed 6 inches in thickness.
- B. Provide fill materials as specified in Part 2- Products. If excavated materials from the Project site are not of required quality or sufficient quantity, import additional materials as necessary.
- C. In addition to the requirements of this Section, import and/or exported materials shall comply with the requirements of Section 01 4524, Environmental Import/Export Materials Testing.
- D. Imported fill materials shall be sampled by the Geotechnical Engineer, for compliance with the requirements of Part 2 of this Section.

- E. The Geotechnical Engineer, will submit the samples to an independent DSA approved testing laboratory for testing.
- F. Initial sampling and testing shall be performed before importing material to the Project site. Identify the location of the source site in addition to the address, name of the person and entity responsible for the source site. The Geotechnical Engineer, will obtain both the initial and additional samples from the identified site and submit samples for required testing.
- G. The Geotechnical Engineer will perform additional sampling during import operations. If the total quantity of import is determined to be greater than 1000 cubic yards of material, one sample shall be obtained and submitted for testing for each 250 cubic yards of imported material. If the total quantity of import is determined to be less than 1000 yards, one sample shall be obtained and submitted for testing for each 100 cubic yards of imported material.
- H. The independent approved testing laboratory will perform the required tests and report results of tests noting if the tested material passed or failed such tests and will furnish copies to the Project Inspector, ARCHITECT, OWNER, CONTRACTOR, and others as required. Report shall state tests were conducted under the responsible charge of a licensed State of California professional engineer and the material was tested in accordance with applicable provisions of the Contract Documents, California Building Code. Upon completion of the Work of this Section, the independent testing laboratory and Geotechnical Engineer will submit a verified report to the OWNER.
- I. Bills of lading or equivalent documentation will be submitted to the Project Inspector on a daily basis.
- J. Upon completion of import operations, provide the OWNER a certification statement attesting that imported material has been obtained from the identified source site.

3.06 INSTALLATION OF MATERIALS

- A. Pavement: Fill or backfill materials shall be installed in horizontal layers of 6 inches, unless otherwise required. Each layer shall be evenly placed and moistened or aerated as necessary. Unless otherwise reviewed by the Geotechnical Engineer, each layer of fill material shall cover the length and width of the area to be filled before the next layer of material is installed. Top surface of each layer shall be installed to an approximate level with a crown or crossfall of at least 1 in 50, but not more than 1 in 20. Provide adequate drainage at all times during installation of the Work of this Section.
- B. Structures:
 - 1. After concrete has been placed, forms removed, and concrete Work inspected, backfill excavations with earth to indicated or required grades. Backfill simultaneously on each side of walls or grade beams. Remove rubbish, debris and other waste materials from excavations before placing backfill.
 - 2. Before placing backfill, adequately cure concrete and provide bracing, if required to stabilize structure. Protect waterproofing or damp-proofing against damage during backfilling operations, with required protection board. Remove bracing as backfill operation progresses.

3. Do not furnish or install expansive soils for retaining wall backfill.
4. Rigidly control the amount of water to be installed to provide optimum moisture content for type of fill material furnished. Do not over-saturate or compact by flooding or jetting.
5. Install wall backfill before installing railings and fences on walls.
6. Install weep hole drainage at the backside of walls so the backing completely covers the weep holes, is horizontally centered and extends at least 12 inches above the bottom of the weep opening. Provide an 8-inch square section of 1/4 inch galvanized or aluminum screen, with a minimum wire diameter of 0.03 inch, and install at the backside of each weep hole before installing the backfill material.
7. Where a reviewed drainage matting system is provided instead of permeable backfill for retaining structures, install in accordance with the manufacturer recommendations.

C. Utilities:

1. Do not install backfill until the Work of this Section has been inspected and tested. Do not furnish or install materials excavated from the Project site containing materials not permitted for backfill.
2. Backfill electrical or other excavated utility trenches located outside of barricaded installation areas within 24 hours after inspection by the IOR.
3. Install backfill in layers not exceeding 4 inches in thickness, except cement-sand slurry.
4. If materials excavated from the Project site are not permitted for trench backfill in paved areas, backfill trenches with a cement-sand slurry mix. Install backfill to an elevation of the existing undisturbed grades plus one inch.

3.07 COMPACTING

- A. Each layer of fill material shall be compacted by tamping, sheepsfoot rollers, or pneumatic-tired rollers to provide specified relative compaction. At inaccessible locations, provide specified compaction by manually held, operated and directed compaction equipment.
- B. Install and compact sand bedding to provide a uniform bearing under the full length of piping and conduits.
- C. Unless otherwise indicated, compact each layer of fill material to a relative compaction of at least ninety percent.
- D. When fill materials, or a combination of fill materials, are encountered or provided which develop densely packed surfaces as a result of installation or compacting operations, scarify each layer of compacted fill before installing the next succeeding layer.

3.08 INSPECTION AND TESTING

- A. The Geotechnical Engineer will inspect and test excavations, sample material quality for testing as set required in Part 2, and observe installation and compaction of fill materials.
- B. The Geotechnical Engineer will sample imported fill materials from their designated source and submit samples to the independent approved testing laboratory before delivery to the Project site.
- C. Installation of backfill shall be observed by the Geotechnical Engineer.
- D. The Geotechnical Engineer will inspect and test excavation Work before the installation of fill and other materials.
- E. Compaction: Test compaction in accordance with ASTM D1557, Method C.
- F. The Project Inspector will inspect foundation excavations when completed and ready for forms, after forms are in place, and before first placement of concrete.

3.09 PROTECTION

- A. Protect the Work of this Section until Substantial Completion.

3.10 CLEANING

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 31 2326

BASE COURSE

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes:
 - 1. Installation of base material.
- B. Related Requirements:
 - 1. Division 01 - General Requirements.
 - 2. Section 31 1000 - Site Clearing.
 - 3. Section 31 2200 - Grading.
 - 4. Section 31 2313 - Excavation and Fill.

1.02 SUBMITTALS

- A. Crushed aggregate base (CAB) shall consist of native rock without naturally occurring asbestos or recycled materials. The CONTRACTOR shall submit written documentation, which identifies the source, volume, and proposed transport date of the material for review and approval by OWNER prior to importing the material. A statement on company letterhead from the CAB source, stamped by either a California Professional Geologist or Engineer, which states that the subject materials are native rock, do not contain any recycled materials and that the source quarry does not mine ultramafic materials, a source of natural occurring asbestos shall be included in the submittal to OWNER
- B. Product Data: Submit material source, technical information and test data for base materials. Gradation and quality certifications shall be dated within 30 days of the submittal.
- C. Sample: Submit sample of proposed base course material.

1.03 QUALITY ASSURANCE

- A. Comply with the following as a minimum requirement: Standard Specifications for Public Works Construction, current edition.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Crushed Aggregate Base (CAB) materials shall conform to the requirements of the Standard Specifications for Public Works Construction: Section 200 - Rock Materials.

- B. Crushed Miscellaneous Base (CMB) or materials generated on site shall not be used as a base course material.

2.02 MATERIAL APPROVAL

- A. Base material shall be inspected by the Project Inspector for gradation and material content prior to installation. The OWNER may choose to have additional tests performed by a geotechnical engineer, retained by the OWNER, before installation.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. Install base course material in layers not exceeding 4 inches in thickness, unless required otherwise. Grade and compact to indicated levels or grades, cut and fill, water and roll until the surface is hard and true to line, grade and required section. Provide a relative compaction of at least 95 percent, unless otherwise required.
- B. Grade base course to elevations indicated on Drawings, ready to receive surfacing, in accordance with Section 31 2200 - Grading.

3.02 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.03 CLEANUP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 31 2705

STABILIZED DECOMPOSED GRANITE PAVING

PART 1 - GENERAL

1.01 SUMMARY

- A. Section Includes:
 - 1. Installation of decomposed granite paving/
- B. Related Requirements:
 - 1. Division 01 - General Requirements.
 - 2. Section 31 1000 - Site Clearing.
 - 3. Section 31 2200 - Grading.
 - 4. Section 31 2313 - Excavation and Fill.

1.02 SUBMITTALS

- A. Product Data: Submit material source, technical information and test data for decomposed granite and related materials.
- C. Sample: Submit three sample of proposed decomposed granite material in clear one quart bags.

PART 2 - PRODUCTS

2.01 MATERIALS

- A. Decomposed granite shall be minus ¼” “Golden Tan” as available at Southwest Boulder and Stone (877) 792-7625, or approved equal.
- B. Stabilizer shall be Technisoil G3 pathway stabilizer, or approved equal.
- C. Landscape fabric shall be Mirafi M-Scape Geosynthetics, or approved equal.

PART 3 - EXECUTION

3.01 INSTALLATION

- A. Excavate the existing soil area to receive 4 inches of base material and 3 inches of decomposed granite. Use a vibrator plate compactor to compact base to 95%. Apply pre-emergent herbicide to decomposed granite area then lay down landscape fabric evenly throughout the area. Place a 4-inch layer of decomposed granite. Evenly grade using landscape rakes then apply pathway stabilizer evenly and thoroughly at the rate of 1 gallon per 20 sq. ft. After pathway stabilizer is fully absorbed into material,

compact surface to 95% using vibrator plate compactor. After compaction, the section of decomposed granite must be a minimum of 3 inches throughout.

- B. Install landscape fabric smooth and uniform throughout the D.G. area after the subbase has been approved by the Inspector. Secure with 6-inch galvanized 'U' pins at 24" o.c. around the perimeter and at 36 inches o.c. throughout. Pins shall be 6" x 1" x 6", 11 gauge galvanized.

3.02 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.03 CLEANUP

- A. Remove rubbish, debris, and waste materials and legally dispose of off the Project site.

END OF SECTION

SECTION 32 3113

CHAIN LINK FENCES AND GATES

PART 1 - GENERAL

1.01 SUMMARY

A. Section Includes:

1. Chain link fences and gates as indicated.

B. Related Requirements:

1. Division 01 - General Requirements.
2. Section 03 3000_ - Cast-in-Place Concrete.
3. Section 31 1000 – Site Clearing.
4. Section 31 2200 - Grading.

1.02 SUBMITTALS

- A. Shop Drawings: Submit dimensioned plans and details indicating extent of fences, locations of gates, and details of attachment and footings. Indicate means and methods for surface preparation and finishing.
- B. Certifications: Manufacturers material certifications in compliance with the ASTM standards referenced in this Section.

1.03 REFERENCES

- A. ASTM A392: Standard Specification for Zinc-Coated Steel Chain Link Fence Fabric.
- B. ASTM A780 - Standard Practice for Repair of Damaged and Uncoated Areas of Hot-Dip Galvanized Coatings.
- C. ASTM A824 – Standard Specification for Metallic-Coated Steel Marcellled Tension Wire for Use with Chain Link Fence.
- D. ASTM F552 - Standard Terminology Relating to Chain Link Fencing.

- E. ASTM C1107 – Standard Specification for Packaged Dry, Hydraulic-Cement Grout (Nonshrink).
- F. ASTM F567: Standard Practice for Installation of Chain Link Fence.
- G. ASTM F626 - Standard Specification for Fence Fittings.
- H. ASTM F668 - Standard Specification for Polyvinyl Chloride (PVC), Polyolefin and Other Polymer-Coated Steel Chain Link Fence Fabric.
- I. ASTM F900 - Standard Specification for Industrial and Commercial Swing Gates.
- J. ASTM F934 - Standard Specification for Standard Colors for Polymer-Coated Chain Link Fence Materials.
- K. ASTM F1083: Standard Specification for Pipe, Steel, Hot-Dipped Zinc-Coated (Galvanized) Welded, for Fence Structures.
- L. ASTM F1184: Standard Specification for Industrial and Commercial Horizontal Slide Gates.
- M. ASTM F1664 – Standard Specification for Poly Vinyl Chloride (PVC) and Other Conforming Organic Polymer-Coated Steel Tension Wire Used with Chain-Link Fence.
- N. ASTM F2200 - Standard Specification for Automated Vehicular Gate Construction.
- O. UL 325 - UL Standard for Safety Door, Drapery, Gate, Louver, and Window Operators and Systems.

1.04 QUALITY ASSURANCE

- A. Manufacturer: Company specialized in manufacturing chain link fence products with at least five years of experience.
- B. Fence Installer: Company with demonstrated successful experience installing similar projects and products in accordance with ASTM F567 and with at least five year experience.

PART 2 – PRODUCTS

2.01 CHAIN LINK FABRIC

- A. Galvanized Chain Link Fabric: Conforming to ASTM A392, Class 2 zinc coating, 2.00 ounces minimum per square foot of uncoated wire surface, hot-dipped galvanized after weaving, and with top and bottom edges knuckled (kk). Tie wires and hog rings shall conform to ASTM F626, and shall be 9 gage and galvanized.

B. Chain Link Fabric Requirements:

1. Fabric for perimeter fencing and interior fencing shall be 9 gage woven wire with 2 inch mesh, unless otherwise specified.
2. Fences 12 feet high or less shall be furnished with single width fabric.
3. Installed fence fabric shall be free from barbs, icicles, or other projections. Fence fabric with such defects will be deemed defective Work.

2.02

STEEL FENCE FRAMEWORK

- A. Posts, Top Rails, Brace Rails and Gate Frames: Standard weight, galvanized, welded steel pipe conforming to ASTM F1083, Group IA Heavy Industrial Fence Framework, with a minimum yield strength of 30,000 psi. Minimum 1.8 Oz/ft² hot dipped zinc coating average for interior and exterior.
- B. Schedule of Posts, Rails, Bracings and Footings: Unless indicated otherwise on the drawings, shall be of sizes indicated on the following schedule.

Item	Height	Nominal Pipe Size (inches)	Outside Diameter (inches)	Weight (pounds per foot)	Footings	
					Diameter (inches)	Depth (inches)
Top Rail, Brace Rails and Transom Rails	Up to 10'-0"	1-5/8	1.660	2.27	N/A	N/A
	10'-1" to 16'-0"	1-7/8	1.900	2.72	N/A	N/A
Line Posts	Up to 6'-0"	2-3/8	2.375	3.65	12	24
	6'-1" to 8'-0"	2-3/8	2.375	3.65	12	36
	8'-1" to 10'-0"	2-7/8	2.875	5.80	12	36
	10'-0" to 16'-0"	3-1/2	3.5	7.58	14	60
	14'-0" to 16'-0"	4	4.000	9.12	14	60
Terminal, Corner, Angle & Pull Posts	Up to 8'-0"	2-1/2	2.875	5.79	12	36
	8'-0" to 10'-0"	2-1/2	2.875	5.79	14	42
	10'-1" to 16'-0"	3	3.5	7.58	14	60
Pedestrian Gate Posts	Up to 8'-0"	2-1/2	2.875	5.79	14	36
Gate Frames	Up to 8'-0"	1-1/2	1.900	2.72	N/A	N/A
Driveway Double- Leaf Swing Gate Posts: Opening						
Up to 17'-3-1/2"	Up to 8'-0"	3 1/2	4	9.11	16	42

Item	Height	Nominal Pipe Size (inches)	Outside Diameter (inches)	Weight (pounds per foot)	Footings	
					Diameter (inches)	Depth (inches)
17'-4" to 20'-3-1/2"	Up to 8'-0"	3-1/2	4	9.11	16	42

2.03 FITTINGS

- A. Fittings shall be malleable iron conforming to ASTM F626.
- B. Post Caps: Designed to fit snugly over posts with a minimum projection of 1-1/2 inches below top of posts. Post caps shall be manufactured with a curved top.
- C. Eye Tops: Designed to fit over line posts, and for through passage of top rail.
- D. Expansion Sleeve Couplings for Top Rails: Steel, 6 inches long, designed to fit tightly on inside of rail, fitted with raised center.
- E. Rail Ends for Top Rails and Brace Rails: With holes to receive 3/8 inch bolts for securing to rail end bands.
- F. Tension Bands and Bands for Securing Rail Ends: Mild steel flats, at least 11 gage x one inch, tension bands in gates shall be 11 gage by 1 inch. Bolts for use with tension bands and rail end bands shall be galvanized machined 3/8 inch by 1 1/2-inch.
- G. Tension Bars: Mild steel flats at least 3/16 inch by 3/4 inch.

2.04 TENSION WIRE

- A. 6 gage marcelled steel wire conforming to ASTM A824, Type II Class 5 zinc coated, 2.00 ounces minimum per square foot of uncoated wire surface. Wavy type wire is not acceptable.
- B. Turnbuckles for installation with Tension Wires: Eye and hook type, drop forged steel, right and left hand threads, at least 3/8 inch screw diameter with at least 4 1/2-inches of take-up.

2.05 PAINT FOR GALVANIZING REPAIR

- A. Paints for Refurbishing Galvanizing: Organic zinc-rich paint conforming to ASTM A780.

2.06 GROUT

- A. Nonshrink, Nonmetallic Grout: Factory-packaged, non-staining, noncorrosive, nongaseous grout complying with ASTM C1107. Provide grout specifically

recommended by manufacturer for interior and exterior applications “Rapid set Cement”.

2.07 GATES

A. General:

1. Gate framework shall be fabricated of tubular steel of sizes indicated on the drawings and conforming to ASTM F1083, Group IA, with a minimum yield strength of 30,000 psi. Joints at corners shall be miter cut and continuously welded to sides.
2. Install fence fabric to side members with tension bars and tension bands as specified, spaced not more than 14 inches apart. Tension bars shall extend full height of gate. Install fence fabric to top and bottom members and to brace rail with wire ties as specified for top rails, spaced not more than 12 inches apart. Chain link fabric shall match adjacent fence system.
3. Latches and Hinges: Weld gate latches and strikes to gate posts and frames. Weld hinges to posts. Weld 3 hinges on each post for swing gates more than 16 feet wide. Welding shall be performed before gate frames are galvanized, or welds shall be finished as specified below.
4. Grind welds flush and smooth. Hot-dip galvanize fabricated parts after welding, or be protected by zinc-rich paint in conformance to ASTM A780.

- B. Swing Gates: Galvanized steel welded fabrication in conformance with ASTM F900, fabric size and gage shall match fence. Positive locking gate latch shall be fabricated of 5/16 inch thick by 1 3/4 inch pressed steel galvanized after fabrication.

2.08 CONCRETE

- A. Comply with requirements of Section 03 3000, Cast-in-Place Concrete. Provide normal-weight, air-entrained concrete with a minimum 28-day compressive strength of 3,000 psi, 4-inch slump, and one inch maximum size aggregate.

PART 3 - EXECUTION

3.01 EARTHWORK

- A. Refer to the following Sections for earthwork related work:
1. Section 31 2200 - Grading.
 2. Section 31 2313 - Excavation and Fill.

3.02 FRAMEWORK INSTALLATION

- A. Install fences as indicated on Drawings.
- B. Space fence posts at equal intervals between terminal, angle, corner, and gate posts, and not more than 10 feet apart measured from center to center of posts. In curved fence sections having a radius of 50 feet or less, space posts not more than 5 feet - 6 inches apart. Install posts so that top of eye of post caps are level with top of fabric.
- C. Install angle or corner posts at each change in direction of 15 degrees or more, at change of 5 percent or more in grade of fencing, and at the beginning and end of curved fence sections.
- D. Install terminal posts at ends of runs of fencing. Install gateposts on both sides of driveway and pedestrian gates. For double-leaf gates, net opening between gate posts shall be gate size as indicated on Drawings, plus 3 ½-inches; for single leaf gates, net opening shall be gate size plus 2 ½-inches.
- E. Embed posts into footing 6 inches less than the depth of the footing unless noted otherwise on drawings.
- F. Where a fence is to be installed on a curb, construct footings with top of footing level with the lower finish grade. Align posts, set plumb and true before placing footings. Remove splattered concrete from exposed pipe surfaces while concrete is still soft. In bituminous surfaced areas, install seal coat on top of concrete footings.
- G. Install fences with top rail. Top rail shall pass through eye tops and be secured at ends with rail-end fittings and bands.
- H. Install fences over 10 feet in height, in addition to top rail, with a full length horizontal mid-rail set at mid-height of fence and rigidly secured to posts with rail end fittings and bands.
- I. In fences higher than 10 feet, install brace rails at angles, corners, and terminals at 1/4 and 3/4 of fence height. Provide one horizontal brace rail in panels adjacent to terminal, angle, corner, and gateposts, install at mid-height of fence and rigidly secured to posts with rail end fittings and bands. Provide horizontal brace rails, as specified, in panels of curved sections having a radius of 50 feet or less. Brace rails are not required in fencing 4 feet or less in height.
- J. Provide a transom rail and fabric at top of pedestrian gate openings. Install transom rail 6 feet 8 inches above high point of grade at gate opening. Ends of transom rails shall be pinned or riveted to rail end fittings with 1/4 inch mild steel rivets. Pin or rivet shall go through rail and peen. Welding on rail ends is not permitted.
- K. Install bottom tension wire a minimum of 3 inches from grade for fencing and secure to fence posts with ties. Provide a turnbuckle for each 150 feet of wire or fractional part

thereof. Turnbuckles are not required in runs of 15 feet or less. Install ends of tension wires to posts in a manner to prevent slipping or loss of tension. Wrap should start from fence side of post. Turn end of wire around post tightly twisted at least three times around wire. At turnbuckles, wire through eye and tightly twist end at least three times around wire. Cut tail of bottom wire flush.

3.03 CHAIN LINK FABRIC INSTALLATION

- A. Install fence fabric on outward facing side of posts, except for tennis courts. Install fence fabric with top edge projecting above top rail of fence.
- B. Install bottom of fence fabric to clear finish grades, except on bituminous surface install 3/4 inch above such surface. Locally shape and trench ground surfaces where necessary to provide uniform top and bottom alignment of fence.
- C. Tightly stretch fabric and at terminal, pull corner, angle, and gateposts, secure with tension bars extending full height of fence. Secure tension bars to posts with bolted tension bands spaced not more than 14 inches apart.
- D. Bands and Ties: Install bands and ties in accordance with following schedule:

15 bands on 16 feet fence	16 ties on 16 feet fence
11 bands on 12 feet fence	12 ties on 12 feet fence
7 bands on 8 feet fence	7 ties on 8 feet fence
6 bands on 6 feet fence	6 ties on 6 feet fence
4 bands on 4 feet fence	4 ties on 4 feet fence
- E. Fasten fabric to line posts with wire ties spaced not more than 16 inches apart. Where 6 gage aluminum ties are furnished, hook the tie at both ends. Installation of hooked ties with links is not permitted.
- F. Fasten fabric to top rails, mid-rails, brace rails, with wire ties spaced not more than 18 inches apart. Bend back ends of tie wires so as not to be a hazard. At bottom tension wire, install hog rings spaced not more than 18 inches apart. Where 2 fabrics are furnished, lap the fabrics one mesh at mid-rail and tie both fabrics with 9 gage wire or 6 gage aluminum ties to midrails.

3.04 WELD GRINDING

- A. Grind all field welds smooth, clean off flux and spatter, damaged galvanizing removed, burrs and projections ground off, properly prepared, then heavily coated with galvanizing repair coating. Install coating in accordance with written recommendations of manufacturer.

3.05 INSTALLATION OF GATES

- A. Provide gates of the sizes indicated on Drawings. Allow clearance on gates of 1-1/2 inches at bottom and one inch at top. Construct gates installed in sloping areas to conform to the grade. Provide an opening in each gate for access to locking device or padlock. Knuckle ends of fabric cut for opening to eliminate hazards.
- B. Sliding Gates and Swing Gates: Fabricate and install as indicated on Drawings. Wheel housing shall be designed to fit tightly to roll track and prevent gate from rolling over objects. Unsupported cantilever type roll gates are not acceptable. Install gate stops in accordance with the drawings. Both top and track stops are required.

3.10 COMPLETION

- A. Completed fencing shall form continuous units between points indicated with required parts, accessories, and fittings provided and installed. Clean exposed metal surfaces of cement, grout and other foreign substances.
- B. Fill in holes left by removal of existing fence footings, except in areas where grading Work is indicated or specified, to existing grade with clean earth thoroughly compacted to at least same density as adjoining soil.

3.11 PROTECTION

- A. Protect the Work of this section until Substantial Completion.

3.12 CLEANUP

- A. Remove rubbish, debris and waste materials and legally dispose of off the Project site.

END OF SECTION